



BURNSIDE

**Functional Servicing and Stormwater
Management Design Report**

**65-69 Bridge Street
Elora ON N0B 1S0**

**Elora greens Housing Developers
120 Matheson Boulevard East
Mississauga ON L4Z 1X1**



BURNSIDE

Functional Servicing and Stormwater Management Design Report

**65-69 Bridge Street
Elora ON N0B 1S0**

**Elora Greens Housing Developers
120 Matheson Boulevard East
Mississauga ON L4Z 1X1**

**R.J. Burnside & Associates Limited
292 Speedvale Avenue West Unit 20
Guelph ON N1H 1C4 CANADA**

**August 2026
300061644.0000**

Distribution List

No. of Hard Copies	PDF	Email	Organization Name
0	Yes	Yes	Township of Centre Wellington

Record of Revisions

Revision	Date	Description
1	July 22, 2026	Issued for Client Review
2	July 30, 2026	Issued for Site Plan Approval
3	August 20, 2026	Updated Geotechnical Report and Issued for Site Plan Approval

R.J. Burnside & Associates Limited**Report Prepared By:**


Daniel Smuk
Engineering Assistant
DS:js/tm/af

Report Reviewed By:

Angela Kroetsch, P.Eng.
Regional Leader, Residential Land Development

Table of Contents

1.0	Introduction.....	1
2.0	Site Information.....	1
3.0	Proposed Development.....	2
3.1	Sanitary Servicing.....	2
3.2	Storm Servicing	2
3.3	Watermain Servicing.....	3
3.4	Foundation Drainage	3
4.0	Stormwater Management	4
4.1	Design Criteria.....	4
4.2	Existing Conditions	5
4.3	Allowable Release Rates	7
4.4	Post-Development Conditions	7
4.5	Routing – Post-Development Conditions	9
4.6	Volume Retention	11
4.7	Quality Control Treatment.....	11
5.0	Water Balance	11
5.1	Design Infiltration Rates.....	11
5.2	Monthly Water Balance and Annual Recharge.....	11
6.0	Erosion Protection and Sediment Control	15
7.0	Conclusions	16

Tables

Table 1: Proposed Sanitary Sewer Design Flows	2
Table 2: Chicago Storm Parameters per City of Guelph Design Criteria	4
Table 3: Horton Parameters Utilized in the MIDUSS Model	4
Table 4: Existing Condition Flow Rates and Runoff Volumes	5
Table 5: Allowable Release Rates	7
Table 6: Post-Development Condition Flow Rates and Runoff Volumes for 2- to 100-Yr Design Storm Events	9
Table 7: Comparison of Existing Condition Peak Flow Rates, Allowable Release Rates, and Post-Development Flow Rates	9
Table 8: Comparison of Peak Flow Rates and Runoff Volumes to the Bridge Street ROW	10
Table 9: Comparison of Peak Flow Rates and Runoff Volumes to the Rear Yard	10
Table 10: Monthly Water Balance Components (Table WB-1).....	13
Table 11: Water Balance – Existing Conditions and Post-Development (With No SWM/LID Measures) (Table WB-2).....	14

Figures

Figure 1: Existing Conditions Drainage Catchment Areas.....	6
Figure 2: Proposed Development Drainage Catchment Areas.....	8

Appendices

Appendix A	Sanitary Demand Calculations
Appendix B	Stormwater Calculations
Appendix C	Geotechnical Investigations
Appendix D	Water Balance Calculations

1.0 Introduction

R.J. Burnside & Associates Limited (Burnside) has been retained by Elora Greens Housing Developers to prepare a Functional Servicing and Stormwater Management Design Report for the proposed re-development at 65-69 Bridge Street in the Township of Centre Wellington (Elora).

This Functional Servicing and Stormwater Management Design Report has been prepared to support the building permit application submission for the re-development of the Site, and to document the Site servicing and stormwater management (SWM) design.

The topographic and legal boundary survey of the Site was completed by Van Harten Surveying Inc. (dated September 5, 2024). The Site Plan was prepared by MHBC Planning Urban Design & Landscape Architecture (received on July 10, 2026). The Elevation and Floor Plan was prepared by Greystone Limited (received on July 7, 2026).

2.0 Site Information

The subject site, 65 to 69 Bridge Street, is approximately 0.102 ha in size and is located on the west side of Bridge Street, approximately 60 m south of the intersection of Clarke Street and Bridge Street. The Site is bound by existing residential development to the north, Bridge Street right-of-way (ROW) to the east, the existing Elora-Cataract Trail to the south and existing residential development to the west. The existing site comprises of a vacant lot with deciduous trees along the edges near the Elora-Cataract trail and Bridge Street.

3.0 Proposed Development

The proposed development consists of four townhouse units – Parcels 1, 2, 3, and 4. Each parcel will have one internal accessory dwelling unit for a total of eight units. Driveway access for Parcels 1, 2, 3, and 4 will be provided via Bridge Street. All existing structures on Site are to be removed.

3.1 Sanitary Servicing

Under existing conditions, the Site is not serviced by any sanitary sewers. There is currently an existing 300 mm diameter sanitary sewer that extends across the frontage of the Site on Bridge Street.

Four new 100 mm diameter sanitary sewer service laterals will be extended from the existing 300 mm diameter sanitary sewer on Bridge Street to service each of the new units (Parcel 1, Parcel 2, Parcel 3, and Parcel 4).

The proposed sanitary sewer design flows discharging from the Site to the existing 300 mm diameter sanitary sewer are presented in Table 1. Sanitary sewer design calculations are provided in Appendix A.

Table 1: Proposed Sanitary Sewer Design Flows

	Anticipated Sanitary Sewer Design Flow
Average Domestic Sanitary Sewer Flow (eight units @ 2.351 people per unit, @ 350 L/capita/day)	0.00007697 m ³ /s
Peak Sanitary Sewer Flow (PF = 4.0, based on Harmon's Formula)	0.00030788 m ³ /s
Extraneous Flow	0.0000153 m ³ /s
Total Sanitary Flow	0.0003232 m³/s
Existing 300 mm diameter sanitary sewer capacity (@ 0.5% grade)	0.0662947 m ³ /s

Therefore, the anticipated sanitary sewer flow discharging to the existing 300 mm diameter sanitary sewer on Bridge Street is 0.00040015 m³/s.

3.2 Storm Servicing

Under existing conditions, stormwater runoff generated from within the Site sheetflows overland to the adjacent residential property located at the rear of the Site and to the existing Elora-Cataract Trail. The Site is not currently serviced by any storm sewers. There is currently an existing 600 mm diameter concrete storm sewer along the frontage of the Site on Bridge Street.

Upon re-development, runoff generated from the Site will continue to sheetflow overland to both the Bridge Street ROW and to the rear yard. As discussed with Elora, runoff generated from the majority of the Site is to be directed to either the Bridge Street ROW or to the existing Elora-Cataract Trail. Runoff discharging to the adjacent residential property located at the rear of the Site is to be minimized.

Foundation drainage for each of the new parcels will be provided by the extension of four 150 mm diameter storm service laterals from the existing 600 mm diameter storm sewer on Bridge Street. These storm sewer service laterals will provide an outlet for the foundation drainage from each unit. Each unit will be designed and constructed with an internal sump pit and pump system, ultimately discharging to the storm sewer service lateral.

The site's SWM design is described in Section 4.0.

3.3 Watermain Servicing

The existing property is not serviced by any watermain. There is an existing 200 mm diameter watermain on Bridge Street that extends across the frontage of the property.

Four new 50 mm diameter water service laterals will be extended from the existing 200 mm diameter watermain on Bridge Street to service each of the new units (Parcel 1, Parcel 2, Parcel 3, and Parcel 4). A 32 mm diameter water service lateral will then be extended from property line to each parcel.

As per the Township of Centre Wellington Water and Wastewater Servicing Master Plan (dated May 16, 2025), the residential water servicing demand is 280 l per capita per day (223.7 L/c/d residential +56.3 L/c/d non-revenue water), with the average historical water loss of 20.1%. Based on an occupancy of 2.351 people per unit, the total daily water demand per unit is 658.28 L/day. Therefore, the anticipated water demand is 5,266.24 L/day for the eight units.

3.4 Foundation Drainage

Foundation drainage for the proposed development (four townhouse units) will be provided via sump pump(s) discharging to storm sewer service laterals. Storm sewer service laterals are proposed to be connected to sump pumps in each of the parcels, ultimately discharging to the existing storm sewers located on Bridge Street.

4.0 Stormwater Management

4.1 Design Criteria

From the Township of Centre Wellington Development Manual (dated June 2024) and pre-consultation meeting notes (dated May 21, 2026), the SWM criteria for the Site are as follows:

- Control post-development peak flows to pre-development levels for all design storm events (2- to 100-year).
- Volume control performance should be evaluated for the 25 mm storm event, with infiltration maximized where feasible.
- Provide enhanced protection of water quality treatment in accordance with the MECP Stormwater Management Planning and Design Manual (2003) standards, achieving a minimum of 80% total suspended solids (TSS) removed.
- Maintain pre-development recharge rates, volumes, and hydroperiods to the extent possible under post-development conditions.
- Provide erosion control measures in accordance with the MECP guidelines and the requirements of Elora and Grand River Conservation Authority (GRCA).

The hydrologic model MIDUSS (Version 2.25) was utilized to determine the peak flow rates and volumes generated from the Site under both existing and post-development conditions. The Township of Centre Wellington Fergus Shand Dam – Chicago Storm parameters were used to model the 2- to 100-year design storm events and are summarized in Table 2.

Table 2: Chicago Storm Parameters per City of Guelph Design Criteria

	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
a	414.876	544.711	627.308	746.059	820.361	901.088
b	0.0268	0.0206	0.0136	0.0851	0.0100	0.0426
c	0.682	0.686	0.687	0.692	0.691	0.692
r	0.375	0.375	0.375	0.375	0.375	0.375
Duration (min)	240	240	240	240	240	240

The Horton infiltration method was used in the MIDUSS model. The Horton parameters utilized are summarized in Table 3.

Table 3: Horton Parameters Utilized in the MIDUSS Model

Parameter	Impervious Areas	Pervious Areas
Maximum Infiltration	0.00 mm/hr	75.0 mm/hr
Minimum Infiltration	0.00 mm/hr	12.5 mm/hr
Lag Constant	0.05 hr	0.25 hr
Depression Storage	1.50 mm	5.0 mm

4.2 Existing Conditions

Under existing conditions, the 0.102 ha site has been modelled as one catchment area as follows:

- Catchment 100 is 0.102 ha in size with an imperviousness of 5%. Catchment 100 represents the existing vegetated site. Under existing conditions, runoff generated from Catchment 100 sheetflows overland to the rear of the Site and the adjacent property. The Clarke Street SWM facility is located approximately 50 m west of the property.


Refer to Figure 1 for details.

Refer to Appendix B for the Existing Condition MIDUSS modelling files.

In summary, the existing condition flow rates and runoff volumes generated from the Site are as follows:

Table 4: Existing Condition Flow Rates and Runoff Volumes


	Peak Flow Rate (m ³ /s) and Runoff Volumes (m ³)					
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Catchment 100	0.003m ³ /s	0.009m ³ /s	0.013m ³ /s	0.019m ³ /s	0.024m ³ /s	0.029 m ³ /s
	4.82m ³	11.03m ³	15.73m ³	22.08m ³	27.26m ³	32.66 m ³
Total Flow Rate from Site	0.003m ³ /s	0.009m ³ /s	0.013m ³ /s	0.019m ³ /s	0.024m ³ /s	0.029 m ³ /s
Total Runoff Volume from Site	4.82m ³	11.03m ³	15.73m ³	22.08m ³	27.26m ³	32.66 m ³

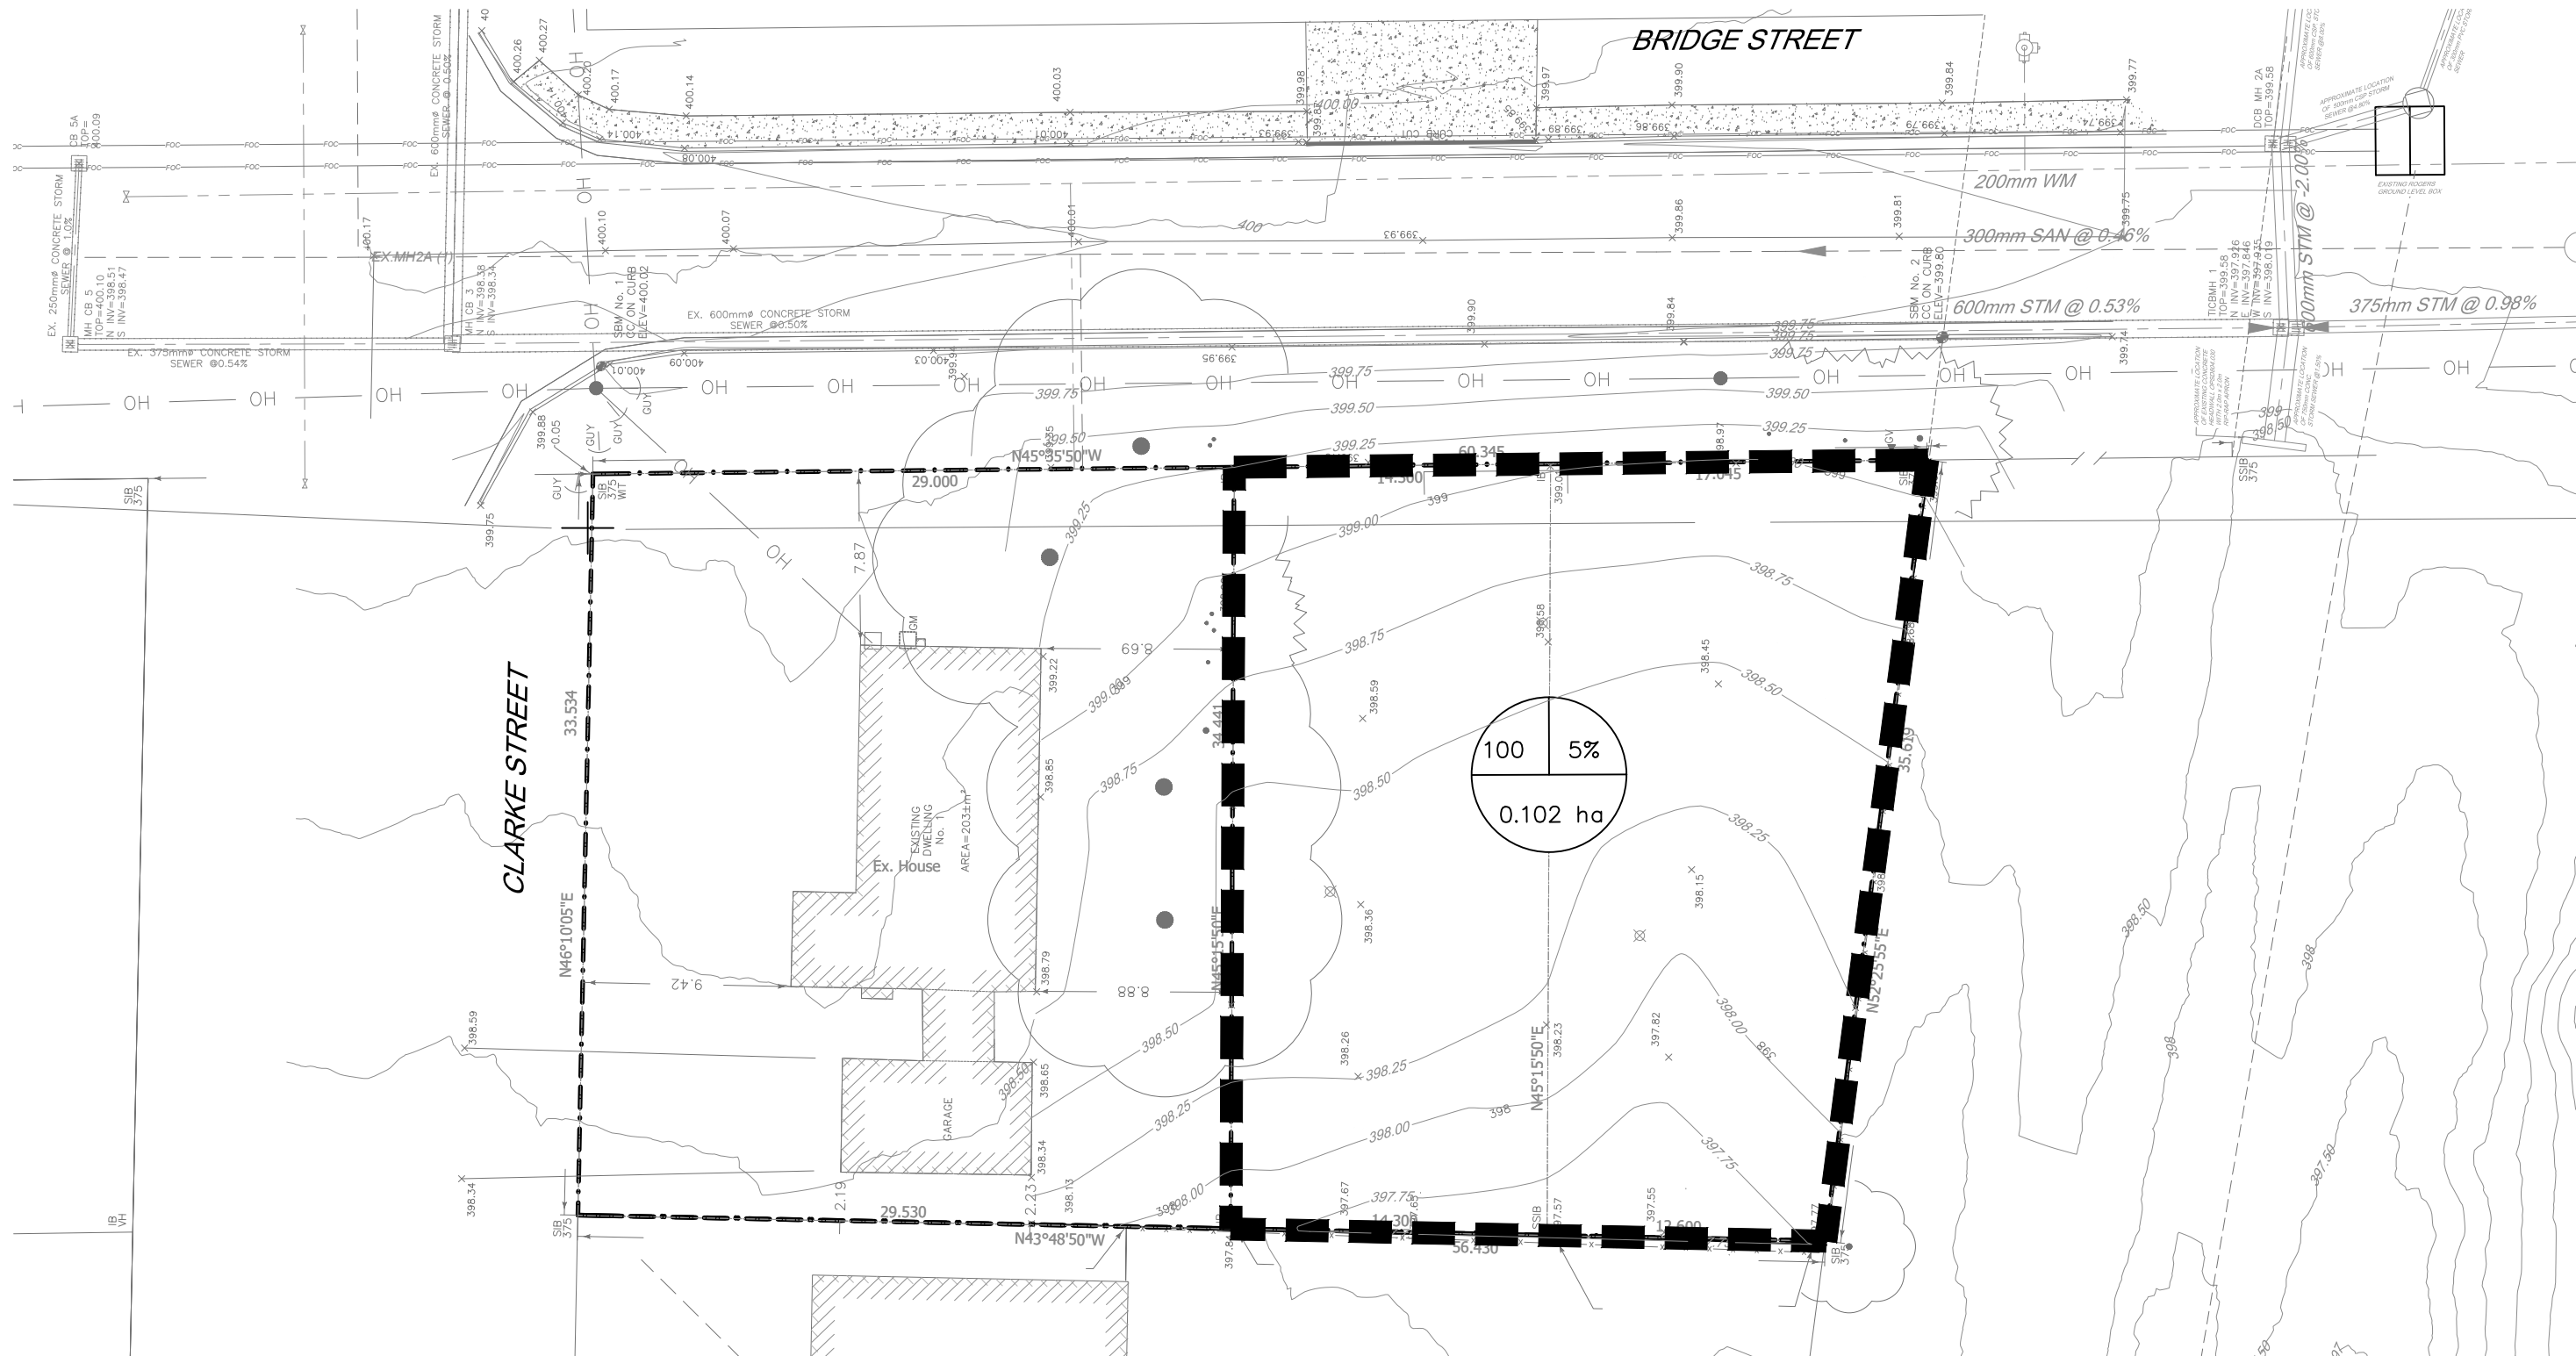

- Notes
1. This drawing is the exclusive property of R. J. Burnside & Associates Limited. The reproduction of any part without prior written consent of this office is strictly prohibited.
 2. The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to this office prior to construction.
 3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

NOT FOR CONSTRUCTION


LEGEND

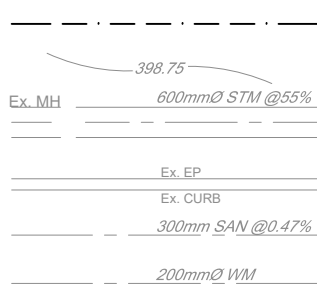

PROPERTY BOUNDARY
EXISTING CONTOURS
EXISTING STORM SEWER
EXISTING CURB & GUTTER
EXISTING SANITARY SEWER
EXISTING WATERMAIN



DRAINAGE BOUNDARY
DRAINAGE AREA NUMBER
PERCENT IMPERVIOUS DRAINAGE AREA (ha)



R.J. Burnside & Associates Limited

292 Speedvale Ave. W., Unit 20
Guelph, Ontario, N1H 1C4
telephone (519) 823-4995
fax (519) 836-5477

Client

ELORA GREENS HOUSING DEVELOPERS

120 MATHESON BLVD E
MISSISSAUGA, ON
L4Z 1X1

Project Name

65-69 BRIDGE STREET
ELORA, ON

Drawing Title

EXISTING CONDITION DRAINAGE CATCHMENT AREAS

Drawn

AB

Checked

MB

Date

26/05/05

Project No.

300061644

Drawing No.

FIG1

4.3 Allowable Release Rates

As per Elora SWM criteria, all post-development peak flows generated from the Site are to be controlled to the pre-development levels for the full range of design storm events (2- to 100-year design storm events). A summary of the allowable release rates from the Site is provided in Table 5.

Table 5: Allowable Release Rates

	Allowable Release Rate (m ³ /s)					
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Total Flow from Site	0.003	0.009	0.013	0.019	0.024	0.029


4.4 Post-Development Conditions

Under post-development conditions, the 0.102 ha site have been modelled as two catchment areas as follows:

- Catchment 1000 is 0.072 ha in size with an imperviousness of 75%. It includes the entire dwellings, driveways, and front yard area. The proposed drainage pattern directs roof runoff from the townhouse units towards the front of the property. Under post-development conditions, runoff generated from Catchment 1000 will sheetflow uncontrolled to the Bridge Street ROW.
- Catchment 2000 is 0.030 ha in size with an imperviousness of 5%. Catchment 2000 represents the rear and side yard areas for the Site. Runoff generated from Catchment 2000 will be directed to the swale in the rear yard, ultimately discharging to the Elora-Cataract Trail along the south boundary of Site. Infiltration structures were considered, but were not feasible due to the soil conditions, high groundwater levels and drainage concerns raised by adjacent property owners.

Refer to Figure 2 for details.


Refer to Appendix B for the Post-Development Condition MIDUSS modelling files.

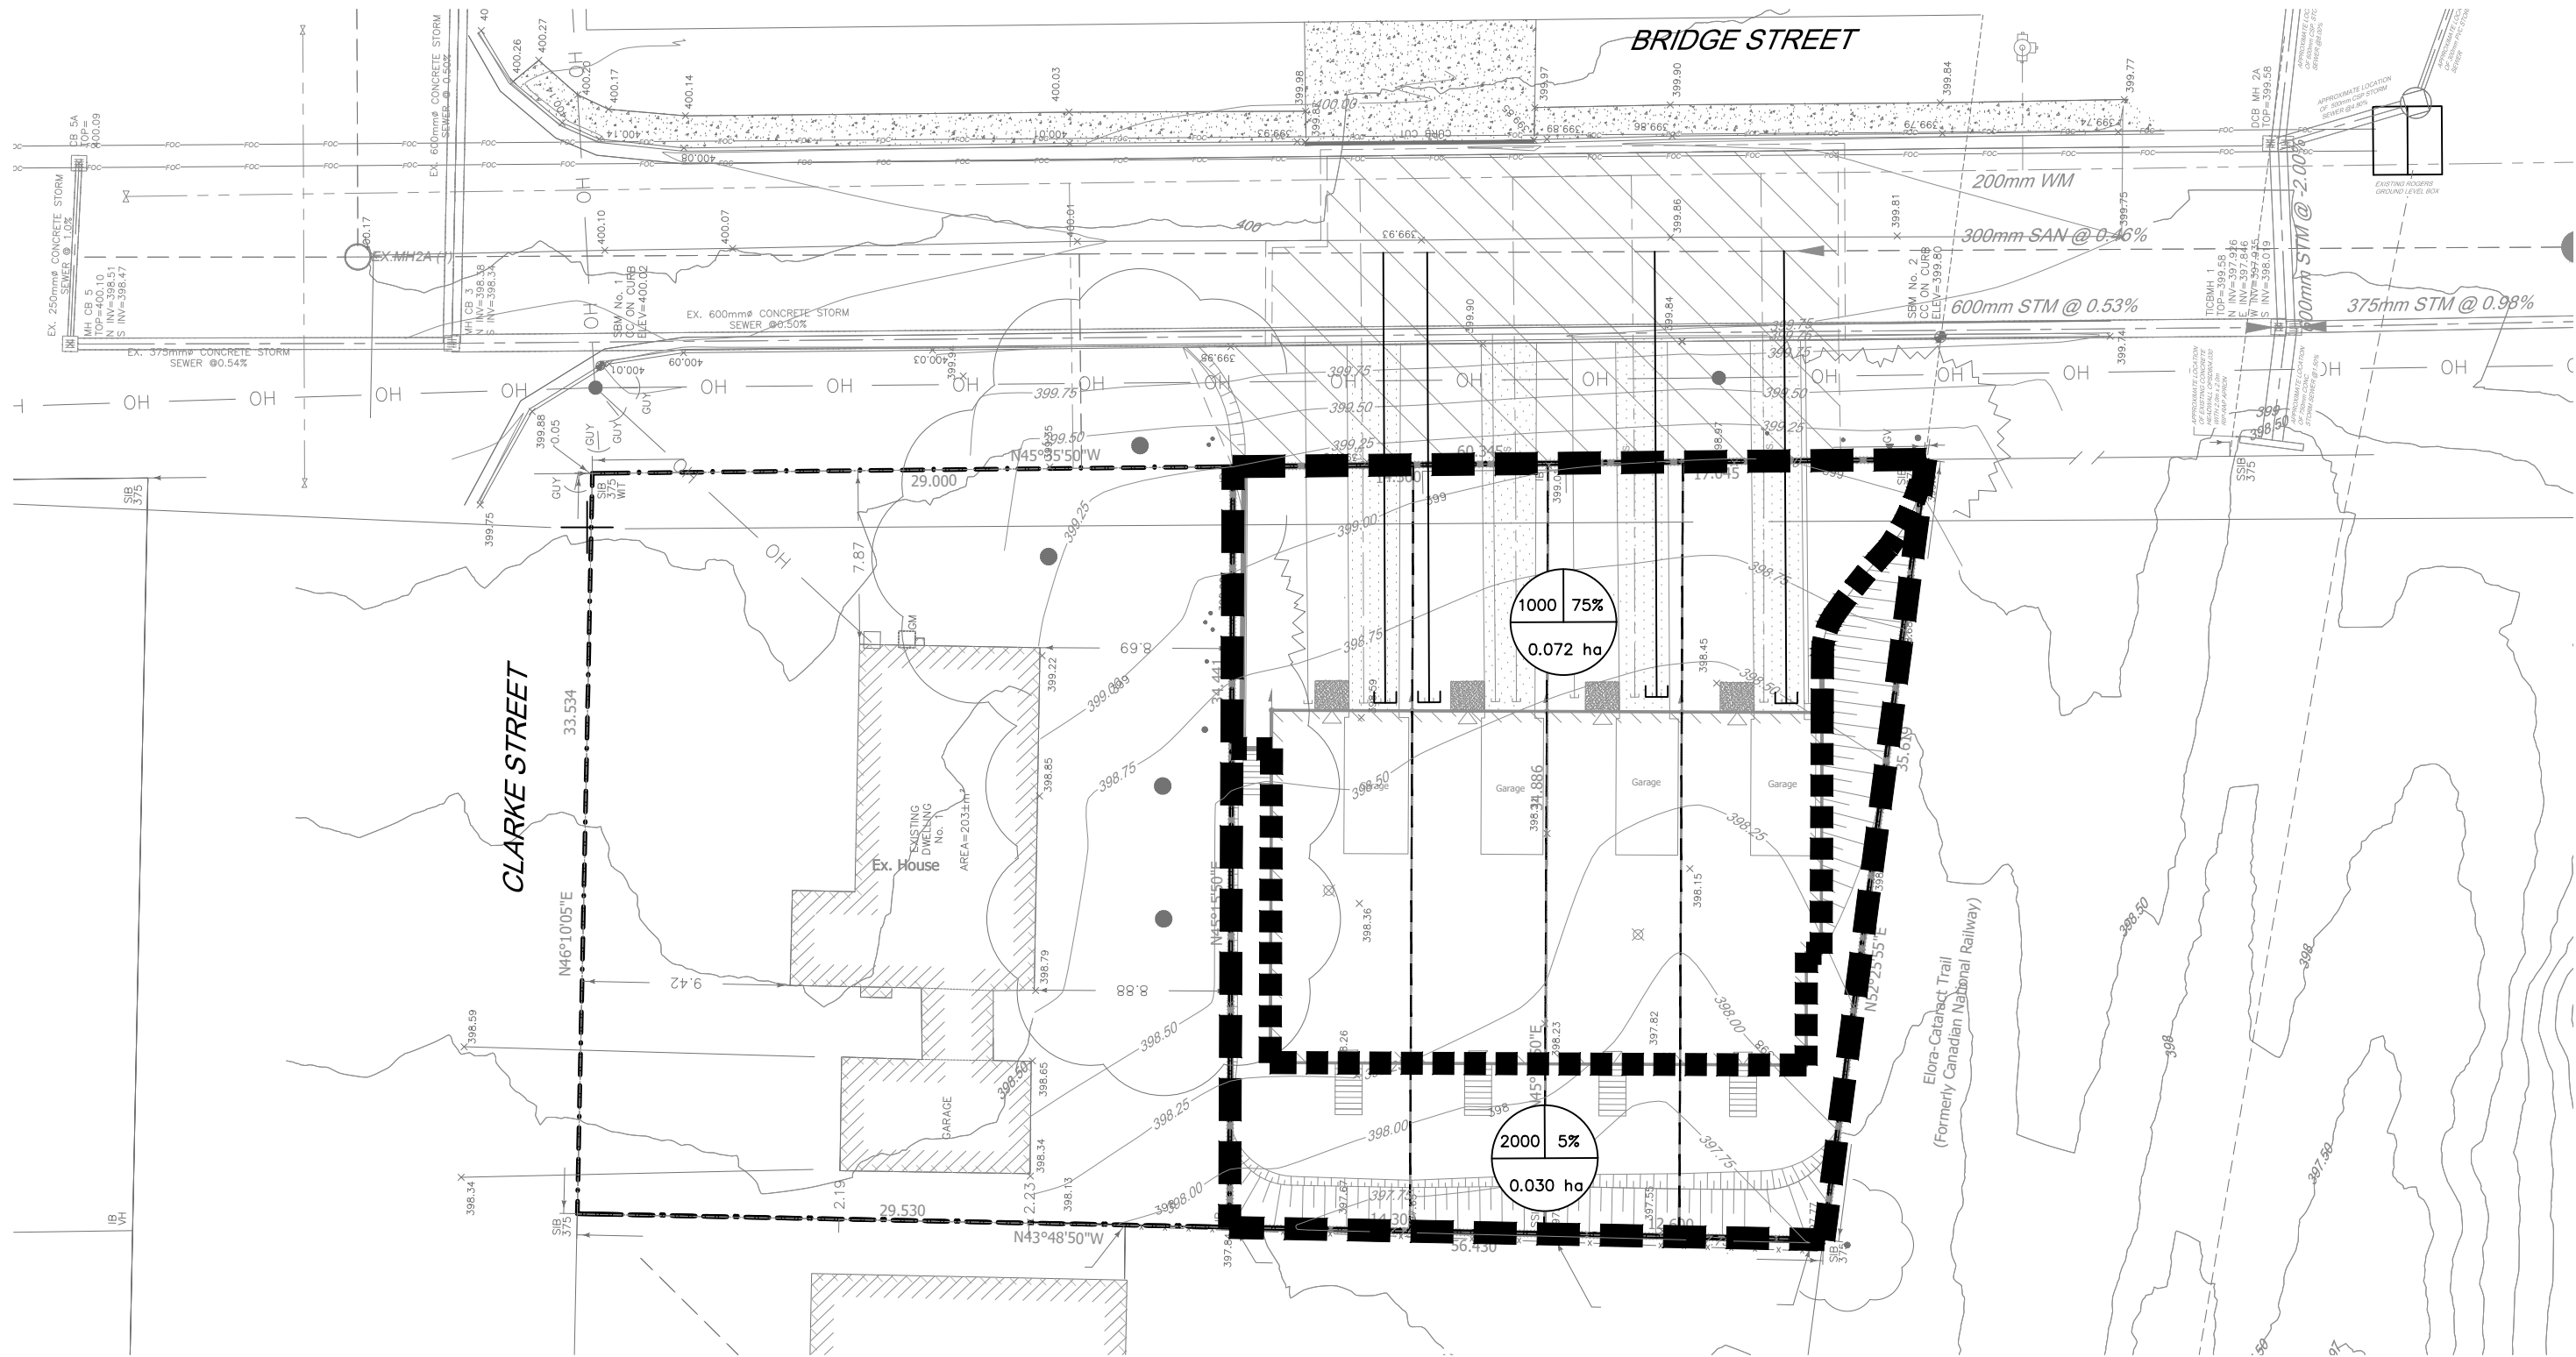

- Notes
1. This drawing is the exclusive property of R. J. Burnside & Associates Limited. The reproduction of any part without prior written consent of this office is strictly prohibited.
 2. The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to this office prior to construction.
 3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

NOT FOR CONSTRUCTION

LEGEND

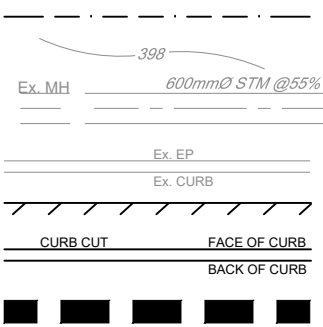

PROPERTY BOUNDARY
EXISTING CONTOURS
EXISTING STORM SEWER
EXISTING CURB & GUTTER
PROPOSED BUILDING
PROPOSED CURB & GUTTER
DRAINAGE BOUNDARY



PROPOSED STORM / SANITARY SEWER
PROPOSED IN-LINE DRAIN/ CLEANOUT (SEE DETAIL)
PROPOSED INFILTRATION GALLERY (SEE DETAIL)
DRAINAGE AREA NUMBER
PERCENT IMPERVIOUS DRAINAGE AREA (ha)



R.J. Burnside & Associates Limited

292 Speedvale Ave. W., Unit 20
Guelph, Ontario, N1H 1C4
telephone (519) 823-4995
fax (519) 836-5477

Client

ELORA GREENS HOUSING DEVELOPERS

120 MATHESON BLVD E
MISSISSAUGA, ON
L4Z 1X1

Project Name

65-69 BRIDGE STREET
ELORA, ON

Drawing Title

PROPOSED DEVELOPMENT DRAINAGE
CATCHMENT AREAS

Drawn

AB

Checked

MB

Date

26/05/05

Project No.

300061644

Drawing No.

FIG2

4.5 Routing – Post-Development Conditions

The post-development conditions were modelled using MIDUSS to calculate the peak flow rates and volumes from the Site. The design storm peak flow rates and runoff volumes under post-development conditions are summarized in Table 6. The existing conditions peak flow rates, allowable release rates, and post-development conditions peak flow rates are summarized in Table 7. The peak runoff volumes and flow rates for the Bridge Street ROW are summarized in Table 8. The peak runoff volumes and flow rates for the rear yard are summarized in Table 9.

A summary of the post-development condition peak flow rates and runoff volumes for the 2- to 100-year design storm events are presented in Table 6.

Table 6: Post-Development Condition Flow Rates and Runoff Volumes for 2- to 100-Yr Design Storm Events

	Peak Flow Rate (m ³ /s) and Runoff Volumes (m ³)					
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Catchment 1000 (uncontrolled)	0.014 m ³ /s	0.019 m ³ /s	0.021 m ³ /s	0.025 m ³ /s	0.029 m ³ /s	0.032 m ³ /s
	20.87 m ³	27.89 m ³	32.59 m ³	38.49 m ³	43.17 m ³	47.75 m ³
Catchment 2000 (uncontrolled)	0.001 m ³ /s	0.004 m ³ /s	0.006 m ³ /s	0.008 m ³ /s	0.009 m ³ /s	0.010 m ³ /s
	1.41 m ³	3.24 m ³	4.58 m ³	6.42 m ³	7.96 m ³	9.56 m ³
Total Runoff Flow from Site	0.015 m³/s	0.023 m³/s	0.027 m³/s	0.033 m³/s	0.038 m³/s	0.042 m³/s
Total Runoff Volume from Site	22.28 m³	31.13 m³	37.17 m³	44.91 m³	51.13 m³	57.31 m³

A comparison of the existing condition peak flow rates, allowable release rates and post-development condition peak flow rates from the Site are provided in Table 7.

Table 7: Comparison of Existing Condition Peak Flow Rates, Allowable Release Rates, and Post-Development Flow Rates

	Peak Flow Rate (m ³ /s)					
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Existing Condition – Total Flow from Site	0.003	0.009	0.013	0.019	0.024	0.029
Allowable Release Rate	0.003	0.009	0.013	0.019	0.024	0.029
Post-Development Condition – Total Flow from Site	0.015	0.023	0.027	0.033	0.038	0.042

As shown in Table 7, the post-development peak flow rates are greater than the allowable release rates for the 2- to 100-year design storm events.

Table 8: Comparison of Peak Flow Rates and Runoff Volumes to the Bridge Street ROW

To Bridge Street ROW						
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Existing Condition – Peak Flows (m ³ /s)	0.000	0.000	0.000	0.000	0.000	0.000
Existing Condition – Runoff Volumes (m ³)	0.000	0.000	0.000	0.000	0.000	0.000
Post-Development Condition – Catchment 1000 Peak Flows (m ³ /s)	0.014	0.019	0.021	0.025	0.029	0.032
Post-Development Condition – Catchment 1000 Runoff Volumes (m ³)	20.87	27.89	32.59	38.49	43.17	47.75

The existing properties drainage patterns drain entirely to the rear yard, leading to the adjacent property and Elora-Cataract Trail. Observing Table 8, the post-development design redirects a large portion of the runoff to the Bridge Street ROW, which drains to the existing catchbasins located approximately 30 m south of the Site on bridge Street.

Table 9: Comparison of Peak Flow Rates and Runoff Volumes to the Rear Yard

To Rear Yard						
	2-Year	5-Year	10-Year	25-Year	50-Year	100-Year
Existing Condition – Peak Flows (m ³ /s)	0.003	0.009	0.013	0.019	0.024	0.029
Existing Condition – Runoff Volumes (m ³)	4.82	11.03	15.73	22.08	27.26	32.66
Post-Development Condition – Catchment 2000 Peak Flows (m ³ /s)	0.001	0.004	0.006	0.008	0.009	0.010
Post-Development Condition – Catchment 2000 Runoff Volumes (m ³)	1.41	3.24	4.58	6.42	7.96	9.56

The existing drainage pattern is the allowable release rate that can be directed to the rear yard. Table 9 shows that the post-development design conditions decrease the amount of flow and runoff volume travelling to the rear yard. The post-development peak flow rates and runoff volumes are less than or equal to the allowable release rates for the 2- to 100-year design storm events.

4.6 Volume Retention

As noted in Section 4.1 Stormwater Management Design Criteria, runoff volume control measures are to be considered for the 25 mm storm event, with infiltration maximized where feasible. Due to site constraints, elevated groundwater levels, and potential drainage concerns for adjacent properties, infiltration-based volume retention facilities are not proposed. The proposed drainage system has been designed to convey post-development runoff safely to the existing municipal storm sewer system and Elora-Cataract Trail, while minimizing impacts to the pre-development drainage conditions.

4.7 Quality Control Treatment

As noted in Section 4.1 Stormwater Management Design Criteria, an enhanced level of quality control is required on-site. The quality control will be achieved by directing runoff over grassed surfaces prior discharging from the Site.

5.0 Water Balance

5.1 Design Infiltration Rates

A percolation test was conducted at the Site by Planet Engineering Inc. (dated June 2, 2026) to assess the infiltration capacities of the native soils. The test consisted of a 150 mm diameter borehole drilled 1.3 m below the ground surface towards the rear of the Site. As well, three boreholes were drilled and installed with monitoring wells on-site with depths ranging from 6.4 to 6.7 m below ground surface. A copy of the Geotechnical Investigation Report prepared by Planet Engineering Inc. (dated August 19, 2026) and the Percolation Test Field Measurements and Calculations completed by Planet Engineering Inc. (dated June 18, 2026) has been provided in Appendix C. The calculations for the results of the percolation test can be found in Appendix C.

Based on stabilized measurements, a percolation rate of 2.1 mm/hr was determined. Using a safety factor of 2.5 to account for variability in surface and subsurface soil conditions, seasonal groundwater fluctuations, and long-term performance, we determined a design infiltration rate of 0.84 mm/hr for the Site. The low design infiltration rate indicates there is limited infiltration on site and is considered for all SWM measures.

5.2 Monthly Water Balance and Annual Recharge

As noted in Section 4.1 Stormwater Management Design Criteria Maintain pre-development recharge rates, volumes, and hydroperiods to the extent possible under post-development conditions. Monthly Water Balance calculations were prepared using the Thornthwaite and Mather methodology to analyze the annual runoff and recharge volumes for the Site under both existing and post-development conditions. In

the existing conditions, the Site has an annual recharge volume of 162 m³/year. In the proposed conditions, without mitigation measures, the post-development annual recharge volume is 78 m³/year. As such, an additional recharge volume of 84 m³/year is required to match and maintain the existing condition annual volume.

Given the Site constraints, the pre-development annual recharge volume cannot be achieved under post-development conditions. Although infiltration measures were evaluated to offset reduction in infiltration, infiltration structures were not feasible due to the Site's soil conditions, high groundwater levels, and the potential impact to adjacent properties with additional infiltration. Therefore, the SWM system used presents a feasible option for the Site, while minimizing the impact to the surrounding areas.

WATER BALANCE CALCULATIONS
65-69 Bridge Street, Elora
Elora Greens Housing Developers

PROJECT No: 300061644.0000



TABLE WB-1

Pre- and Post-Development Monthly Water Balance Components													
Based on Thornthwaite's Soil Moisture Balance Approach with a Soil Moisture Retention of 125 mm (Urban Lawn in Sandy Silt)													
Climate data from WATERLOO WELLINGTON AIRPORT Climate Station (1981 - 2010)													

Potential Evapotranspiration Calculation	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Average Temperature (Degree C)	-6.50	-5.50	-1.00	6.20	12.50	17.60	20.00	18.90	14.50	8.20	2.50	-3.30	7.0
Heat index: $i = (t/5)^{1.514}$	0.00	0.00	0.00	1.38	4.00	6.72	8.16	7.49	5.01	2.11	0.35	0.00	35.2
Unadjusted Daily Potential Evapotranspiration U (mm)	0.00	0.00	0.00	29.03	60.80	87.22	99.80	94.02	71.10	38.99	11.14	0.00	492
Adjusting Factor for U (Latitude 43° 27' N)	0.81	0.82	1.02	1.12	1.26	1.28	1.29	1.2	1.04	0.95	0.81	0.77	
Adjusted Potential Evapotranspiration PET (mm)	0	0	0	33	77	112	129	113	74	37	9	0	582
COMPONENTS	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Precipitation (P)	65	55	61	75	82	82	99	84	88	67	87	71	916.3
Potential Evapotranspiration (PET)	0	0	0	33	77	112	129	113	74	37	9	0	582
P - PET	65	55	61	42	6	-29	-30	-29	14	30	78	71	334
Change in Soil Moisture Storage	0	0	0	0	0	-29	-30	-29	14	30	44	0	0
Soil Moisture Storage max 125 mm	125	125	125	125	125	96	66	37	51	81	125	125	
Actual Evapotranspiration (AET)	0	0	0	33	77	112	129	113	74	37	9	0	582
Soil Moisture Deficit max 125 mm	0	0	0	0	0	29	59	88	74	44	0	0	
Water Surplus - available for infiltration or runoff	65	55	61	42	6	0	0	0	0	0	34	71	334
Potential Infiltration (based on MOE methodology*; independent of temperature)	33	27	31	21	3	0	0	0	0	0	17	36	167
Potential Direct Surface Water Runoff (independent of temperature)	33	27	31	21	3	0	0	0	0	0	17	36	167
IMPERVIOUS AREA WATER SURPLUS													
Precipitation (P)	916	mm/year											
Potential Evaporation (PE) from impervious areas (assume 15%)	137	mm/year											
P-PE (surplus available for runoff from impervious areas)	779	mm/year											

Assume January storage is 100% of Soil Moisture Storage

Soil Moisture Storage 125 mm

<-- See "Water Holding Capacity" values in Table 3.1, MOE SWMPDM, 2003

*MOE SWM infiltration calculations

topography - rolling land 0.2

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

soils - sandy silt 0.2

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

cover - grass 0.1

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

Infiltration factor 0.5

Latitude of site (or climate station) 43 ° N.

WATER BALANCE CALCULATIONS

65-69 Bridge Street, Elora
Elora Greens Housing Developers

PROJECT No: 300061644.0000



TABLE WB-2

Water Balance - Existing Conditions and Post-Development (with no SWM/LID measures)												
Land Cover	Approx. Land Area (m ²)	Impervious Fraction for Land Cover	Estimated Impervious Area (m ²)	Runoff from Impervious Area* (m/a)	Runoff Volume from Impervious Area (m ³ /a)	Estimated Pervious Area (m ²)	Runoff from Pervious Area* (m/a)	Runoff Volume from Pervious Area (m ³ /a)	Infiltration from Pervious Area* (m/a)	Infiltration Volume from Pervious Area (m ³ /a)	Total Runoff Volume (m ³ /a)	Total Infiltration Volume (m ³ /a)
Existing Conditions												
Grass and Trees	1,020	0.05	51	0.779	40	969	0.167	162	0.167	162	202	162
TOTAL PRE-DEVELOPMENT	1,020		51		40	969		162		162	202	162
Post-Development Conditions (with no LID measures in place)												
Catchment 1000 - Front Catchment	720	0.75	540	0.779	421	180	0.167	30	0.167	30	451	30
Catchment 2000 - Back Catchment	300	0.05	15	0.779	12	285	0.167	48	0.167	48	59	48
TOTAL POST-DEVELOPMENT	1,020		555		432	465		78		78	510	78
% Change from Pre to Post											253	52
Effect of development (with no mitigation)											2.4 times increase in runoff	52 % reduction in infiltration

* figures from Table WB-1

To balance pre- to post-,
the infiltration target (m³/a)=

84

m³/a

6.0 Erosion Protection and Sediment Control

Silt fencing is to be installed along the perimeter of the Site to delineate the limits of construction, the limits of grading and to minimize the opportunity for sediment to be transported from the Site.

Inspection and maintenance of the silt fencing will begin following installation. It will be inspected on a weekly basis during active construction, or after a rainfall of 13 mm or greater. If any part of the silt fence requires repair, maintenance will be carried out within 48 hours. The silt fencing as well as accumulated sediment will be removed once construction and landscaping have been substantially completed.

All areas on site that are not subject to active construction within 30 days will be topsoiled and hydroseeded as per OPSS PROV 804 to further minimize the opportunity for erosion and sediment transport.

7.0 Conclusions

In summary, the features of the design for the proposed development are as follows:

- Four new 100 mm diameter sanitary sewer service laterals will be extended from the existing 300 mm diameter sanitary sewer on Bridge Street to service each of the new units (Parcel 1, Parcel 2, Parcel 3, and Parcel 4).
- Foundation drainage for each of the new parcels will be provided by the extension of four 150 mm diameter storm service laterals from the existing 600 mm diameter storm sewer on Bridge Street. These storm sewer service laterals will provide an outlet for the foundation drainage from each unit. Each parcel will be designed and constructed with an internal sump pit and pump system, ultimately discharging to the storm sewer service lateral.
- Four new 50 mm diameter water service laterals will be extended from the existing 200 mm diameter watermain on Bridge Street to the curb stop on the property line. A 32 mm diameter water service lateral will then be extended from property line to each parcel to service each of the new units (Parcel 1, Parcel 2, Parcel 3, and Parcel 4).
- Post-development peak runoff flowrates and volumes generated from the rear yard are uncontrolled and will continue to discharge overland and through swales overland toward the Elora Cataract Trail under allowable release rates. Peak runoff flowrates and volumes generated from the front yard and roof will sheetflow toward the Bridge Street ROW.
- The existing development achieves an annual water balance recharge volume of 162 m³ per year, whereas the proposed development condition recharge volume is 78 m³ per year, requiring approximately 84 m³/year more to achieve a balance of the existing to post-development infiltration target. The annual recharge volume cannot be achieved under post-development conditions due to soil conditions, high groundwater levels, and potential impact to adjacent properties with additional infiltration.



BURNSIDE

[THE DIFFERENCE IS OUR PEOPLE]



Appendix A

Sanitary Demand Calculations

SANITARY SEWER DESIGN SHEET

Proposed Sanitary Network
65-69 Bridge Street, Elora, Township of Centre Wellington



Project #: 300061644
Date: 22-Jul-26
Designed: DS
Checked: AK

Min Diameter = 100 mm

Mannings 'n'= 0.013

Min. Velocity = 0.60 m/s

Max. Velocity = 3.50 m/s

Avg. Domestic Flow = 350.0 l/c/d

Infiltration = 0.150 l/s/ha

Max. Peaking Factor = 4.00

Min. Peaking Factor= 2.00

Factor of Safety = 0 %

NOMINAL PIPE SIZE USED

DESCRIPTION	FROM MH	TO MH	RESIDENTIAL							COMMERCIAL/INDUSTRIAL/INSTITUTIONAL						FLOW CALCULATIONS							PIPE DATA					
			AREA (ha)	ACC. AREA (ha)	UNITS (#)	DENISTY (P/ha)	DENSITY (P/unit)	POP	ACCUM. RES. POP.	AREA (ha)	ACC. AREA (ha)	EQUIV. POP. (p/ha)	FLOW RATE (l/s/ha)	EQUIV. POP.	ACCUM. EQUIV. POP.	INFILTRATION (l/s)	TOTAL ACCUM. POP.	PEAKING FACTOR	POP. FLOW (l/s)	CONSTANT COMM. FLOW (l/s)	ACCUM. COMM. FLOW (l/s)	TOTAL FLOW (l/s)	SLOPE (%)	PIPE DIAMETER (mm)	FULL FLOW CAPACITY (l/s)	FULL FLOW VELOCITY (m/s)	ACTUAL VELOCITY (m/s)	PERCENT FULL (%)
		EX. 300mm SAN SEWER	0.102	0.102	8		2.351	19	19							0.01530	19	4.383	0.3079			0.3232	2.00	100	7.305	0.93	0.46	4%



BURNSIDE

[THE DIFFERENCE IS OUR PEOPLE]



Appendix B

Stormwater Calculations

Existing Condition MIDUSS Modelling Files	1
Post-Development MIDUSS Modelling Files	2

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 2 yr.out"
"          Licensee name:                     daniel.smuk@rjburnside.com"
"          Company                           R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 3:28:05 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          414.876 Coefficient A"
"          0.027  Constant B"
"          0.682  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity      100.235  mm/hr"
"          Total depth            39.504  mm"
"          6  002hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

	0.003	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	18.071	2.216	11.754	minutes"
"	Time to Centroid	108.791	114.725	111.155	minutes"
"	Rainfall depth	39.504	39.504	39.504	mm"
"	Rainfall volume	38.28	2.01	40.29	c.m"
"	Rainfall losses	36.511	1.850	34.778	mm"
"	Runoff depth	2.993	37.654	4.726	mm"
"	Runoff volume	2.90	1.92	4.82	c.m"
"	Runoff coefficient	0.076	0.953	0.120	"
"	Maximum flow	0.002	0.001	0.003	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.003	0.003	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 5 yr.out"
"          Licensee name:                     daniel.smuk@rjburnside.com"
"          Company                           R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 3:42:42 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          544.711 Coefficient A"
"          0.021  Constant B"
"          0.686  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity          130.581  mm/hr"
"          Total depth                50.743  mm"
"          6  005hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

	0.009	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	12.113	1.994	9.836	minutes"
"	Time to Centroid	106.416	113.446	107.998	minutes"
"	Rainfall depth	50.743	50.743	50.743	mm"
"	Rainfall volume	49.17	2.59	51.76	c.m"
"	Rainfall losses	41.919	2.044	39.926	mm"
"	Runoff depth	8.824	48.699	10.817	mm"
"	Runoff volume	8.55	2.48	11.03	c.m"
"	Runoff coefficient	0.174	0.960	0.213	"
"	Maximum flow	0.009	0.002	0.009	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.009	0.009	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				


```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 10 yr.out"
"          Licensee name:                     daniel.smuk@rjburnside.com"
"          Company                           R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 3:47:49 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          627.308 Coefficient A"
"          0.014  Constant B"
"          0.687  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity      150.159  mm/hr"
"          Total depth            58.119  mm"
"          6  010hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

	0.013	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	11.023	1.885	9.367	minutes"
"	Time to Centroid	107.603	112.857	108.555	minutes"
"	Rainfall depth	58.119	58.119	58.119	mm"
"	Rainfall volume	56.32	2.96	59.28	c.m"
"	Rainfall losses	44.826	2.198	42.694	mm"
"	Runoff depth	13.294	55.921	15.425	mm"
"	Runoff volume	12.88	2.85	15.73	c.m"
"	Runoff coefficient	0.229	0.962	0.265	"
"	Maximum flow	0.012	0.002	0.013	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.013	0.013	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 25 yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 4:08:57 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          746.059 Coefficient A"
"          0.085  Constant B"
"          0.692  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity          175.653  mm/hr"
"          Total depth                67.239  mm"
"          6  025hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.019	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	10.148	1.771	8.893	minutes"
"	Time to Centroid	108.014	112.159	108.635	minutes"
"	Rainfall depth	67.239	67.239	67.239	mm"
"	Rainfall volume	65.15	3.43	68.58	c.m"
"	Rainfall losses	47.869	2.419	45.596	mm"
"	Runoff depth	19.370	64.820	21.643	mm"
"	Runoff volume	18.77	3.31	22.08	c.m"
"	Runoff coefficient	0.288	0.964	0.322	"
"	Maximum flow	0.018	0.002	0.019	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.019	0.019	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 50 yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 4:11:26 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000  Max. Storm length"
"          3000.000  Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          820.361  Coefficient A"
"          0.010  Constant B"
"          0.691  Exponent C"
"          0.375  Fraction R"
"          240.000  Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    194.803  mm/hr"
"          Total depth                          74.358  mm"
"          6  050hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.024	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	9.635	1.699	8.568	minutes"
"	Time to Centroid	108.434	111.874	108.896	minutes"
"	Rainfall depth	74.358	74.358	74.358	mm"
"	Rainfall volume	72.05	3.79	75.84	c.m"
"	Rainfall losses	50.009	2.533	47.635	mm"
"	Runoff depth	24.349	71.825	26.723	mm"
"	Runoff volume	23.59	3.66	27.26	c.m"
"	Runoff coefficient	0.327	0.966	0.359	"
"	Maximum flow	0.023	0.003	0.024	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.024	0.024	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        \\gue-lfs-v-01\SP_Bulk_Data\BulkStorage\
"                                           061644 65-69 Bridge Street Elora"
"          Output filename:                    061644 Ex 100 yr.out"
"          Licensee name:                     daniel.smuk@rjburnside.com"
"          Company                           R.J. Burnside & Associates Ltd."
"          Date & Time last used:              6/8/2026 at 4:16:42 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          901.088 Coefficient A"
"          0.043  Constant B"
"          0.692  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                212.928  mm/hr"
"          Total depth                      81.221  mm"
"          6  100hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 100"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          100  Catchment 100"
"          5.000  % Impervious"
"          0.102  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.097  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.005  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

	0.029	0.000	0.000	0.000 c.m/sec"	
"	Catchment 100	Pervious	Impervious	Total Area	"
"	Surface Area	0.097	0.005	0.102	hectare"
"	Time of concentration	9.233	1.640	8.301	minutes"
"	Time to Centroid	108.726	111.634	109.083	minutes"
"	Rainfall depth	81.221	81.221	81.221	mm"
"	Rainfall volume	78.70	4.14	82.85	c.m"
"	Rainfall losses	51.654	2.659	49.205	mm"
"	Runoff depth	29.566	78.562	32.016	mm"
"	Runoff volume	28.65	4.01	32.66	c.m"
"	Runoff coefficient	0.364	0.967	0.394	"
"	Maximum flow	0.027	0.003	0.029	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4	Add Runoff "			
"	0.029	0.029	0.000	0.000"	
" 38	START/RE-START TOTALS 100"				
"	3	Runoff Totals on EXIT"			
"	Total Catchment area			0.102	hectare"
"	Total Impervious area			0.005	hectare"
"	Total % impervious			5.000"	
" 19	EXIT"				


```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 2 Yr.out"
"          Licensee name:                     daniel.smuk@rjburnside.com"
"          Company                           R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:31:54 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          414.876 Coefficient A"
"          0.027  Constant B"
"          0.682  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    100.235  mm/hr"
"          Total depth                        39.504  mm"
"          6  002hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.014	0.000	0.000	0.000 c.m/sec"
"	Catchment 1000	Pervious	Impervious	Total Area "
"	Surface Area	0.018	0.054	0.072 hectare"
"	Time of concentration	18.071	2.216	2.625 minutes"
"	Time to Centroid	108.791	114.725	114.572 minutes"
"	Rainfall depth	39.504	39.504	39.504 mm"
"	Rainfall volume	7.11	21.33	28.44 c.m"
"	Rainfall losses	36.511	1.850	10.515 mm"
"	Runoff depth	2.993	37.654	28.989 mm"
"	Runoff volume	0.54	20.33	20.87 c.m"
"	Runoff coefficient	0.076	0.953	"
"	Maximum flow	0.000	0.014	0.014 c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.014	0.014	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n'"
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n'"
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.001	0.014	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area "
"	Surface Area	0.029	0.002	0.030 hectare"
"	Time of concentration	11.922	1.462	7.776 minutes"
"	Time to Centroid	104.266	113.567	107.953 minutes"
"	Rainfall depth	39.504	39.504	39.504 mm"
"	Rainfall volume	11.26	0.59	11.85 c.m"
"	Rainfall losses	36.514	2.199	34.798 mm"
"	Runoff depth	2.990	37.305	4.706 mm"
"	Runoff volume	0.85	0.56	1.41 c.m"

"	Runoff coefficient	0.076	0.944	0.119	"
"	Maximum flow	0.001	0.000	0.001	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"	0.001	0.015	0.000	0.000"	
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102	hectare"	
"	Total Impervious area		0.055	hectare"	
"	Total % impervious		54.412"		
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 5 Yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:35:43 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          544.711 Coefficient A"
"          0.021  Constant B"
"          0.686  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    130.581  mm/hr"
"          Total depth                          50.743  mm"
"          6  005hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.019	0.000	0.000	0.000 c.m/sec"
"	Catchment 1000	Pervious	Impervious	Total Area "
"	Surface Area	0.018	0.054	0.072 hectare"
"	Time of concentration	12.113	1.994	2.570 minutes"
"	Time to Centroid	106.416	113.446	113.046 minutes"
"	Rainfall depth	50.743	50.743	50.743 mm"
"	Rainfall volume	9.13	27.40	36.53 c.m"
"	Rainfall losses	41.919	2.044	12.013 mm"
"	Runoff depth	8.824	48.699	38.730 mm"
"	Runoff volume	1.59	26.30	27.89 c.m"
"	Runoff coefficient	0.174	0.960	0.763 "
"	Maximum flow	0.002	0.018	0.019 c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.019	0.019	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n' "
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n' "
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.004	0.019	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area "
"	Surface Area	0.029	0.002	0.030 hectare"
"	Time of concentration	7.992	1.315	6.505 minutes"
"	Time to Centroid	103.165	112.451	105.233 minutes"
"	Rainfall depth	50.743	50.743	50.743 mm"
"	Rainfall volume	14.46	0.76	15.22 c.m"
"	Rainfall losses	41.912	2.660	39.949 mm"
"	Runoff depth	8.831	48.083	10.794 mm"
"	Runoff volume	2.52	0.72	3.24 c.m"

"	Runoff coefficient	0.174	0.948	0.213	"
"	Maximum flow	0.004	0.001	0.004	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"	0.004	0.020	0.000	0.000"	
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102	hectare"	
"	Total Impervious area		0.055	hectare"	
"	Total % impervious		54.412"		
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 10 Yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:37:59 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          627.308 Coefficient A"
"          0.014  Constant B"
"          0.687  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    150.159  mm/hr"
"          Total depth                          58.119  mm"
"          6  010hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.021	0.000	0.000	0.000 c.m/sec"
"	Catchment 1000	Pervious	Impervious	Total Area "
"	Surface Area	0.018	0.054	0.072 hectare"
"	Time of concentration	11.023	1.885	2.556 minutes"
"	Time to Centroid	107.603	112.857	112.471 minutes"
"	Rainfall depth	58.119	58.119	58.119 mm"
"	Rainfall volume	10.46	31.38	41.85 c.m"
"	Rainfall losses	44.826	2.198	12.855 mm"
"	Runoff depth	13.294	55.921	45.264 mm"
"	Runoff volume	2.39	30.20	32.59 c.m"
"	Runoff coefficient	0.229	0.962	"
"	Maximum flow	0.002	0.021	0.021 c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.021	0.021	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n'"
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n'"
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.006	0.021	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area "
"	Surface Area	0.029	0.002	0.030 hectare"
"	Time of concentration	7.273	1.244	6.184 minutes"
"	Time to Centroid	103.859	111.930	105.316 minutes"
"	Rainfall depth	58.119	58.119	58.119 mm"
"	Rainfall volume	16.56	0.87	17.44 c.m"
"	Rainfall losses	44.953	3.015	42.856 mm"
"	Runoff depth	13.166	55.104	15.263 mm"
"	Runoff volume	3.75	0.83	4.58 c.m"

"	Runoff coefficient	0.227	0.948	0.263	"
"	Maximum flow	0.005	0.001	0.006	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"		0.006	0.024	0.000	0.000"
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102		hectare"
"	Total Impervious area		0.055		hectare"
"	Total % impervious		54.412"		
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 25 Yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:40:51 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          746.059 Coefficient A"
"          0.085  Constant B"
"          0.692  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    175.653  mm/hr"
"          Total depth                          67.239  mm"
"          6  025hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.025	0.000	0.000	0.000 c.m/sec"
"	Catchment 1000	Pervious	Impervious	Total Area "
"	Surface Area	0.018	0.054	0.072 hectare"
"	Time of concentration	10.148	1.771	2.530 minutes"
"	Time to Centroid	108.014	112.159	111.784 minutes"
"	Rainfall depth	67.239	67.239	67.239 mm"
"	Rainfall volume	12.10	36.31	48.41 c.m"
"	Rainfall losses	47.869	2.419	13.781 mm"
"	Runoff depth	19.370	64.820	53.458 mm"
"	Runoff volume	3.49	35.00	38.49 c.m"
"	Runoff coefficient	0.288	0.964	"
"	Maximum flow	0.003	0.024	0.025 c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.025	0.025	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n'"
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n'"
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.008	0.025	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area "
"	Surface Area	0.029	0.002	0.030 hectare"
"	Time of concentration	6.695	1.168	5.871 minutes"
"	Time to Centroid	104.271	111.273	105.314 minutes"
"	Rainfall depth	67.239	67.239	67.239 mm"
"	Rainfall volume	19.16	1.01	20.17 c.m"
"	Rainfall losses	48.080	3.484	45.850 mm"
"	Runoff depth	19.159	63.755	21.389 mm"
"	Runoff volume	5.46	0.96	6.42 c.m"

"	Runoff coefficient	0.285	0.948	0.318	"
"	Maximum flow	0.007	0.001	0.008	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"	0.008	0.029	0.000	0.000"	
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102	hectare"	
"	Total Impervious area		0.055	hectare"	
"	Total % impervious		54.412"		
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 50 Yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:42:02 PM"
" 31          TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32          STORM Chicago storm"
"          1  Chicago storm"
"          820.361 Coefficient A"
"          0.010  Constant B"
"          0.691  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                    194.803  mm/hr"
"          Total depth                          74.358  mm"
"          6  050hyd  Hydrograph extension used in this file"
" 33          CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```

"	0.029	0.000	0.000	0.000 c.m/sec"
"	Catchment 1000	Pervious	Impervious	Total Area "
"	Surface Area	0.018	0.054	0.072 hectare"
"	Time of concentration	9.635	1.699	2.505 minutes"
"	Time to Centroid	108.434	111.874	111.525 minutes"
"	Rainfall depth	74.358	74.358	74.358 mm"
"	Rainfall volume	13.38	40.15	53.54 c.m"
"	Rainfall losses	50.009	2.533	14.402 mm"
"	Runoff depth	24.349	71.825	59.956 mm"
"	Runoff volume	4.38	38.79	43.17 c.m"
"	Runoff coefficient	0.327	0.966	"
"	Maximum flow	0.004	0.027	0.029 c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.029	0.029	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n'"
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n'"
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.009	0.029	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area "
"	Surface Area	0.029	0.002	0.030 hectare"
"	Time of concentration	6.356	1.121	5.661 minutes"
"	Time to Centroid	104.744	110.977	105.572 minutes"
"	Rainfall depth	74.358	74.358	74.358 mm"
"	Rainfall volume	21.19	1.12	22.31 c.m"
"	Rainfall losses	50.144	3.884	47.831 mm"
"	Runoff depth	24.214	70.474	26.527 mm"
"	Runoff volume	6.90	1.06	7.96 c.m"

"	Runoff coefficient	0.326	0.948	0.357	"
"	Maximum flow	0.009	0.001	0.009	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"		0.009	0.034	0.000	0.000"
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102		hectare"
"	Total Impervious area		0.055		hectare"
"	Total % impervious		54.412"		
" 19	EXIT"				

```

"          MIDUSS Output ----->"
"          MIDUSS version                      Version 2.25  rev. 473"
"          MIDUSS created                      Sunday, February 07, 2010"
"          10  Units used:                      ie METRIC"
"          Job folder:                        C:\Users\DSmuk\OneDrive - RJB\Documents\
"          061644 65-69 BRIDGE ST ELORA\MIDUSS\POST UPDATED"
"          Output filename:                    061644 Post 100 Yr.out"
"          Licensee name:                      daniel.smuk@rjburnside.com"
"          Company                            R.J. Burnside & Associates Ltd."
"          Date & Time last used:              7/14/2026 at 4:43:56 PM"
" 31      TIME PARAMETERS"
"          5.000  Time Step"
"          240.000 Max. Storm length"
"          3000.000 Max. Hydrograph"
" 32      STORM Chicago storm"
"          1  Chicago storm"
"          901.088 Coefficient A"
"          0.043  Constant B"
"          0.692  Exponent C"
"          0.375  Fraction R"
"          240.000 Duration"
"          1.000  Time step multiplier"
"          Maximum intensity                212.928  mm/hr"
"          Total depth                      81.221  mm"
"          6  100hyd  Hydrograph extension used in this file"
" 33      CATCHMENT 1000"
"          1  Triangular SCS"
"          1  Equal length"
"          2  Horton equation"
"          1000  FRONT OF SITE"
"          75.000  % Impervious"
"          0.072  Total Area"
"          30.000  Flow length"
"          2.000  Overland Slope"
"          0.018  Pervious Area"
"          30.000  Pervious length"
"          2.000  Pervious slope"
"          0.054  Impervious Area"
"          30.000  Impervious length"
"          2.000  Impervious slope"
"          0.250  Pervious Manning 'n'"
"          75.000  Pervious Max.infiltration"
"          12.500  Pervious Min.infiltration"
"          0.250  Pervious Lag constant (hours)"
"          5.000  Pervious Depression storage"
"          0.015  Impervious Manning 'n'"
"          0.000  Impervious Max.infiltration"
"          0.000  Impervious Min.infiltration"
"          0.050  Impervious Lag constant (hours)"
"          1.500  Impervious Depression storage"

```


"	0.032	0.000	0.000	0.000 c.m/sec"	
"	Catchment 1000	Pervious	Impervious	Total Area	"
"	Surface Area	0.018	0.054	0.072	hectare"
"	Time of concentration	9.233	1.640	2.486	minutes"
"	Time to Centroid	108.726	111.634	111.310	minutes"
"	Rainfall depth	81.221	81.221	81.221	mm"
"	Rainfall volume	14.62	43.86	58.48	c.m"
"	Rainfall losses	51.654	2.659	14.908	mm"
"	Runoff depth	29.566	78.562	66.313	mm"
"	Runoff volume	5.32	42.42	47.75	c.m"
"	Runoff coefficient	0.364	0.967	0.816	"
"	Maximum flow	0.005	0.029	0.032	c.m/sec"

" 40 HYDROGRAPH Add Runoff "

" 4 Add Runoff "

"	0.032	0.032	0.000	0.000"
---	-------	-------	-------	--------

" 33 CATCHMENT 2000"

"	1	Triangular SCS"
"	1	Equal length"
"	2	Horton equation"
"	2000	Rear of Yard"
"	5.000	% Impervious"
"	0.030	Total Area"
"	15.000	Flow length"
"	2.000	Overland Slope"
"	0.029	Pervious Area"
"	15.000	Pervious length"
"	2.000	Pervious slope"
"	0.002	Impervious Area"
"	15.000	Impervious length"
"	2.000	Impervious slope"
"	0.250	Pervious Manning 'n'"
"	75.000	Pervious Max.infiltration"
"	12.500	Pervious Min.infiltration"
"	0.250	Pervious Lag constant (hours)"
"	5.000	Pervious Depression storage"
"	0.015	Impervious Manning 'n'"
"	0.000	Impervious Max.infiltration"
"	0.000	Impervious Min.infiltration"
"	0.050	Impervious Lag constant (hours)"
"	1.500	Impervious Depression storage"

"	0.010	0.032	0.000	0.000 c.m/sec"
---	-------	-------	-------	----------------

"	Catchment 2000	Pervious	Impervious	Total Area	"
"	Surface Area	0.029	0.002	0.030	hectare"
"	Time of concentration	6.091	1.082	5.487	minutes"
"	Time to Centroid	105.129	110.690	105.801	minutes"
"	Rainfall depth	81.221	81.221	81.221	mm"
"	Rainfall volume	23.15	1.22	24.37	c.m"
"	Rainfall losses	51.720	4.266	49.347	mm"
"	Runoff depth	29.501	76.955	31.874	mm"
"	Runoff volume	8.41	1.15	9.56	c.m"

"	Runoff coefficient	0.363	0.947	0.392	"
"	Maximum flow	0.010	0.001	0.010	c.m/sec"
" 40	HYDROGRAPH Add Runoff "				
"	4 Add Runoff "				
"	0.010	0.038	0.000	0.000"	
" 38	START/RE-START TOTALS 2000"				
"	3 Runoff Totals on EXIT"				
"	Total Catchment area		0.102	hectare"	
"	Total Impervious area		0.055	hectare"	
"	Total % impervious		54.412"		
" 19	EXIT"				



BURNSIDE

[THE DIFFERENCE IS OUR PEOPLE]

Appendix C

Geotechnical Investigations

Geotechnical Investigation Report	1
Percolation Test Field Measurements and Calculations	2

Revised

**GEOTECHNICAL INVESTIGATION REPORT
65-69 BRIDGE ST, TOWNSHIP OF CENTRAL WELLINGTON, ONTARIO**

Client

Elora Greens Inc.

120 Matheson Blvd. E., Unit 3
Mississauga, ON L4Z 1X1

Prepared by:



2179 Dunwin Drive, Unit 4
Mississauga, ON L5L 1X2

Project No. 2601486AG

August 19, 2026

August 19, 2026

Reference No.: 2601486AG

Elora Greens Inc.
120 Matheson Blvd. E., Unit 3
Mississauga, ON L4Z 1X1

Attention: Farhan Kamali Siddiqui
Email: farhan@eloragreens.com

Dear Mr. Siddiqui,

RE: Geotechnical Investigation Report
65-69 Bridge St, Township of Central Wellington, Ontario

Enclosed is a copy of geotechnical investigation report related to the above noted site.

For and on behalf of PLANET Engineering Inc



Irfan Ahmad Khokhar, Ph.D., P.Eng., Consulting Engineer
Vice President and Principal

Executive Summary

A geotechnical investigation based on three boreholes (BH1 to BH3) was carried out for the proposed dwellings located at 65-69 Bridge St, County of Wellington, ON (the Site).

Based on the information provided by the Client, the proposed development consists of four townhouses, each with one level of basement.

Stormwater management measures, such as an infiltration trench, are utilized to facilitate controlled subsurface discharge and maintain site drainage performance, as detailed in Appendix E: Percolation Memo.

PLANET does not have any structural information regarding the proposed development.

Topsoil, 150 mm to 200 mm thick, was encountered in boreholes BH1 to BH3. Topsoil quantities should not be estimated based solely on borehole data, as significant variations in depth may exist across the site.

A layer of fill/disturbed native was encountered at all boreholes (BH1 to BH3) locations below topsoil and extended in general to a depth approximately from 1.1m to 1.2m below the existing ground surface. The fill/disturbed native consisted of silty sand, trace to some gravel & clay, trace rootlets, very moist to moist, brown, compact to loose state.

Native materials were encountered underlying the fill/disturbed native material in all the boreholes. The native materials were generally non-cohesive to cohesive in nature (i.e., loose to dense silty sand till to sandy silt till, trace to some clay and gravel, boulders, very stiff to hard, sandy clayey silt till, trace gravel) to maximum explored depth ranging from 6.4m to 6.7m below existing ground surface.

Based on the borehole information, the existing topsoil and fill/disturbed native materials are unsuitable for direct foundation support. The proposed spread and strip footings may be constructed at the proposed underside-of-footing elevation of 398.04 m using a trench-and-pour method.

Foundation trenches must extend through all unsuitable materials to competent, undisturbed native silty sand till to sandy silt till. A geotechnical reaction of 100 kPa at the Serviceability Limit States (SLS) and a factored geotechnical resistance of 150 kPa at the Ultimate Limit States (ULS) may be used, subject to confirmation of competent native soil during construction. The geotechnical reactions and factored geotechnical resistances including the corresponding highest founding elevations at the borehole locations are summarized on Table 4.1. Following inspection and approval by PLANET, the trenches may be filled with approved lean concrete having a minimum 28-day compressive strength of 5 MPa, extending from the native founding surface to the proposed footing base (398.04m). The recommended founding levels and geotechnical reactions for the proposed structures would need to be confirmed by PLANET at the time of construction.

The floor slab can be supported on grade, provided all topsoil, existing weathered/disturbed and surficially softened or loose materials are removed, and the subgrade thoroughly proof rolled. Any loose spots or areas revealed from proof rolling must be sub-excavated, backfilled and compacted.

During drilling and at the completion of drilling, the short-term groundwater levels were observed in the boreholes at depths varying from 1.4m to 4.1m below the existing ground surface. Monitoring wells were installed at all borehole locations BH1 to BH3. Groundwater level measurements were made at different times to observe water level fluctuations in the monitoring wells and presented in Table 3.2 of this report.

Based on the water table readings obtained on June 9, 2026 and June 22, 2026 the groundwater level varied from 0.83m to 1.47m below the existing ground surface, corresponding to geodetic elevations of

397.03m to 397.74m. Groundwater problems are anticipated during excavation and installation of foundations below the existing ground surface. Dewatering will be required to manage groundwater and any water-related issues encountered during construction.

It should be noted that groundwater conditions vary depending on factors such as temperature, season, precipitation, construction activity and other situations, which may be different from those encountered at the time of the monitoring. The possibility of groundwater level fluctuations at the site should be considered when designing and developing the construction plans for the project.

All excavations must be carried out in accordance with the most recent Occupational Health and Safety Act (OHSA). In accordance with OHSA, the on-site fill material and loose to dense or very stiff to hard native soils can be classified as Type 3 soil. The dense to very dense native soils can be classified as Type 1 to Type 2 soil above the water level and Type 4 below the groundwater table. Wet sandy silt to silty sand seams can also be classified as Type 4 soils. As a general rule, the excavations in Type 1 and 2 soils can be carried out without support using side slopes 1H:1V, while the bottom 1.2m of the excavation can be cut vertically and could retain the wall for a short period of time. The excavation in Type 3 soil can be carried out maintaining the side slopes not steeper than 1H:1V. The excavations in Type 4 soils will require minimum flatter side slopes of 3H to 1V. These slopes should be visually monitored for any movement especially if workers are present within the excavation. These temporary slopes should only be utilized for a short duration. If an excavation contains more than one type of soil, the soil shall be classified as the type with the highest number among the types present.

The select inorganic fill and native soils free from topsoil and organics can be used as general construction backfill where it can be compacted with sheep's foot type compactors. Loose lifts of soil, which are to be compacted, should not exceed 200 mm. Majority of the on-site inorganic fill is not considered suitable for backfilling, imported fill materials (preferably granular) with suitable moisture must be used to replace the existing fill under the slab-on-grade and in trenches.

Based on the borehole information, the subject site for the proposed addition can be classified as Class 'D' for seismic site response according to Table 4.1.8.4.A of OBC 2024 provided the footings will be supported on undisturbed native deposits. Consideration could be given to conduct an earthquake site assessment with the use of in-situ testing of the seismic characteristics (i.e. Geophysical testing – Multi-channel Analysis of Surface Waves-MASW) which can lead to an improved site classification (i.e. from Class D to Class C).

TABLE OF CONTENTS

1	INTRODUCTION	1
2	FIELD AND LABORATORY WORK	2
3	RESULTS OF THE INVESTIGATION	3
3.1	Subsurface Conditions	3
3.1.1	Topsoil	3
3.1.2	Granular Fill	3
3.1.3	Fill/Disturbed Native Soil	3
3.1.4	Native Soils:	3
3.2	Groundwater Conditions	4
4	DISCUSSION AND RECOMMENDATIONS.....	5
4.1	Foundations	5
4.1.1	Footings founded on Native Soils.....	5
4.1.2	Other Comments on Foundations	6
4.2	Floor Slab and Permanent Drainage	7
4.3	Excavations and Backfill	9
4.4	Frost Susceptibility of Soils	10
4.5	Earth Pressures	10
4.6	Earthquake Considerations	10
4.7	Underground Utility Trenches	11
4.7.1	Trenching.....	11
4.7.2	Bedding	11
4.7.3	Backfilling of Trenches	11
4.8	Pavements.....	12
4.8.1	Ideal Conditions	12
4.8.2	Non-Ideal Conditions	12
4.8.3	Stripping, Sub-excavation and Grading.....	15
4.8.4	Construction.....	16
4.8.5	Drainage	16
4.9	Geotechnical Review	16
4.10	Percolation Test Memo	16
4.11	Engineered Fill and Sub-Excavation	16
5	GENERAL COMMENTS	19

Drawings

Drawing No.

Site Key Plan	1
Borehole Location Plan	1A
Notes on Sample Descriptions	1B
Sieve and Hydrometer Grain Size Analyses	2
Under Floor Drainage System	3
Perimeter and Under Floor Drainage System for Open-Cut Excavation	4

Tables

Table 2.1: Sample Details for Grain Size Analyses
Table 3.1: Summary of Grain-Size Distribution
Table 3.2: Summary of Groundwater Level Observations in Installed Monitoring Wells
Table 4.1: Bearing Values & Founding Levels of Footings on Native Soils
Table 4.3: Lateral Earth Pressure Parameters
Table 4.4: Lateral Earth Pressure Parameters
Table 4.5: Recommended Pavement Structure Thickness
Table 4.6: Minimum Rigid Concrete Pavement Structure

Appendices

Appendix A	Limitations of Report
Appendix B	Borehole Logs
Appendix C	General Requirements for Engineered Fill
Appendix D	Proposed Site Plan Provided by the Client
Appendix E	Percolation Memo

1 INTRODUCTION

PLANET Engineering Inc. (PLANET) was retained by Elora Green Inc. (the Client) to conduct a geotechnical investigation for the proposed residential development (four townhouses) located at 65-69 Bridge St. within the Township of Centre Wellington, Ontario (the Site). The approximate location of the proposed development is shown in Drawings 1 and 1A.

This work was conducted in accordance with the scope of work outlined in PLANET's proposal number 2601486AG, dated May 1, 2026, which was approved on May 01, 2026. Based on the information provided by the Client, the proposed development consists of four town houses, each with one level of basement, along with associated site servicing, grading, and drainage infrastructure. The project also includes stormwater management measures, such as an infiltration trench, to facilitate controlled subsurface discharge and maintain site drainage performance.

PLANET does not have any structural information regarding the proposed development. The purpose of this investigation was to assess the subsurface conditions at three borehole locations (BH1 to BH3), from the findings in the boreholes make geotechnical engineering recommendations for the following:

- Design parameters required by the structural engineer/civil engineer
- Soil characteristics and drainage recommendations
- Comments related to earth pressures
- Frost susceptibility of all soils in the upper 1.2 metres
- Special precautions specific to this site
- The use of the excavated soil
- Drainage recommendations
- Estimate of the native soils' hydraulic conductivity (Coefficient of Permeability)
- Recommendations regarding the suitability of native soils to support infiltration and Low Impact Development (LID) structures

This report contains preliminary geotechnical findings. However, once conceptual drawings are finalized, a detailed geotechnical report is recommended.

This report is provided on the basis of the terms of reference presented above and, in the text, and on the assumption that the design will be in accordance with the applicable codes and standards. If there is any change in the design features relevant to the geotechnical analyses, or if any question arises concerning the geotechnical aspects of the codes and standards, PLANET should be contacted to review the design. It may then be necessary to carry out additional borings and reporting before the recommendations of PLANET can be relied upon.

The site investigation and recommendations follow generally accepted practice for geotechnical consultants in Ontario. The format and contents are guided by client specific needs and economics and do not conform to generalized standards for services. Laboratory testing for most part follows ASTM or CSA Standards or modifications of these standards that have become standard practice.

This report has been prepared for Elora Green Inc (the Client), and its architects, consultants, contractors and designers. Third party use of this report without PLANET's consent is prohibited. The limitations presented in Appendix A form an integral part of the report and they must be considered in conjunction with this report.

2 FIELD AND LABORATORY WORK

Borehole locations for this investigation were established in and marked on the ground by PLANET personnel in accordance with the client requirements. Prior to drilling operations, underground utilities were cleared at borehole locations by the public utility's companies.

For this geotechnical investigation, three boreholes (BH1 to BH3) were drilled to depths varying from 6.4m to 6.7 m on June 02, 2026. The boreholes were advanced by a drilling sub-contractor, under the observations of PLANET personnel. The boreholes were advanced by utilizing continuous flight solid stem augers. Samples were retrieved at regular intervals with a 50 mm O.D. split-barrel sampler driven with a hammer weighing 624 N (63.5 kg) and dropping 760 mm in accordance with the Standard Penetration Test (SPT) method (ASTM D1586). The number of blows of the hammer required to drive the sampler into the relatively undisturbed ground by a vertical distance of 300 mm (12 inches) was recorded as SPT 'N' value of the soil which indicated the consistency of cohesive soils or compactness of non-cohesive soils. The results of SPT are shown in the Record of Boreholes. The samples were logged in the field and returned to the PLANET laboratory for detailed examination by the project engineer and for laboratory testing. The approximate borehole locations are shown on Drawing 1A.

Water level observations were made during drilling and at the completion of the drilling operations. Upon completion of drilling, each borehole was backfilled in accordance with current regulations.

The locations of the boreholes were established in the field by PLANET in consultation with the client. The borehole elevations and locations were surveyed and established by the PLANET staff. Note, these elevations are approximate only, for relating borehole soil stratigraphy and should not be used or relied on for other purposes.

Boreholes BH1 to BH3 were drilled and sampled within the approximate footprints of the proposed residential development.

As well as visual examinations in the laboratory, soil samples were tested for water content determinations. Grain size analyses were carried out on selected soil samples as presented in Table 2.1. The results of the laboratory tests are presented on the borehole logs.

Table 2.1: Sample Details for Grain Size Analyses

Sample No.	Approximate Depth Below the Existing Ground Surface (m)	Approximate Local Elevation (m)	Type of Test
BH1- SS2	0.8 – 1.2	397.7 – 397.1	MH
BH1- SS5	3.1 – 3.7	395.4 – 394.8	MH
BH2- SS3	3.1 – 3.7	395.0 – 394.4	MH
BH3- SS4	2.3 – 2.9	396.4 – 395.8	MH

Notes: • MH stands for sieve and hydrometer grain size analyses

The result of grain size analyses is presented on referenced borehole log.

3 RESULTS OF THE INVESTIGATION

The site is located at 65-69 Bridge St, Township of Central Wellington, Ontario. The site key plan and the borehole locations are presented on Drawings 1 and 1A. Notes on sample descriptions and the general features of fill material and native soils are presented on Drawing 1B. Detailed subsurface conditions are presented on borehole log sheets, attached as Appendix B.

Details of the subsurface conditions encountered at the borehole locations are provided on the borehole logs following the text of this report. The borehole logs indicate the subsurface conditions only at the borehole locations. Note the material boundaries indicated on the attached sheets are approximate and based on visual observations. These boundaries typically represent a transition from one material type to another and should not be regarded as an exact plane of geological change. It should be pointed out that the subsurface conditions will vary across this site. The subsurface soil and groundwater conditions are summarized as follows.

3.1 Subsurface Conditions

The subsurface conditions encountered in the boreholes are summarized as follows.

3.1.1 Topsoil

Topsoil, 150 mm to 200 mm thick, was encountered in boreholes BH1 to BH3. Topsoil quantities should not be estimated based solely on borehole data, as significant variations in depth may exist across the site.

3.1.2 Granular Fill

A layer of fill/disturbed native was encountered at all boreholes (BH1 to BH3) locations below topsoil and extended in general to a depth approximately from 1.1m to 1.2m below the existing ground surface. The fill/disturbed native consisted of silty sand, trace to some gravel & clay, trace rootlets, very moist to moist, brown, compact to loose state.

3.1.3 Fill/Disturbed Native Soil

A layer of fill/disturbed native was encountered at all boreholes (BH1 to BH3) locations below topsoil/granular fill and extended in general to a depth approximately from 0.4m to 0.5m below the existing ground surface. The fill/disturbed native consisted of sandy silty clay, trace gravel, trace rootlets was typically firm to stiff.

Based on the visual observation in the field and our experience in the area, it appears that these SPT N values are not representative to determine the compactness. It also indicates that the fill did not receive systematic compaction. It should be noted that the thickness of fill could vary between and beyond boreholes and this should be considered when estimating.

3.1.4 Native Soils:

Native materials were encountered underlying the fill/disturbed native material in all the boreholes. The native materials were generally cohesive to non-cohesive to cohesive in nature (i.e., loose to dense silty sand till to sandy silt till, trace to some clay and gravel, boulders, very stiff to hard, sandy clayey silt till, trace gravel) to maximum explored depth ranging from 6.4m to 6.7m below existing ground surface.

The grain-size distribution of four selected soil samples from the silty clay was carried out and results are summarized in Table 3.1.

Table 3.1: Summary of Grain-Size Distribution

Sample No.	Depth Below the Existing Ground Surface (m)	Sieve and Hydrometer Test Results			
		Gravel %	Sand %	Silt %	Clay %
BH1- SS2	0.8 – 1.2	12	36	43	9
BH1- SS5	3.1 – 3.7	11	41	35	13
BH2- SS3	3.1 – 3.7	9	44	36	11
BH3- SS4	2.3 – 2.9	23	32	34	11

3.2 Groundwater Conditions

During drilling and at the completion of drilling, the short-term groundwater levels were observed in the boreholes at depths varying from 1.4m to 4.1m below the existing ground surface. Monitoring wells were installed at all borehole locations BH1 to BH3. Groundwater level measurements were made at different times to observe water level fluctuations in the monitoring wells and presented in Table 3.2 of this report.

Table 3.2: Summary of Groundwater Level Observations in Installed Monitoring Wells

MW ID	Ground Surface Elevation (m)	Borehole Depth (mbgs)	Monitoring Well Depth (mbgs)	Groundwater Level Observations			
				June 9, 2026		June 22, 2026	
				Depth (mbgs)	Elevation (m)	Depth (mbgs)	Elevation (m)
BH1	398.5	6.4	6.1	1.47	397.03	1.23	397.27
BH2	398.1	6.7	6.1	1.05	397.05	0.83	397.27
BH3	398.7	6.7	6.1	1.1	397.6	0.96	397.74

Based on the water table readings obtained on June 9, 2026, and June 22, 2026, the groundwater level varied from 0.83m to 1.47m below the existing ground surface, corresponding to geodetic elevations of 397.03m to 397.74m. Groundwater problems are anticipated during excavation and installation of foundations below the existing ground surface. Dewatering will be required to manage groundwater and any water-related issues encountered during construction.

It should be noted that groundwater conditions vary depending on factors such as temperature, season, precipitation, construction activity, and other site-specific conditions, which may differ from those encountered at the time of monitoring. The possibility of groundwater level fluctuations at the site should be considered during the design and development of the construction plans for the project.

Perched water may be encountered in excavated areas during wet seasons. A perched water condition can occur due to the accumulation of infiltrated water within the more pervious fill overlying less pervious deposits, or at the interface between fill and native soils, particularly during wet periods. Groundwater levels are subject to seasonal fluctuations and major weather events. In addition, the depth of the groundwater table may be influenced by underground features such as utility trenches, which could affect construction procedures, costs, and schedules.

4 DISCUSSION AND RECOMMENDATIONS

Based on the information provided by the Client, the proposed development consists of four town houses, each with one level of basement, along with associated site servicing, grading, and drainage infrastructure. The project also includes stormwater management measures, such as an infiltration trench, to facilitate controlled subsurface discharge and maintain site drainage performance.

PLANET does not have any structural information regarding the proposed development.

The following sections of the report provide our interpretation of the factual geotechnical data obtained during our field evaluation and are intended for the guidance of the design engineer only. Where comments are made on aspects of construction, they are provided only to highlight those aspects which could affect the design of the project. Contractors bidding on or undertaking the work should make their own interpretation of the subsurface information provided as it affects their proposed construction methods, equipment selection, scheduling, safety, and the like.

Boreholes BH1 to BH3 were drilled and sampled within the approximate footprints of the proposed residential development.

4.1 Foundations

Based on the borehole information, the fill/disturbed native materials are unsuitable to support foundations and slab on grade due to gross and differential settlements that could damage the structures

4.1.1 Footings founded on Native Soils

Based on the borehole information, the existing topsoil and fill/disturbed native materials are unsuitable for direct foundation support. The proposed spread and strip footings may be constructed at the proposed underside-of-footing elevation of 398.04 m using a trench-and-pour method.

Foundation trenches must extend through all unsuitable materials to competent, undisturbed native silty sand till to sandy silt till. A geotechnical reaction of 100 kPa at the Serviceability Limit States (SLS) and a factored geotechnical resistance of 150 kPa at the Ultimate Limit States (ULS) may be used, subject to confirmation of competent native soil during construction. The geotechnical reactions and factored geotechnical resistances including the corresponding highest founding elevations at the borehole locations are summarized on Table 4.1. Following inspection and approval by PLANET, the trenches may be filled with approved lean concrete having a minimum 28-day compressive strength of 5 MPa, extending from the native founding surface to the proposed footing base (398.04m).

Table 4.1: Bearing Values & Founding Levels of Footings on Native Soils

BH No.	Material	Ground Elevation	Geotechnical Reaction at SLS (kPa)	Factored Geotechnical Resistance at ULS (kPa)	Minimum Depth below Existing Grade (m)	Native Founding Elevation (m)	Proposed Footing Base Elevation (m)	Minimum Lean Mix Thickness (m)
BH1	Silty Sand till Sandy Silt till	398.5	100	150	1.5	397.0	398.04	1.04
BH2	Silty Sand till to Sandy Silt till	398.1	100	150	2.2	395.9	398.04	2.14
BH3	Silty Sand till Sandy Silt till	398.7	100	150	1.5	397.2	398.04	0.84

The founding depths and Lean mix quantities are approximate and must be confirmed during excavation. Groundwater control will be required to maintain stable, dry trenches and prevent disturbance of the native founding soil.

It should be noted that the recommended bearing capacities have been calculated by PLANET from the borehole information for the design stage only. The investigation and comments are necessarily on-going as new information on the underground conditions becomes available. For example, more specific information is available with respect to conditions between boreholes when foundation construction is underway. The interpretation between boreholes and the recommendations of this report must therefore be checked through field inspections provided by PLANET to validate the information for use during the construction.

4.1.2 Other Comments on Foundations

Variations in the soil conditions are expected in between the borehole locations, and during construction, the soil bearing pressures should be confirmed by the Geotechnical Engineer.

The base of all footings must be inspected by this office to ensure their placement on the competent native soil.

To comply with the Township's design standards (Section H.6), a minimum vertical separation of 0.30 m shall be maintained between the underside of footings and the seasonally high groundwater elevation.


Footings designed to the specified bearing capacity at the serviceability limit states (SLS) are expected to settle less than 25 mm total and 19 mm differential.

In the vicinity of the existing buried utilities, footings must be lowered to undisturbed native soils, or alternatively the services must be structurally bridged.

During winter construction, foundations and slab (if applicable) on grade must not be poured on frozen soil. Foundations must be adequately protected at all times from cold weather and freezing conditions.

Design frost protection depth for the general area is 1.2m. Therefore, for frost protection, new footings should have a permanent earth cover of at least 1.2m or be provided with an equivalent thickness of extruded rigid exterior-grade polystyrene insulation. In case of rip-rap (rock fill), only one-half of the rock fill thickness should be assumed to be effective in providing frost protection.

Where it is necessary to place footings at different levels, the upper footing must be founded below an imaginary 10 horizontal to 7 vertical line drawn up from the base of the lower footing. The lower footing must be installed first to help minimize the risk of undermining the upper footing. Footings close to underground services should also be set back from the services based on this slope limitation as shown in the following Figure.

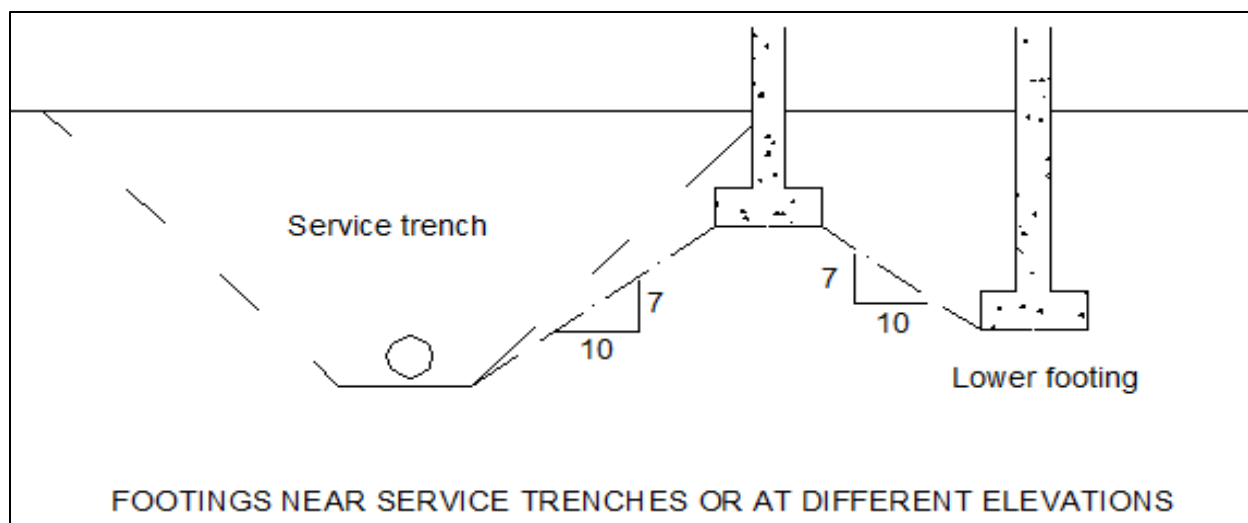

The recommended bearing capacities and the corresponding founding elevations would need to be confirmed by the representative of PLANET during construction. It should be noted that the recommended bearing capacities have been calculated by PLANET from the borehole information for the design stage only. The investigation and comments are necessarily on-going as new information on the underground conditions becomes available. For example, more specific information is available with respect to conditions between boreholes when foundation construction is underway. The interpretation between boreholes and the recommendations of this report must therefore be checked through field inspections provided by PLANET to validate the information for use during the construction stage. In this regard, PLANET should be retained for a general review of the final design and specifications to verify that this report has been properly interpreted and implemented. If not accorded the privilege of making this review, PLANET will assume no responsibility for interpretation of the recommendations in the report.

4.2 Floor Slab and Permanent Drainage

Based on the proposed basement-floor elevation of 398.19 m, the basement slab subgrade is expected to consist of existing fill/disturbed native soils and engineered fill used to raise the proposed grades. All unsuitable materials must be removed and replaced with approved engineered fill under geotechnical supervision. The slab subgrade should be assessed by a geotechnical engineer and disturbed/soft/wet subgrade areas should be sub excavated and replaced with imported Granular A and/or Granular B Type 2. The imported granular material must meet the specifications defined in OPSS-1010-13. The existing fill free from topsoil and organics may be used to raise the grade, provided it is confirmed by a qualified geotechnical professional from PLANET Engineering Inc. at the time construction. The fill required to raise the grade must be placed in shallow lifts (each lift not more than 200 mm) and compacted to at least 98 percent of Standard Proctor Maximum Dry Density (SPMDD).

It is necessary that the basement floor slab be provided with a capillary moisture barrier and drainage layer. This is provided by placing the slab on a minimum layer of 19 mm clear stone (OPSS 1004) compacted by vibration to a compact state. Regardless of the approach to slab construction, the floor slabs that are to have bonded floor finishes (such as tiles with adhesives) should be provided with a capillary moisture and vapour barrier. The floor manufacturers have specific requirements for vapor barrier; therefore, the floor designer/architect must ensure that a provision of appropriate vapour barrier conforming to specific floor finish requirements is incorporated in the project specifications. Adequate testing must be carried out to ensure acceptable levels of moisture/relative humidity in the concrete slab prior to the installation of floor

finish(es). Studies indicate that a provision of 200 mm thick 19 mm clear stone base (OPSS 1004) under the slab helps provide a good capillary moisture break provided the granular base is positively drained. However, this provision does not replace the floor manufacturers' specific requirement(s) for a vapour barrier.

The estimated modulus of subgrade reaction (k_s) equal to 20 MN/m³ may be used for the design of slab-on-grade supported on native or structural fill soils, provided that the construction is in accordance with the recommendations provided herein. If structural fill (Granular A or B Type II) having minimum thickness of 300 mm, this value can be increased to 30 MN/m³. The estimated value provided above may need to be adjusted based on the structure size and location of detailed design.

Such slab are expected to settle less than 25 mm total and $L/\Delta \leq 1/500$ differential. Where

Δ = difference in settlement between two points

L = distance between those points

The floor slabs should not be tied to any load-bearing walls or columns unless they have been designed accordingly. Contraction/expansion joints should be provided for the slabs as required by the structural engineer.

To assist in maintaining a dry basement from seepage, it is recommended that exterior grades around the building be sloped away at a 2 percent gradient or more, for a distance of at least 1.2 m. A perimeter drainage system is provided by forming a drained cavity with prefabricated drain core material such as Miredrain 2000 (Mirafi) or Terradrain 20 (Terrafix). The composite drainage board then discharge to the drainage layer beneath the lowest floor slab through ports made in the foundation wall above the footing level. The subfloor drainage system directs the discharge water to the building stormwater sump. A conceptual underfloor drainage is shown on Drawing 3. It should be note that upon completion of the detailed design of the below grade structure, the underfloor drainage system design shall be reviewed and finalized.

In addition to the perimeter drainage, a provision of a sub-floor drainage system is installed beneath the basement floor slab is also recommended. The sub-floor drainage system should consist of perforated pipes surrounded by granular filter consisting of a free draining material consisting of 19 mm clear stone (OPSS 1004) wrapped in filter fabric (Terrafix 270R or equivalent or OPSS HL 8 Course Aggregate) located at a maximum spacing of 3.0 m on centres (refer to attached Drawing 4 – Basement floor Subdrains).

The exposed subgrade is expected to consist of sandy silt below the water table, and all openings including the subgrade must be covered or wrapped with filter fabric, typically a Class II non-woven textile with a filtration opening size (F.O.S.) of 50 to 100 μ m.

The perimeter and sub-floor drains should outlet to a suitable discharge point under gravity flow or connected to a sump pit(s) located in the lowest level of the basement, and the water be pumped up to a suitable discharge point. The size of the sump should be adequate to accommodate anticipated water seepage. A duplex pumping arrangement (main pump with a provision of a backup pump) on emergency backup power is recommended. The pumps should have sufficient capacity to accommodate the anticipated maximum peak water flow (refer to our hydrogeological investigation report for estimated flow rate). The sub-drain installation and outlet must confirm to the plumbing code requirements.

The subfloor drainage system is a critical structural element at this site, since it keeps water pressure from acting on the basement floor slab. As such the storm sump that ensures the performance of this system must have duplexed pump arrangement on emergency power, as noted above, for 100 percent pumping redundancy.

4.3 Excavations and Backfill

It is anticipated that the existing grade will be raised by approximately 2 m across the site. Excavations within the engineered fill used to raise the grade can be carried out using a heavy hydraulic backhoe. Considering the footings to be placed at minimum frost level, it is anticipated that the excavation will be extended to about 1.2m below the existing grade. Based on the borehole information, Groundwater problems are anticipated for the installation of foundations below the existing ground surface. Any seepage, which may occur during wet periods through fill, can be removed by conventional pumping from sumps for excavation.

All excavations must be carried out in accordance with the most recent Occupational Health and Safety Act (OHSA). In accordance with OHSA, the on-site fill material and compact to loose or firm native soils can be classified as Type 3 soil. The dense to very dense native soils can be classified as Type 1 to Type 2 soil above the water level and Type 4 below the groundwater table. Wet sandy silt to silty sand seams can also be classified as Type 4 soils. As a general rule, the excavations in Type 1 and 2 soils can be carried out without support using side slopes 1H:1V, while the bottom 1.2m of the excavation can be cut vertically and could retain the wall for a short period of time. The excavation in Type 3 soil can be carried out maintaining the side slopes not steeper than 1H:1V. The excavations in Type 4 soils will require minimum flatter side slopes of 3H to 1V. These slopes should be visually monitored for any movement especially if workers are present within the excavation. These temporary slopes should only be utilized for a short duration. If an excavation contains more than one type of soil, the soil shall be classified as the type with the highest number among the types present.

Note that till is non-sorted sediment and therefore may contain boulders. Possible large obstructions such as buried concrete pieces may also be encountered in the fill material. Provisions must be made in the excavation contract for the removal of possible boulders in the till or obstructions in the fill material during construction.

The existing fill (free of topsoil) and native soils can be used as general construction backfill where it can be adequately compacted with suitable type compactors. Loose lifts of soil, which are to be compacted, should not exceed 200 mm. Noted that the excavated soils are subject to moisture content increase during wet weather which would make these materials too wet for adequate compaction. Stockpiles should therefore be compacted at the surface or be covered with tarpaulins to help minimize moisture intake.

Imported granular fill, which can be compacted with handheld equipment, should be used in confined areas. The excavated soils are considered to be free draining. Where free draining backfill is required, imported granular fill such as OPSS Granular B should be used.

Stockpiles should be placed well away from the edge of excavation and their height should be controlled so that they do not surcharge the sides of the excavation. Surface drainage should be controlled to prevent flow of surface water into the excavations. Excavation safety and stability of temporary construction slopes and lateral support systems are the contractor's responsibility.

During winter construction, concrete and/or fill must not be placed on frozen fill or soil. Subgrades and foundations must be placed adequately protected at all times from cold weather and freezing conditions.

4.4 Frost Susceptibility of Soils

The frost depth penetration in this area is considered to be 1.2m. Based on the grain size analysis and using the Ministry of Transportation (MTO) category for frost susceptibility soils, the on-site fill/disturbed native soils would be classified as low susceptible to frost heaving.

4.5 Earth Pressures

The lateral earth pressures acting on walls or underground structures may be calculated from the following expression:

$$p = K(\gamma h + q)$$

where p = Lateral earth pressure in kPa acting at depth h

K = Earth pressure coefficient equal to 0.4 for vertical walls and horizontal Granular B backfill used for permanent construction. Water pressure must be considered if continuous wall drains are not used.

γ = Unit weight of backfill, a value of 21 kN/m³ may be assumed

h = Depth to point of interest in meters

q = Equivalent value of surcharge on the ground surface in kPa

The above expression assumes that the perimeter drainage system prevents the build up of any hydrostatic pressure behind the wall.

Table 4.2: Lateral Earth Pressure Parameters

Static Lateral Earth Pressure Parameters	Silty Sand Till / Sandy Silt Till	Sandy Clayey Silt Till
Active, K_a	0.27	0.33
At-rest, K_o	0.43	0.5
Passive, K_p	3.7	3.0

Table 4.3: Lateral Earth Pressure Parameters

Soil Strength Parameters	Silty Sand Till / Sandy Silt Till	Sandy Clayey Silt Till
Angle of Friction ϕ' (deg)	35	30
Cohesion c' (kPa)	0	5

4.6 Earthquake Considerations

Based on the borehole information, the subject site for the proposed addition can be classified as Class 'D' for seismic site response according to Table 4.1.8.4.A of OBC 2024 provided the footings will be supported on undisturbed native deposits. Consideration could be given to conduct an earthquake site assessment with the use of in-situ testing of the seismic characteristics (i.e. Geophysical testing – Multi-channel Analysis of Surface Waves-MASW) which can lead to an improved site classification (i.e. from Class D to Class C).

4.7 Underground Utility Trenches

As a part of the site development, a network of utility trenches needs to be constructed.

4.7.1 Trenching

It is expected that in most cases the trenches will be excavated through loose to compact fill/disturbed native and/or loose to very dense non-cohesive soils.

Groundwater is anticipated to be a major problem for excavating utility trenches. Any cut below the groundwater level will require dewatering. Otherwise, it will result in an unstable excavation base and flowing sides. The groundwater table must be lowered one meter below the lowest excavation level. The test pit should be carried out in this area before the excavation to further explore the groundwater and seepage conditions. In accordance with OHSA, on-site fill above the groundwater table can be classified as Type 3 soil and the undisturbed native soils as Type 1 to Type 2 soils. Sandy seams or fill layers below the groundwater table can be classified as Type 4.

4.7.2 Bedding

The undisturbed native deposits or engineered fill will provide adequate support for the utility pipes and allow the use of normal Class B type bedding.

The recommended minimum thickness of granular bedding below the invert of the pipes is 150 mm. The thickness of the bedding may, however, have to be increased depending on the pipe diameter or in accordance with local standards or if wet or weak subgrade conditions such are encountered, especially when the soil at the trench base level consists of wet, dilatant silts, sand to silty sand. The bedding material should consist of well-graded granular material such as Granular 'A' or equivalent. After installing the pipe on the bedding, a granular surround of approved bedding material, which extends at least 300 mm above the obvert of the pipe, or as set out by the local authority, should be placed.

To avoid the loss of soil fines from the subgrade, uniformly graded clear stone should not be used unless, below the granular bedding material, a suitable, approved filter fabric (geotextile) is placed. The geotextile should extend along the sides of the trench and should be wrapped all around the poorly graded bedding material.

4.7.3 Backfilling of Trenches

The existing fill (free of topsoil) and native soils can be used as general construction backfill where it can be adequately compacted with suitable type compactors.

The backfill should be placed in maximum 200 mm thick layers at or near ($\pm 2\%$) of the optimum water content and each layer should be compacted to at least 95% SPMDD to within 1.5 m to final subgrade. In the upper 1 m, the degree of compaction should be a minimum 98% SPMDD, except for landscape area. Unsuitable materials such as organic soils, boulders, cobbles, frozen soils, etc. should not be used for backfilling.

The on-site excavated soils should not be used in confined areas (e.g. around catch basins and laterals under roadways) where heavy compaction equipment cannot be operated. The use of imported granular fill together with an appropriate frost taper would be preferable in confined areas and around structures, such as catch basins.

4.8 Pavements

The pavement structures presented in Table 4.4 can be used for the design of proposed asphalt parking lot and driveway.

The explored fill/disturbed generally extended not more than 1.2m in boreholes. The subgrade is expected to consist of fill materials and/or native soils depending upon the proposed grades of pavement structure. The zone of influence of the pavement subgrade is generally estimated within 0.6m below the underside of the granular sub-base.

4.8.1 Ideal Conditions

Under ideal conditions, the zone of the pavement subgrade within 0.8m below the underside of the granular sub-base must be compacted to at least 95% of its Standard Proctor Maximum Dry Density (SPMDD) with moisture content 2 to 3% drier than its optimum and then the compaction should be increased to 98% of SPMDD in the upper 0.6 m of the subgrade.

4.8.2 Non-Ideal Conditions

If the proposed pathways are to be constructed during the wet seasons and if the subgrade is unsuitable then either the top 0.6m of the subgrade should be replaced with drier, compacted, select subgrade material meeting as OPSS 1010-13 or the top 0.6 m of the subgrade should be replaced with granular material meeting the specifications defined in OPSS-1010-13. This will be assessed at the time of access roadways construction and parking area.

The existing fill/disturbed native within 0.6m from the underside of sub-base must be excavated and assessed its stability and suitability according to ideal/non-ideal conditions criteria stipulated by the local authority having jurisdiction over the project site. Depending upon evaluation either the excavated material will be re-used or if found to be unsuitable replaced with select subgrade/granular materials.

In preparation of the subgrade, prior to placement of the granular sub-base and base materials, the subgrade must be proof rolled to determine its stability and suitability for access road construction and parking area by a qualified geotechnical professional.

The recommended pavement structures provided in Table 4.4 are based upon an estimate of the subgrade soil properties determined from visual examination and textural classification of the soil samples. Consequently, the recommended pavement structures should be considered for preliminary design purposes only. A functional design life of eight to ten years has been used to establish the pavement recommendations. This represents the number of years to the first rehabilitation, assuming regular maintenance is carried out. If required, a more refined pavement structure design can be performed based on specific traffic data and design life requirements and will involve specific laboratory tests to determine frost susceptibility and strength characteristics of the subgrade soils, as well as specific data input from the client.

Table 4.4: Recommended Pavement Structure Thickness

Pavement Layer	Compaction Requirements	Light Duty Parking (Cars)	Medium Duty Parking (Occasional Service Vehicle)	Heavy Duty Parking (Delivery Trucks)
Asphaltic Concrete	92 to 96.5% Maximum Relative Density	40 mm OPSS HL 3 40 mm OPSS HL 8	40 mm OPSS HL 3 80 mm OPSS HL 8	50 mm OPSS HL 3 80 mm OPSS HL 8
OPSS Granular A Base** (or 20mm Crushed Limestone)	100% SPMDD*	150 mm	150 mm	150 mm
OPSS Granular B Type I or approved equivalent***	100% SPMDD	200 mm	250 mm	350 mm

* Denotes Standard Proctor Maximum Dry Density, ASTM-D698

** As per TS1010 recycled concrete materials are not acceptable for base material as replacement of granular A.

***An additional thickness of 50mm will be added for sub-base, if recycled concrete materials are used as granular B.

The subgrade must be compacted to 98% SPMDD for at least the upper 300 mm unless accepted by PLANET.

The long-term performance of the pavement structure is highly dependent upon the subgrade support conditions. Stringent construction control procedures should be maintained to ensure uniform subgrade moisture and density conditions are achieved.

Alternatively, consideration should be given to the use of rigid Portland Cement Concrete pavement where there is intense truck use, parking and turning of vehicles. The following Table 4.5 provides the minimum recommended rigid pavement structure.

Table 4.5: Minimum Rigid Concrete Pavement Structure

Pavement Layer	Compaction Requirements	Heavy Duty Pavement	Light Duty Pavement
Portland Cement Concrete (CAN3-CSA A23.1) - Class C-2	CAN3-CSA A23.1	225 mm	150mm
Base Course: Granular A (OPSS 1010) or 19 mm Crusher Run Limestone	100% Standard Proctor Maximum Dry Density (ASTM-D698)	150 mm	150mm

It must be noted that this structure does not provide full protection of the subgrade from frost penetration; therefore, the pavement slabs must be separated from the building structure.

Control of surface water is an important factor in achieving a good pavement life. The need for adequate subgrade drainage cannot be over-emphasized. The subgrade must be free of depressions and sloped (preferably at a minimum grade of two percent) to provide effective drainage toward subgrade drains. Grading adjacent to the pavement areas should be designed to ensure that water is not allowed to pond adjacent to the outside edges of the pavement. Continuous pavement subdrains should be provided along

both sides of the driveway/access routes and drained into respective catch basins to facilitate drainage of the subgrade and granular materials. The subdrain invert should be maintained at least 0.3 m below subgrade level. Subdrains should also be provided at all catch basins within the parking area.

Concrete should be proportioned, mixed, placed and cured in accordance with the requirements of CSA Standard CAN/CSA-A23.1-19 for class C-2 exposure, with the following key requirements:

minimum 28-day compressive strength:	32 MPa
air entrainment:	5 to 8 %
maximum water/cementing material ratio:	0.45

Concrete should be placed and spread in a manner which avoids segregation. It should be consolidated with a vibratory screed or internal vibrators. Consolidation close to form edges must be given special consideration.

Concrete should be finished with a thickness tolerance of 0 to plus 10 mm. Concrete must be cured adequately to provide durability and strength. Curing can be accomplished by wet blankets, sprinkling, plastic sheets and curing compounds. Curing should begin immediately after loss of bleed water.

Concrete pavement should be provided with joints to control stresses and prevent the formation of irregular cracks. Recommended joint spacing is 24 to 30 times slab thickness to a maximum dimension of about 4.0m. We would also recommend that load transfer dowels be placed at 50 mm spacing at the joints.

Sawed joints should be cut before random cracking occurs in the slab, usually within 6 to 18 hours after concrete placement. The maximum thickness (aperture) of control joints should be 6 mm, while the depth of control joints should be about 1/4th of the slab thickness.

The pavement should be closed to traffic until a minimum flexural strength of 2 MPa is attained or an approximate compressive strength of 20 MPa. This minimum strength is generally reached when the concrete can be sawcut without raveling.

Additional comments on the construction of parking areas and access roadways are as follows:

1. Removal of all fill for pavement is not necessary. As part of the subgrade preparation, proposed parking and play areas and access roadways should be stripped fill at least in the upper 0.8 m below grade and superficially softened native soils and the base then should be thoroughly proof rolled by using a loaded truck. Unstable areas or areas with excessive organic materials should be further sub-excavated. The fill required to raise the grade can consist of inorganic soil, placed in shallow lifts and compacted to minimum 98 percent of Standard Proctor Maximum Dry Density (SPMDD).
2. The locations and extent of sub-drainage required within the paved areas should be reviewed by this office in conjunction with the proposed lot grading. Assuming that satisfactory crossfalls in the order of two percent have been provided, subdrains extending from and between catch basins may be satisfactory. In the event that shallower crossfalls are considered, a more extensive system of sub-drainage may be necessary and should be reviewed by PLANET.
3. The above pavement structure considers that construction will be carried out during the dry period of the year. If the subgrade becomes excessively wet or rutted during construction activities, additional sub-base material or placement of geogrids may be required. The need for additional sub-base material and/or placement of geogrids including filter fabric to stabilize the base is best determined during construction. It is recommended that the existing subgrade be heavily proof

rolled prior to placement and any areas showing excessive deflection be replaced prior to placing the granular sub-base material.

4. It is recommended that PLANET be retained to review the final pavement structure designs and drainage plans prior to construction to ensure that they are consistent with the recommendations.

4.8.3 Stripping, Sub-excavation and Grading

The final subgrade should be cambered or otherwise shaped properly to facilitate rapid drainage and to prevent the formation of local depressions in which water could accumulate.

Owing to the clayey (i.e. impervious) nature of the subsoil at some locations of the site, proper cambering and allowing the water to escape towards the sides (where it can be removed by means of subdrains) is considered to be beneficial for this project. Otherwise, any water collected in the granular sub-base materials could be trapped thus causing problems due to softened subgrade, differential frost heave, etc. For the same reason damaging the subgrade during and after placement of the granular materials by heavy construction traffic should be avoided. If the moisture content of the local material cannot be maintained at $\pm 2\%$ of the optimum moisture content, imported granular material may need to be used.

Any fill required regarding the site or backfill should be select, clean material, free of topsoil, organic or other foreign and unsuitable matter. The fill should be placed in thin layers and compacted to at least 95% of its SPMDD. The degree of compaction should be increased to 98% within the top 1.0 m of the subgrade, or as per City Standards. The compaction of the new fill should be checked by frequent field density tests.

The native deposit may contain larger particles (cobbles and boulders) that are not specifically identified in the boreholes. The size and distribution of such obstructions cannot be predicted with borings, because the borehole sampler size is insufficient to secure representative samples of the particles of this size. Provision should be made in excavation contracts to allocate risks associated with time spent and equipment utilized to remove or penetrate such obstructions when encountered.

The undisturbed native soil deposit at the site predominantly consists of silty sand with trace to some clay. Based on the borehole and water level data as well as estimated underside of excavation is not expected to extend below the prevailing ground water table, therefore, there is no significant water seepage expected in relatively shallow excavations, except for relatively limited amounts of perched ground water which may be present in wet silt/sand lenses within native soils. Any ground water seepage encountered should diminish slowly and can be controlled by continuous pumping from a conventional sump and pump arrangement at the base of the excavation.

It is noted that the native soils tend to weather rapidly and deteriorate when exposed to the atmosphere and water. Therefore, any excavation base that remains open for an extended period should be protected with a skim coat of lean concrete.

During and at the completion of drilling, no ground water was observed in any of the boreholes. Perched water may be encountered in excavated areas during wet seasons. A perched water condition can occur due to the accumulation of surface water in the more pervious fill overlying less pervious deposit, or at the interface of fill and native soils, especially during wet periods. Note that the groundwater level can vary and is subject to seasonal fluctuations and in response to major weather events. The depth of groundwater table can also be influenced by the presence of underground features such as utility trenches, and this may affect the construction procedures, costs and schedules. Wet soils may be encountered to about 0.6 m higher than the water levels noted due to capillary rise in fine cohesionless soils. It should be noted that excavations carried through and below the water bearing cohesionless soils (sand, silt), will experience

loosening and sloughing of the sides and/or unstable base, thus requiring relatively flatter excavation slopes.

4.8.4 Construction

Once the subgrade has been inspected and approved, the granular base and sub-base course materials should be placed in layers not exceeding 200 mm (uncompacted thickness) and should be compacted to at least 100% of their respective SPMDD. The grading of the material should conform to current OPS Specifications.

The placing, spreading, and rolling of the asphalt should be in accordance with OPS Specifications or, as required by the local authorities.

Frequent field density tests should be carried out on both the asphalt and granular base and sub-base materials to ensure that the required degree of compaction is achieved.

4.8.5 Drainage

All paved surfaces should be sloped to provide satisfactory drainage towards catch basins. Installation of full-length subdrains on all roads is recommended. The subdrains should be properly filtered to prevent the loss of (and clogging by) soil fines.

4.9 Geotechnical Review

It is recommended that the project design drawings be submitted to PLANET for review for compatibility with site subsurface conditions and the recommendations contained in this report.

4.10 Percolation Test Memo

The percolation test memo, including recommendations regarding the long-term percolation capacity, is presented in Appendix E.

4.11 Engineered Fill and Sub-Excavation

Detailed site grading plans for the proposed development were not available to us at the time of preparation of this report. In the areas where earth fill is required for site grading purposes, engineered fill can be used and similarly, if the area under consideration need to be raised, engineered fill can be used.

Prior to the placement of the engineered fill, all of the existing fill, the loose possible fill/disturbed soil, and surficially softened native soils must be removed and the exposed surface proof rolled. Any soft spots revealed during proof rolling must be sub-excavated and re-engineered. The depths of sub-excavation required for the construction of engineered fill will be assessed by a geotechnical professional at the time of excavation.

General guidelines for the placement and preparation of engineered fill are presented on Appendix "C". A geotechnical reaction of 100 to 150 kPa (2000 to 3000 psf) at the Serviceability Limit States (SLS) and factored geotechnical resistances of 150 to 225 kPa at the Ultimate Limit States (ULS) can be used on engineered fill, provided that all requirements on Appendix "C" are adhered to. To reduce the risk of improperly placed engineered compacted fill, full-time supervision of the contractor is essential. Despite full time supervision, it has been found that contractors frequently bulldoze loose fill into areas and compact

only the surface. The inspector, either busy on other portions of the site or absent during “off hours” will be unaware of this condition. For this reason, we cannot guarantee the performance of the engineered fill, and this guarantee must be the responsibility of the contractor. The owner and his representatives must accept the risk involved in the use of engineered fill and offset this risk with the monetary savings of avoiding deep foundations/soil improvement. This potential problem must be recognized and discussed at a pre-construction meeting. Procedures can then be instigated to reduce the risk of settlement resulting from un-compacted fill.

The following is a recommended procedure for engineered fill:

1. Prior to site work involving engineered fill, a site meeting to discuss all aspects must be convened. The surveyor, contractor, design engineer and geotechnical engineer must attend the meeting. At this meeting, the limits of the engineered fill will be defined. The contractor must make known where all fill material will be obtained, and samples must be provided to the geotechnical engineer for review, and approval before filling begins.
2. Detailed drawings indicating the lower boundaries as well as the upper boundaries of the engineered fill must be available at the site meeting and be approved by the geotechnical engineer.
3. The building footprint and base of the pad, including basements, garages (if applicable), etc. must be defined by offset stakes that remain in place until the footings and service connections are all constructed. Confirmation that the footings are within the pad, service lines are in place, and that the grade conforms to drawings, must be obtained by the owner in writing from the surveyor and PLANET Engineering Inc. Without this confirmation no responsibility for the performance of the structure can be accepted by PLANET Engineering Inc. Survey drawing of the pre and post fill location and elevations will also be required.
4. The area must be stripped of all topsoil and fill materials. Subgrade must be proof rolled. Soft spots must be dug out. The stripped native subgrade must be examined and approved by PLANET Engineering Inc engineer prior to placement of fill.
5. The approved engineered fill must be compacted to 100% Standard Proctor Maximum Dry Density throughout. Granular Fill preferred. Engineered fill should not be placed (where it will support footings) during the winter months. Engineered fill compacted to 100% SPMDD will settle under its own weight approximately 0.5% of the fill height and the structural engineer must be aware of this settlement. In addition to the settlement of the fill, additional settlement due to consolidation of the underlying soils from the structural and fill loads will occur.
6. Full-time geotechnical inspection by PLANET Engineering Inc during placement of engineered fill is required. Work cannot commence or continue without the presence of the PLANET representative.
7. The fill must be placed such that the specified geometry is achieved. Refer to sketches for minimum requirements. Take careful note that the projection of the compacted pad beyond the footing at footing level is a minimum of 2 m. The base of the compacted pad extends 2 m plus the depth of excavation beyond the edge of the footing.
8. A geotechnical reaction of 100 to 150 kPa (2000 to 3000 psf) may be used provided that all conditions outlined above are adhered to. A minimum footing width of 500 mm (20 inches) is suggested and footings should be provided with nominal steel reinforcement.

9. All excavations must be done in accordance with the Occupational Health and Safety Regulations of Ontario.
10. After completion of the pad a second contractor may be selected to install footings. All excavations must be backfilled under full time supervision by PLANET to the same degree as the engineered fill pad. Surface water cannot be allowed to pond in excavations or to be trapped in clear stone backfill. Clear stone backfill can only be used with the approval of PLANET.
11. After completion of compaction, the surface of the pad must be protected from disturbance from traffic, rain and frost.
12. If there is a delay in construction, the engineered fill pad must be inspected and accepted by the PLANET's geotechnical engineer. The location of the structure must be reconfirmed that it remains within the pad.

5 GENERAL COMMENTS

The recommended bearing capacities (Geotechnical Reaction) and the corresponding founding elevations would need to be confirmed by the representative of PLANET during construction. It should be noted that the recommended bearing capacities have been calculated by PLANET from the borehole information for the design stage only. The investigation and comments are necessarily on-going as new information of the underground conditions becomes available. For example, more specific information is available with respect to conditions between boreholes when foundation construction is underway. The interpretation between boreholes and the recommendations of this report must therefore be checked through field inspections provided by PLANET to validate the information for use during the construction.

In this regard, PLANET should be retained for a general review of the final design and specifications to verify that this report has been properly interpreted and implemented. If not accorded the privilege of making this review, PLANET will assume no responsibility for interpretation of the recommendations in the report.

The comments given in this report are intended only for the guidance of design engineers. The number of boreholes required to determine the localized underground conditions between boreholes affecting construction costs, techniques, sequencing, equipment, scheduling, etc., would be much greater than has been carried out for design purposes. Contractors bidding on or undertaking the works should, in this light, decide on their own investigations, as well as their own interpretations of the factual borehole results, so that they may draw their own conclusions as to how the subsurface conditions may affect them.

The information in this report in no way reflects any of the environmental aspects of the soil condition at the site and has not been specifically addressed in this report, since this aspect was beyond the scope and terms of reference.

We trust that the information contained in this report is satisfactory. Should you have any questions, please do not hesitate to contact this office.

For and on behalf of PLANET Engineering Inc


Haseeb Hasan, M.Eng.

Project Manager



Irfan Ahmad Khokhar, Ph.D., P.Eng., Consulting Engineer
Vice President and Principal

DRAWINGS

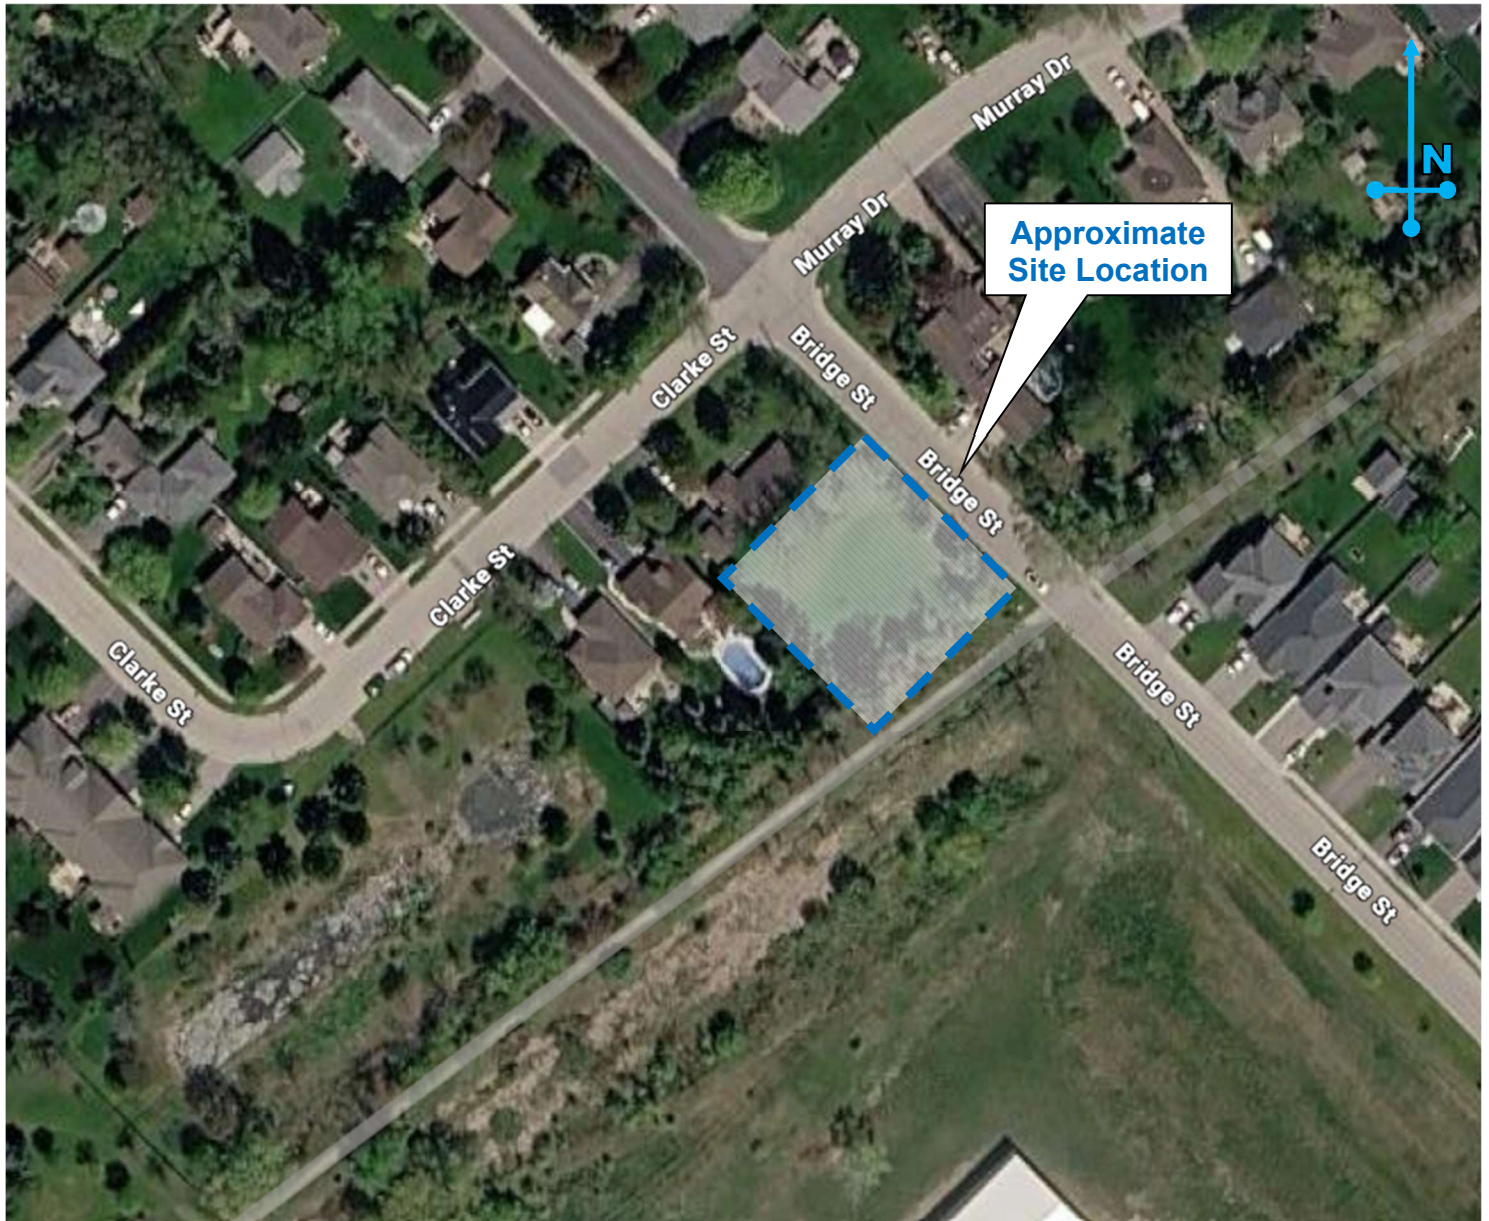

SITE LOCATION PLAN

Drawn By:
ZA

Project:


Date:
June 12, 2026

GEOTECHNICAL INVESTIGATION

Approved By:
IK

65-69 BRIDGE ST, TOWNSHIP OF CENTRAL WELLINGTON,
ONTARIO

Project No:
2601486AG

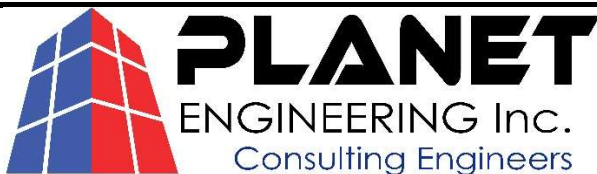

Client:

Elora Greens Inc

Drawing No 1



BOREHOLE LOCATION PLAN

Drawn By:
ZA

Project:


GEOTECHNICAL INVESTIGATION

Date:
June 12, 2026

Approved By:
IK

65-69 BRIDGE ST, TOWNSHIP OF CENTRAL WELLINGTON,
ONTARIO

Project No:
2601486AG

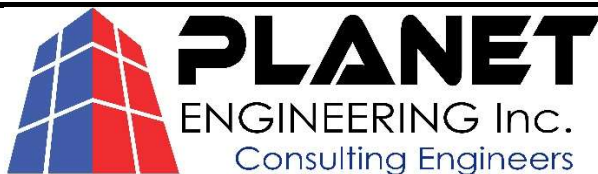

Client:

Elora Greens Inc.

Drawing No 1A

Drawing 1B: Notes on Sample Descriptions

1. All sample descriptions included in this report follow the Canadian Foundations Engineering Manual soil classification system. This system follows the standard proposed by the International Society for Soil Mechanics and Foundation Engineering. Laboratory grain size analyses provided by PLANET Engineering Inc also follow the same system. Different classification systems may be used by others; one such system is the Unified Soil Classification. Please note that, with the exception of those samples where a grain size analysis has been made, all samples are classified visually. Visual classification is not sufficiently accurate to provide exact grain sizing or precise differentiation between size classification systems.

ISSMFE SOIL CLASSIFICATION											
CLAY	SILT			SAND			GRAVEL			COBBLES	BOULDERS
	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE	FINE	MEDIUM	COARSE		
	0.002	0.006	0.02	0.06	0.2	0.6	2.0	6.0	20	60	200

EQUIVALENT GRAIN DIAMETER IN MILLIMETRES											
CLAY (PLASTIC) TO				FINE		MEDIUM		CRS.	FINE		COARSE
SILT (NONPLASTIC)				SAND					GRAVEL		


UNIFIED SOIL CLASSIFICATION											
-----------------------------	--	--	--	--	--	--	--	--	--	--	--

UNIFIED SOIL CLASSIFICATION


2. Fill: Where fill is designated on the borehole log it is defined as indicated by the sample recovered during the boring process. The reader is cautioned that fills are heterogeneous in nature and variable in density or degree of compaction. The borehole description may therefore not be applicable as a general description of site fill materials. All fills should be expected to contain obstruction such as wood, large concrete pieces or subsurface basements, floors, tanks, etc.; none of these may have been encountered in the boreholes. Since boreholes cannot accurately define the contents of the fill, test pits are recommended to provide supplementary information. Despite the use of test pits, the heterogeneous nature of fill will leave some ambiguity as to the exact composition of the fill. Most fills contain pockets, seams, or layers of organically contaminated soil. This organic material can result in the generation of methane gas and/or significant ongoing and future settlements. Fill at this site may have been monitored for the presence of methane gas and, if so, the results are given on the borehole logs. The monitoring process does not indicate the volume of gas that can be potentially generated nor does it pinpoint the source of the gas. These readings are to advice of the presence of gas only, and a detailed study is recommended for sites where any explosive gas/methane is detected. Some fill material may be contaminated by toxic/hazardous waste that renders it unacceptable for deposition in any but designated land fill sites; unless specifically stated the fill on this site has not been tested for contaminants that may be considered toxic or hazardous. This testing and a potential hazard study can be undertaken if requested. In most residential/commercial areas undergoing reconstruction, buried oil tanks are common and are generally not detected in a conventional geotechnical site investigation.
3. Till: The term till on the borehole logs indicates that the material originates from a geological process associated with glaciation. Because of this geological process the till must be considered heterogeneous in composition and as such may contain pockets and/or seams of material such as sand, gravel, silt or clay. Till often contains cobbles (60 to 200 mm) or boulders (over 200 mm). Contractors may therefore encounter cobbles and boulders during excavation, even if they are not indicated by the borings. It should be appreciated that normal sampling equipment cannot differentiate the size or type of any obstruction. Because of the horizontal and vertical variability of till, the sample description may be applicable to a very limited zone; caution is therefore essential when dealing with sensitive excavations or dewatering programs in till materials.

UNIFIED SOIL CLASSIFICATION SYSTEM


LS 702/D 422

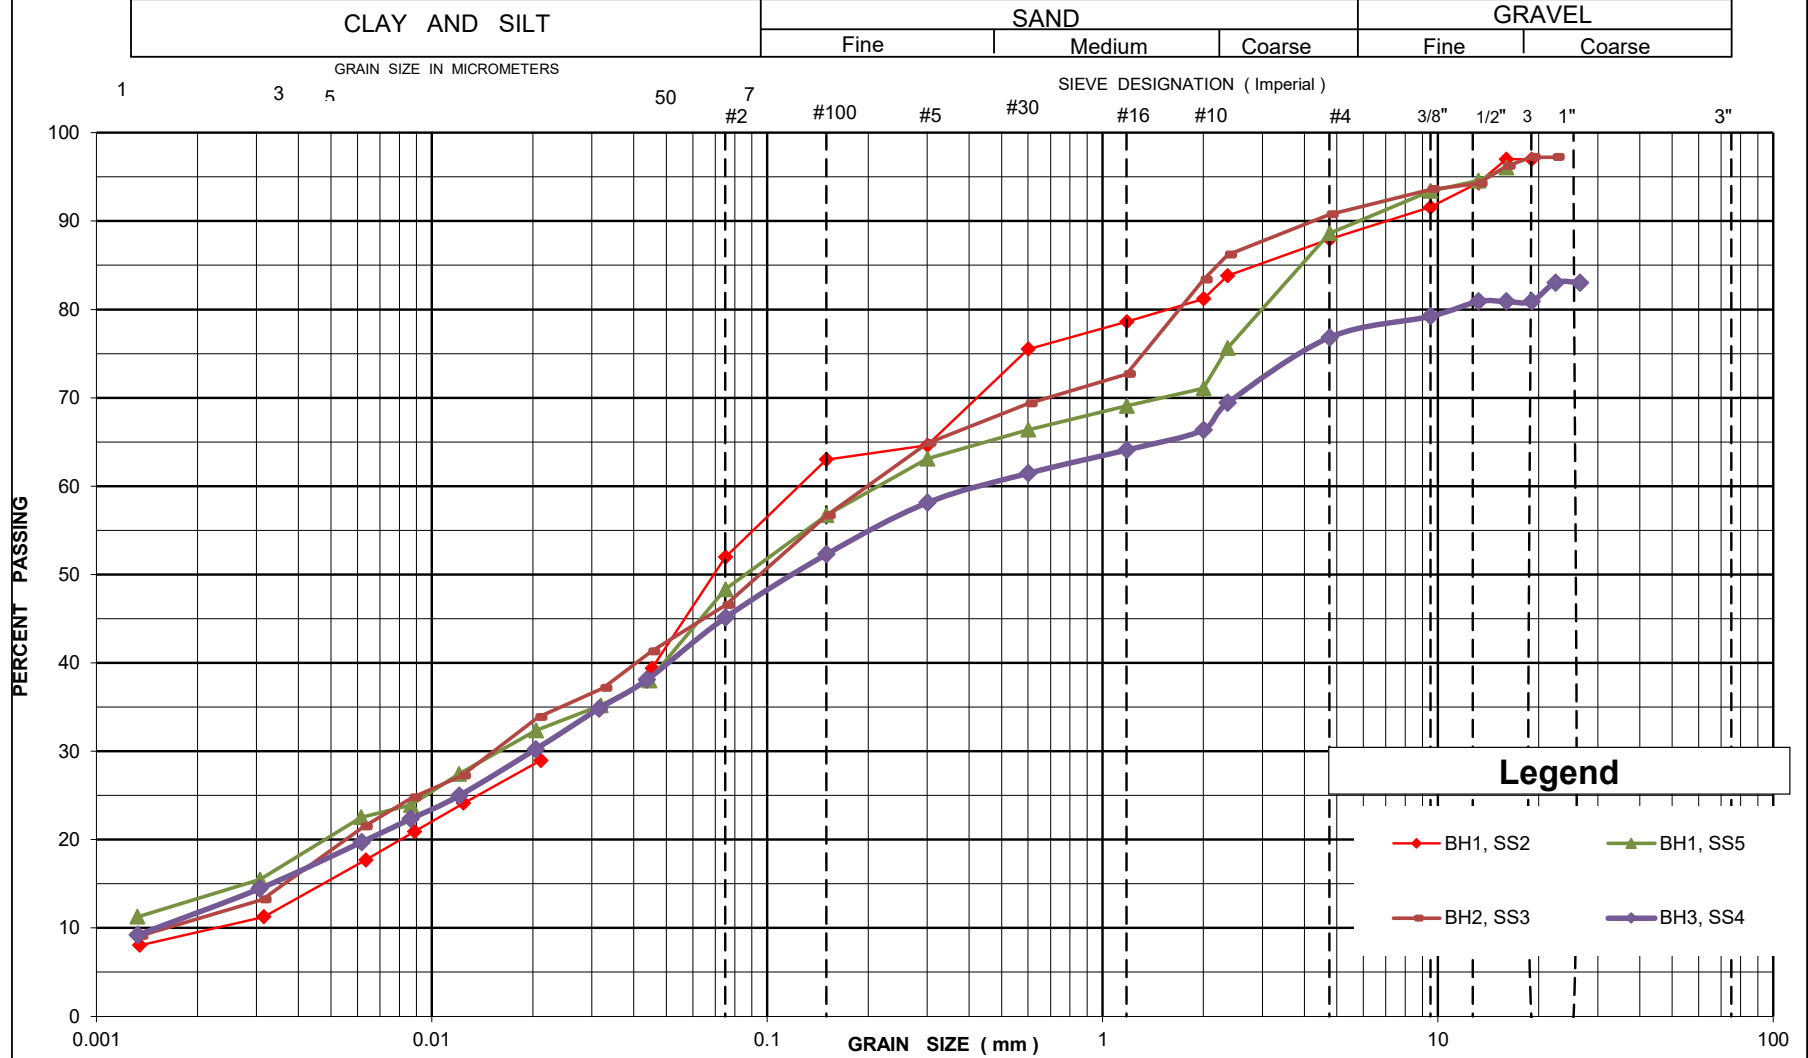

Drawing No. 3

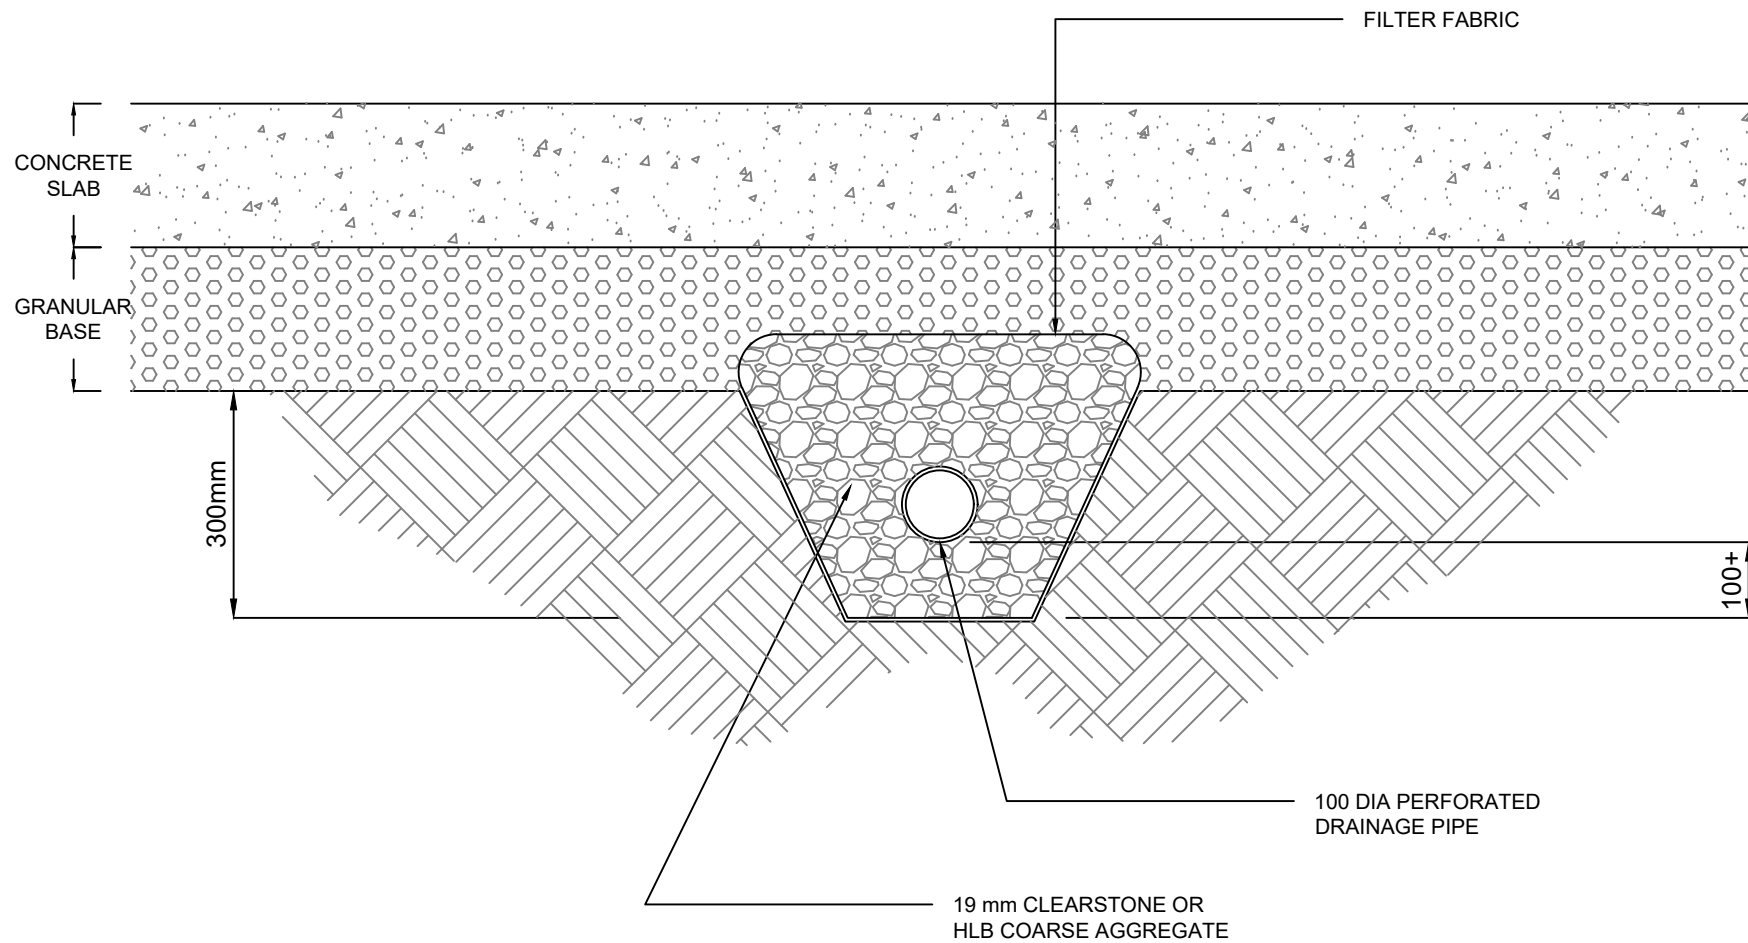

Drawing No. 4

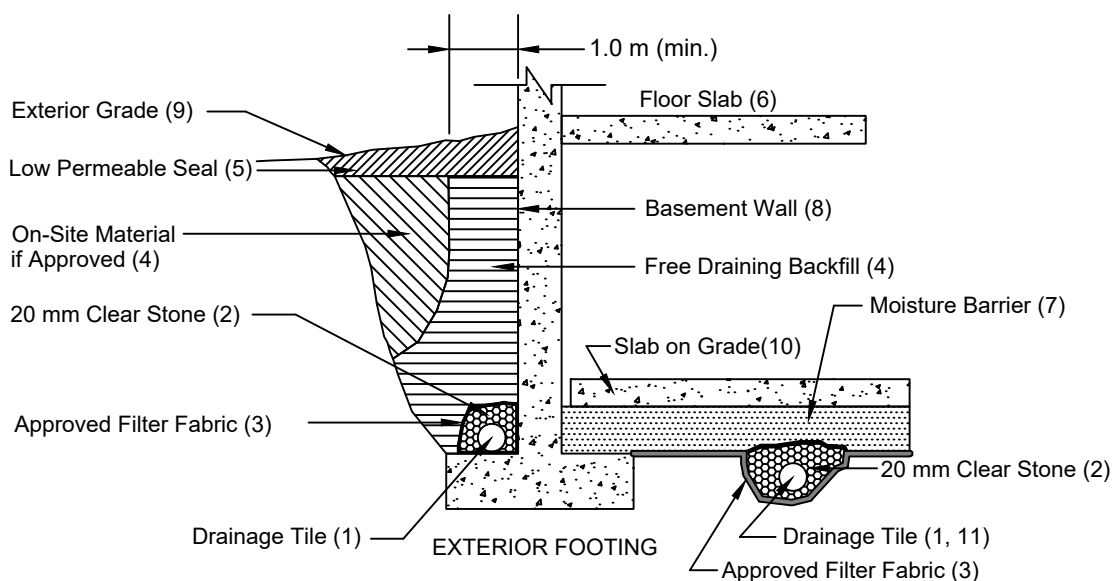

Notes

1. Drainage tile to consist of 100 mm (4") diameter weeping tile or equivalent perforated pipe leading to a positive sump or outlet.
2. 20 mm (3/4") clear stone - 150 mm (6") top and side of drain. If drain is not on footing, place 100 mm (4 inches) of stone below drain.
3. Wrap the clear stone with an approved filter fabric (Terrafix 270R or equivalent).
4. Free Draining backfill - OPSS Granular B or equivalent compacted to the specified density. Do not use heavy compaction equipment within 450 mm (18") of the wall. Use hand controlled light compaction equipment within 1.8 m (6') of wall. The minimum width of the Granular 'B' backfill must be 1.0 m.
5. Low permeable backfill seal - compacted clay, clayey silt or paved with concrete/asphalt or equivalent. If original soil is free-draining, seal may be omitted. Maximum thickness of seal to be 0.5 m.
6. Do not backfill until wall is supported by basement and floor slabs or adequate bracing.
7. Moisture barrier to be at least 200 mm (8") of compacted clear 20 mm (3/4") stone or equivalent free draining material. A vapour barrier may be required for specialty floors.
8. Basement wall to be damp proofed for parking garage and water proofed for finished basement.
9. Exterior grade to slope away from building.
10. Typically slab on grade is not structurally connected to the wall or footing. However, if it is connected to the wall, it should be designed accordingly.
11. Underfloor drain invert to be at least 300 mm (12") below underside of floor slab.
12. Drainage tile placed in parallel rows 6 to 8 m (20 to 25') centers one way. Place drain on 100 mm (4") clear stone with 150 mm (6") of clear stone on top and sides. Enclose stone with filter fabric as noted in (3).
13. The entire subgrade to be sealed with approved filter fabric (Terrafix 270R or equivalent) if non-cohesive (sandy) soils below ground water table encountered.
14. Do not connect the underfloor drains to perimeter drains.
15. Review the geotechnical report for specific details. Final detail must be approved before system is considered acceptable.

DRAINAGE AND BACKFILL RECOMMENDATIONS

Basement with Underfloor Drainage

(not to scale)

APPENDICES

Appendix A:

Limitations of Report

Limitations of Report

This report is intended solely for the Client named. The material in it reflects our best judgment in light of the information available to PLANET Engineering Inc. at the time of preparation. Unless otherwise agreed in writing by PLANET Engineering Inc, it shall not be used to express or imply warranty as to the fitness of the property for a particular purpose. No portion of this report may be used as a separate entity, it is written to be read in its entirety.

The conclusions and recommendations given in this report are based on information determined at the testhole locations. The information contained herein in no way reflects on the environment aspects of the project, unless otherwise stated. Subsurface and groundwater conditions between and beyond the testholes may differ from those encountered at the testhole locations, and conditions may become apparent during construction, which could not be detected or anticipated at the time of the site investigation. The benchmark and elevations used in this report are primarily to establish relative elevation differences between the testhole locations and should not be used for other purposes, such as grading, excavating, planning, development, etc.

The design recommendations given in this report are applicable only to the project described in the text and then only if constructed substantially in accordance with the details stated in this report.

The comments made in this report on potential construction problems and possible methods are intended only for the guidance of the designer. The number of testholes may not be sufficient to determine all the factors that may affect construction methods and costs. For example, the thickness of surficial topsoil or fill layers may vary markedly and unpredictably. The contractors bidding on this project or undertaking the construction should, therefore, make their own interpretation of the factual information presented and draw their own conclusions as to how the subsurface conditions may affect their work. This work has been undertaken in accordance with normally accepted geotechnical engineering practices.

Any use which a third party makes of this report, or any reliance on or decisions to be made based on it, are the responsibility of such third parties. PLANET Engineering Inc accepts no responsibility for damages, if any, suffered by any third party as a result of decisions made or actions based on this report.

We accept no responsibility for any decisions made or actions taken as a result of this report unless we are specifically advised of and participate in such action, in which case our responsibility will be as agreed to at that time. Any user of this report specifically denies any right to claims against the Consultant, Sub-Consultants, their officers, agents and employees in excess of the fee paid for professional services.

Appendix B:

Borehole Logs

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings						DRILLING DATA																		
CLIENT: Elora Greens Inc.						Method: Solid Stem Auger																		
PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington						Diameter: 150mm																		
DATUM: Geodetic						Date: Jun-02-2026																		
BH LOCATION: N 4836564.441 E 547055.5554						REF. NO.: 2601486AG																		
						DRAWING NO.: 1																		
SOIL PROFILE			SAMPLES			DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC LIMIT		NATURAL MOISTURE CONTENT		LIQUID LIMIT		POCKET PEN. (Cu) (kPa)		NATURAL UNIT WT (kN/m³)		REMARKS AND GRAIN SIZE DISTRIBUTION (%)						
(m)	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m	GROUND WATER CONDITIONS	ELEVATION	SHEAR STRENGTH (kPa)		Wp		W		WL										
DEPTH								20	40	60	80	100	20	40	60	80	100	10	20	30	GR	SA	SI	CL
398.5																								
0.0 398.3	Topsoil:200mm																							
0.2	Fill/Disturbed Native: silty sand, trace to some gravel & clay, trace rootlets, very moist, brown, loose		1	SS	7		398																	
1 397.4			2	SS	4																12	36	43	9
1.1	Silty Sand Till to Sandy Silt Till: trace to some gravel & clay, boulders, very moist to moist, brown to grey, loose to compact																							
2			3	SS	18																			
			4	SS	29		396																	
3			5	SS	25		395														11	41	35	13
4																								
393.9							394																	
4.6	Sandy Clayey Silt Till: trace gravel, boulders, moist to very moist, grey, hard		6	SS	40																			
							393																	

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3 , × 3 : Numbers refer to Sensitivity

○ s=3% Strain at Failure

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings							DRILLING DATA												
CLIENT: Elora Greens Inc.							Method: Solid Stem Auger												
PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington							Diameter: 150mm												
DATUM: Geodetic							Date: Jun-02-2026												
BH LOCATION: N 4836553.135 E 547064.0464							REF. NO.: 2601486AG												
							DRAWING NO.: 2												
SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W _L	POCKET PEN. (C _u) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)		
(m)	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m		ELEVATION	SHEAR STRENGTH (kPa)										WATER CONTENT (%)	
ELEV DEPTH								20	40	60	80								100
398.1																			
0.0 397.9	Topsoil: 180mm,						398												
0.2	Fill/Disturbed Native: silty sand, trace to some gravel & clay, trace rootlets, wet to very moist, blackish to brown, compact to loose		1	SS	16														
1																			
396.9			2	SS	4		397												
1.2	Silty Sand Till to Sandy Silt Till: trace to some gravel & clay, boulders, very moist to moist, brown to grey, loose to dense																		
			3	SS	7														
			4	SS	24														

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3 , × 3 : Numbers refer to Sensitivity

○ = 3% Strain at Failure

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings							DRILLING DATA													
CLIENT: Elora Greens Inc.							Method: Solid Stem Auger													
PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington							Diameter: 150mm				REF. NO.: 2601486AG									
DATUM: Geodetic							Date: Jun-02-2026				DRAWING NO.: 3									
BH LOCATION: N 4836566.236 E 547070.9367																				
SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	DYNAMIC CONE PENETRATION RESISTANCE PLOT					PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W _L	POCKET PEN. (CU) (kPa)	NATURAL UNIT WT (kN/m ³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)			
(m)	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m		SHEAR STRENGTH (kPa)											WATER CONTENT (%)		
ELEV. DEPTH							20 40 60 80 100											20 40 60 80 100		
398.7							○ UNCONFINED + FIELD VANE & Sensitivity ● QUICK TRIAXIAL × LAB VANE					10 20 30						GR SA SI CL		
398.8	Topsoil: 150mm																			
0.2	Fill/Disturbed Native: silty sand, trace to some gravel & clay, trace rootlets, very moist to moist, brown, compact to loose		1	SS	11															
397.6			2	SS	6															
1.1	Silty Sand Till to Sandy Silt Till: trace to some gravel & clay, boulders, very moist to moist, brown to grey, loose to dense																			
			3	SS	11															
			4	SS	40												23 32 34 11			
			5	SS	36															
393.9																				
4.8	Sandy Clayey Silt Till: trace gravel, boulders, moist to very moist, grey, hard to very stiff		6	SS	37															

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3 , × 3 : Numbers refer to Sensitivity

○ s=3% Strain at Failure

Appendix C:
General Requirements for Engineered Fill

GENERAL REQUIREMENTS FOR ENGINEERED FILL

Compacted imported soil that meets specific engineering requirements and is free of organics and debris and that has been continually monitored on a full-time basis by a qualified geotechnical representative is classified as engineered fill. Engineered fill that meets these requirements and is bearing on suitable native subsoil can be used for the support of foundations.

Imported soil used as engineered fill can be removed from other portions of a site or can be brought in from other sites if suitable. In general, most of Ontario soils are too wet to achieve the 100% Standard Proctor Maximum Dry Density (SPMDD) and will require drying and careful site management if they are to be considered for engineered fill. Imported non-cohesive granular soil is preferred for all engineered fill. For engineered fill, Planet Engineering Inc (PLANET) recommends use of OPSS Granular 'B' sand and gravel fill material only.

Adverse weather conditions such as rain make the placement of engineered fill to the required degree of density difficult or impossible; engineered fill should not be placed during freezing conditions, i.e. normally not between December 15 and April 1 of each year. If the project demands placement of engineered fill in winter (December 15- April1) it can be placed only under the following conditions:



- All frozen material and or snow must be removed before placement of engineered fill on a daily basis
- Only Granular B Type 2 or Granular A (including crushed concrete or crushed limestone)
- The fill placement must be supervised on a full time basis by a geotechnical consultant

The location of the foundations on the engineered soil pad is critical and certification by a qualified surveyor that the foundations are within the stipulated boundaries is mandatory. Since layout stakes are often damaged or removed during fill placement, offset stakes must be installed and maintained by the surveyors during the course of fill placement so that the contractor and engineering staff are continually aware of where the engineered fill limits lie. Foundations placed within the engineered soil pad must be backfilled with the same conditions and quality control as the original pad.

To perform satisfactorily, engineered fill requires the cooperation of the designers, engineers, contractors and all parties must be aware of the requirements. The minimum requirements are as follows, however, the geotechnical report must be reviewed for specific information and requirements.


1. Prior to site work involving engineered fill, a site meeting to discuss all aspects must be convened. The surveyor, contractor, design engineer and geotechnical engineer must attend the meeting. At this meeting, the limits of the engineered fill will be defined. The contractor must make known where all fill material will be obtained and samples must be provided to the geotechnical engineer for review, and approval before filling begins.
2. Detailed drawings indicating the lower boundaries as well as the upper boundaries of the engineered fill must be available at the site meeting and be approved by the geotechnical engineer.
3. The building footprint and base of the pad, including basements, garages, etc. must be defined by offset stakes that remain in place until the footings and service connections are all constructed. Confirmation that the footings are within the pad, service lines are in place, and that the grade conforms to drawings, must be obtained by the owner in writing from the surveyor and Planet Engineering Inc. Without this confirmation no responsibility for the performance of the structure can be accepted by Planet Engineering Inc. Survey drawing of the pre and post fill location and elevations will also be required.

4. The area must be stripped of all topsoil and fill materials. Subgrade must be proof rolled. Soft spots must be dug out. The stripped native subgrade must be examined and approved by an engineer from Planet Engineering Inc. prior to placement of fill.
5. The approved engineered fill must be compacted to 100% Standard Proctor Maximum Dry Density throughout. Granular Fill preferred. Engineered fill should not be placed (where it will support footings) during the winter months. Engineered fill compacted to 100% SPMDD will settle under its own weight approximately 0.5% of the fill height and the structural engineer must be aware of this settlement. In addition to the settlement of the fill, additional settlement due to consolidation of the underlying soils from the structural and fill loads will occur and should be evaluated prior to placing the fill.
6. Full-time geotechnical inspection by Planet Engineering during placement of engineered fill is required. Work cannot commence or continue without the presence of Planet Engineering representative.
7. The fill must be placed such that the specified geometry is achieved. Refer to sketches for minimum requirements. Take careful note that the projection of the compacted pad beyond the footing at footing level is a minimum of 2 m. The base of the compacted pad extends 2 m plus the depth of excavation beyond the edge of the footing.
8. The allowable bearing pressure provided in the accompanying report may be used provided that all conditions outlined above are adhered to. A minimum footing width of 500 mm (20 inches) is suggested and footings must be provided with nominal steel reinforcement.
9. All excavations must be done in accordance with the Occupational Health and Safety Regulations of Ontario.
10. After completion of the pad a second contractor may be selected to install footings. The prepared footing bases must be evaluated by engineering staff from Planet Engineering Inc. prior to footing concrete placements. All excavations must be backfilled under full time supervision by Planet Engineering Inc. representative to the same degree as the engineered fill pad. Surface water cannot be allowed to pond in excavations or to be trapped in clear stone backfill. Clear stone backfill can only be used with the approval of Planet Engineering Inc.
11. After completion of compaction, the surface of the pad must be protected from disturbance from traffic, rain and frost. During the course of fill placement, the engineered fill must be smooth-graded, proof rolled and sloped/crowned at the end of each day, prior to weekends and any stoppage in work in order to promote rapid runoff of rainwater and to avoid any ponding surface water. Any stockpiles of fill intended for use as engineered fill must also be smooth-bladed to promote runoff and/or protected from excessive moisture take up.
12. If there is a delay in construction, the engineered fill pad must be inspected and accepted by the geotechnical engineer. The location of the structure must be reconfirmed that it remains within the pad.
13. The geometry of the engineered fill as illustrated in these General Requirements is general in nature. Each project will have its own unique requirements. For example, if perimeter sidewalks are to be constructed around the building, then the projection of the engineered fill beyond the foundation wall may need to be greater.
14. These guidelines are to be read in conjunction with Planet Engineering Inc. report attached.

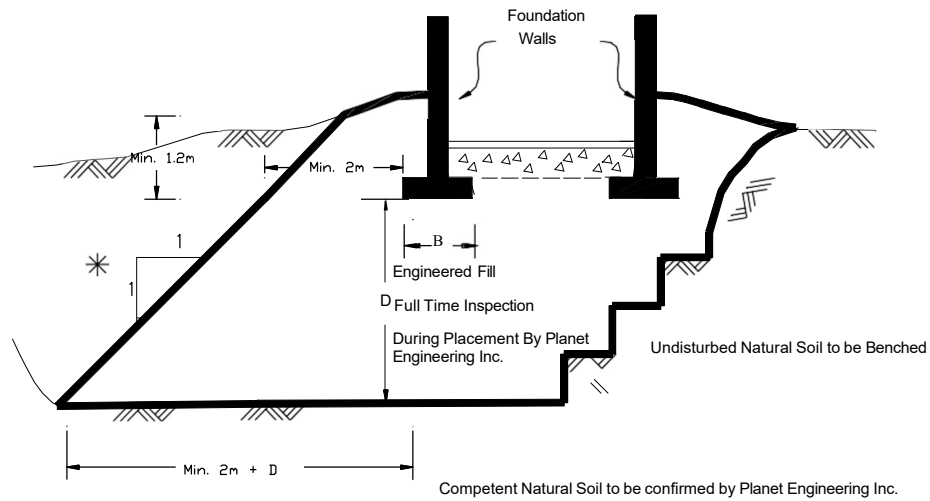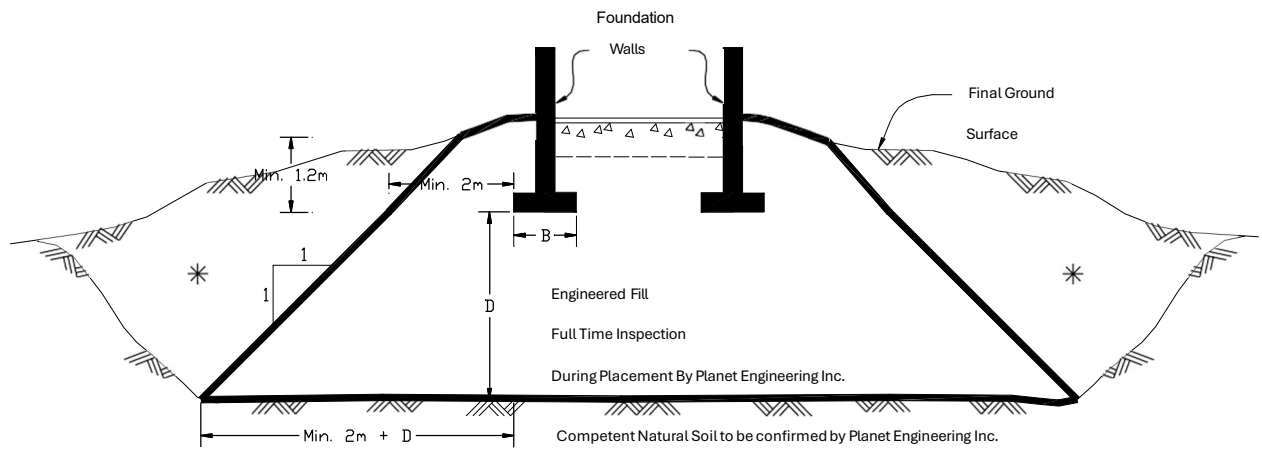

* Backfill in this area to be as per the Planet Engineering Inc. report

Appendix D:
Proposed Site Plan Provided by the Client

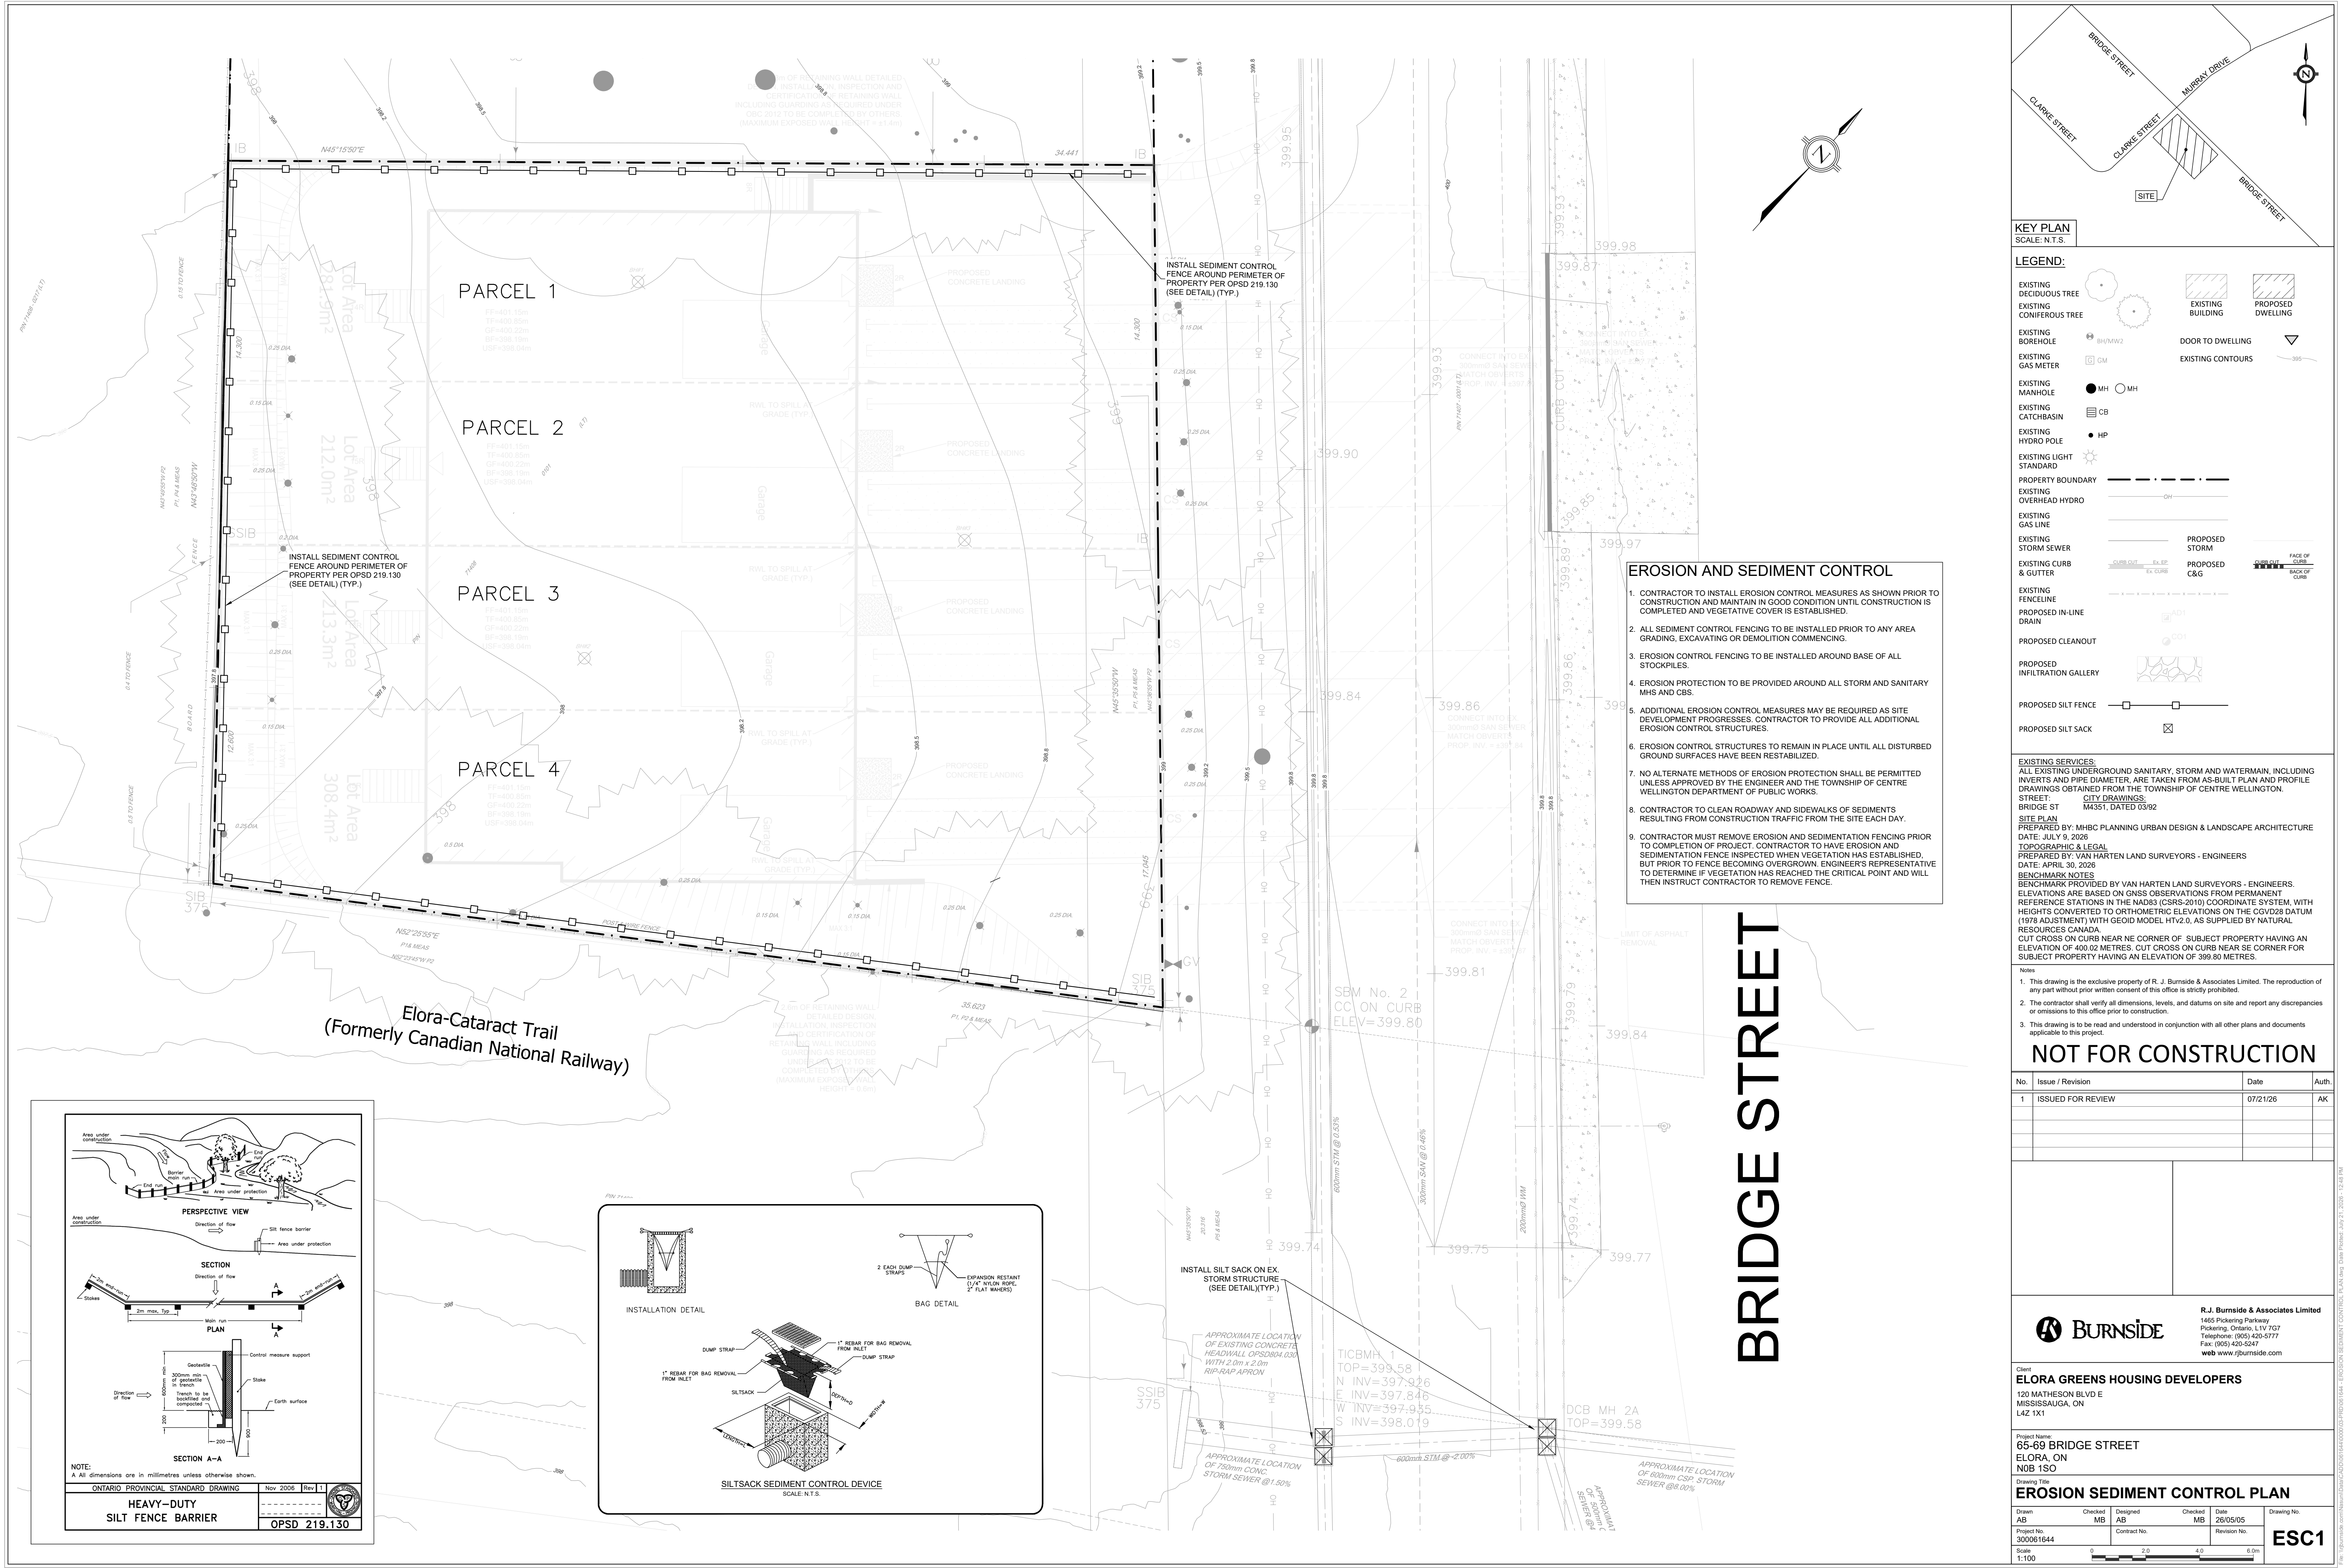

KEY PLAN
SCALE: N.T.S.

LEGEND:

EXISTING DECIDUOUS TREE

EXISTING CONIFEROUS TREE

EXISTING BOREHOLE

EXISTING GAS METER

EXISTING MANHOLE

EXISTING CATCHBASIN

EXISTING HYDRO POLE

EXISTING LIGHT STANDARD

EXISTING OVERHEAD HYDRO

EXISTING GAS LINE

EXISTING STORM SEWER

EXISTING CURB & GUTTER

EXISTING FENCELINE

PROPOSED CLEANOUT

PROPOSED INFILTRATION GALLERY

PROPOSED SILT FENCE

PROPOSED SILT SACK

EXISTING BUILDING

PROPOSED DWELLING

DOOR TO DWELLING

EXISTING CONTOURS

PROPERTY BOUNDARY

EXISTING OVERHEAD HYDRO

PROPOSED STORM

PROPOSED C&G

FACE OF CURB

BACK OF CURB

EROSION AND SEDIMENT CONTROL

- CONTRACTOR TO INSTALL EROSION CONTROL MEASURES AS SHOWN PRIOR TO CONSTRUCTION AND MAINTAIN IN GOOD CONDITION UNTIL CONSTRUCTION IS COMPLETED AND VEGETATIVE COVER IS ESTABLISHED.
- ALL SEDIMENT CONTROL FENCING TO BE INSTALLED PRIOR TO ANY AREA GRADING, EXCAVATING OR DEMOLITION COMMENCING.
- EROSION CONTROL FENCING TO BE INSTALLED AROUND BASE OF ALL STOCKPILES.
- EROSION PROTECTION TO BE PROVIDED AROUND ALL STORM AND SANITARY MHS AND CBS.
- ADDITIONAL EROSION CONTROL MEASURES MAY BE REQUIRED AS SITE DEVELOPMENT PROGRESSES. CONTRACTOR TO PROVIDE ALL ADDITIONAL EROSION CONTROL STRUCTURES.
- EROSION CONTROL STRUCTURES TO REMAIN IN PLACE UNTIL ALL DISTURBED GROUND SURFACES HAVE BEEN RESTABILIZED.
- NO ALTERNATE METHODS OF EROSION PROTECTION SHALL BE PERMITTED UNLESS APPROVED BY THE ENGINEER AND THE TOWNSHIP OF CENTRE WELLINGTON DEPARTMENT OF PUBLIC WORKS.
- CONTRACTOR TO CLEAN ROADWAY AND SIDEWALKS OF SEDIMENTS RESULTING FROM CONSTRUCTION TRAFFIC FROM THE SITE EACH DAY.
- CONTRACTOR MUST REMOVE EROSION AND SEDIMENTATION FENCING PRIOR TO COMPLETION OF PROJECT. CONTRACTOR TO HAVE EROSION AND SEDIMENTATION FENCE INSPECTED WHEN VEGETATION HAS ESTABLISHED, BUT PRIOR TO FENCE BECOMING OVERGROWN. ENGINEERS REPRESENTATIVE TO DETERMINE IF VEGETATION HAS REACHED THE CRITICAL POINT AND WILL THEN INSTRUCT CONTRACTOR TO REMOVE FENCE.

EXISTING SERVICES:

ALL EXISTING UNDERGROUND SANITARY, STORM AND WATERMAIN, INCLUDING INVERTS AND PIPE DIAMETER, ARE TAKEN FROM AS-BUILT PLAN AND PROFILE DRAWINGS OBTAINED FROM THE TOWNSHIP OF CENTRE WELLINGTON. STREET CITY DRAWINGS. BRIDGE ST M4351, DATED 03/92

SITE PLAN

PREPARED BY: MHBC PLANNING URBAN DESIGN & LANDSCAPE ARCHITECTURE DATE: JULY 9, 2026

TOPOGRAPHIC & LEGAL

PREPARED BY: VAN HARTEN LAND SURVEYORS - ENGINEERS DATE: APRIL 30, 2026

BENCHMARK NOTES

BENCHMARK PROVIDED BY VAN HARTEN LAND SURVEYORS - ENGINEERS. ELEVATIONS ARE BASED ON GNSS OBSERVATIONS FROM PERMANENT REFERENCE STATIONS IN THE NAD83 (CSRS-2010) COORDINATE SYSTEM, WITH HEIGHTS CONVERTED TO ORTHOMETRIC ELEVATIONS ON THE CGVD28 DATUM (1978 ADJUSTMENT) WITH GEOID MODEL HTV2.0, AS SUPPLIED BY NATURAL RESOURCES CANADA. CUT CROSS ON CURB NEAR NE CORNER OF: SUBJECT PROPERTY HAVING AN ELEVATION OF 400.02 METRES. CUT CROSS ON CURB NEAR SE CORNER FOR SUBJECT PROPERTY HAVING AN ELEVATION OF 399.80 METRES.

Notes

- This drawing is the exclusive property of R. J. Burnside & Associates Limited. The reproduction of any part without prior written consent of this office is strictly prohibited.
- The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to this office prior to construction.
- This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

NOT FOR CONSTRUCTION

No.	Issue / Revision	Date	Auth.
1	ISSUED FOR REVIEW	07/21/26	AK

R. J. Burnside & Associates Limited
1405 Pickering Parkway
Pickering, Ontario, L1V 7G7
Telephone: (905) 420-5777
Fax: (905) 420-5247
web www.rjburnside.com

Client
ELORA GREENS HOUSING DEVELOPERS
120 MATHESON BLVD E
MISSISSAUGA, ON
L4Z 1X1

Project Name:
65-69 BRIDGE STREET
ELORA, ON
NOB 150

Drawing Title
EROSION SEDIMENT CONTROL PLAN

Drawn	Checked	Designed	Checked	Date	Drawing No.
AB	MB	AB	MB	26/05/05	



Project No.
300061644


Contract No.

Revision No.

Scale
1:100

ESC1

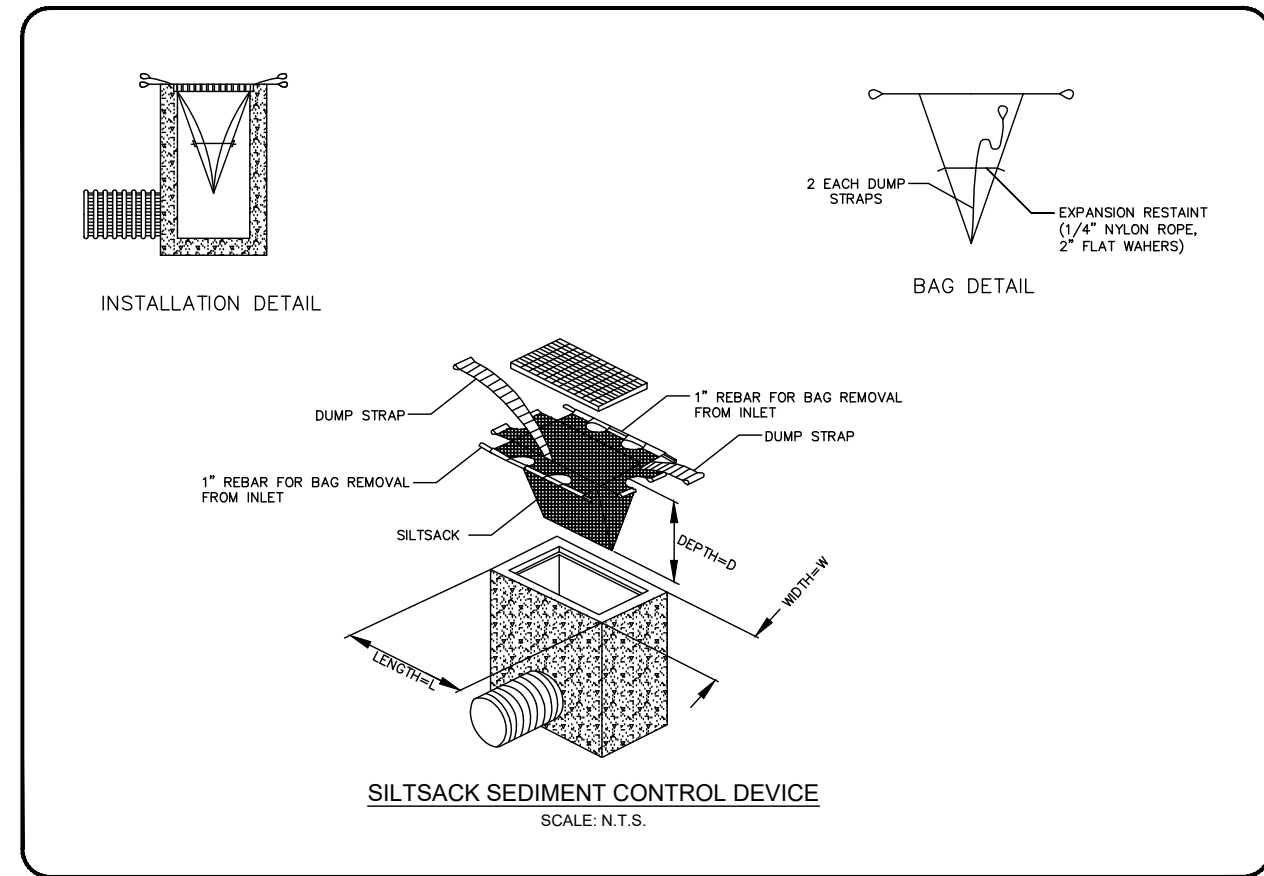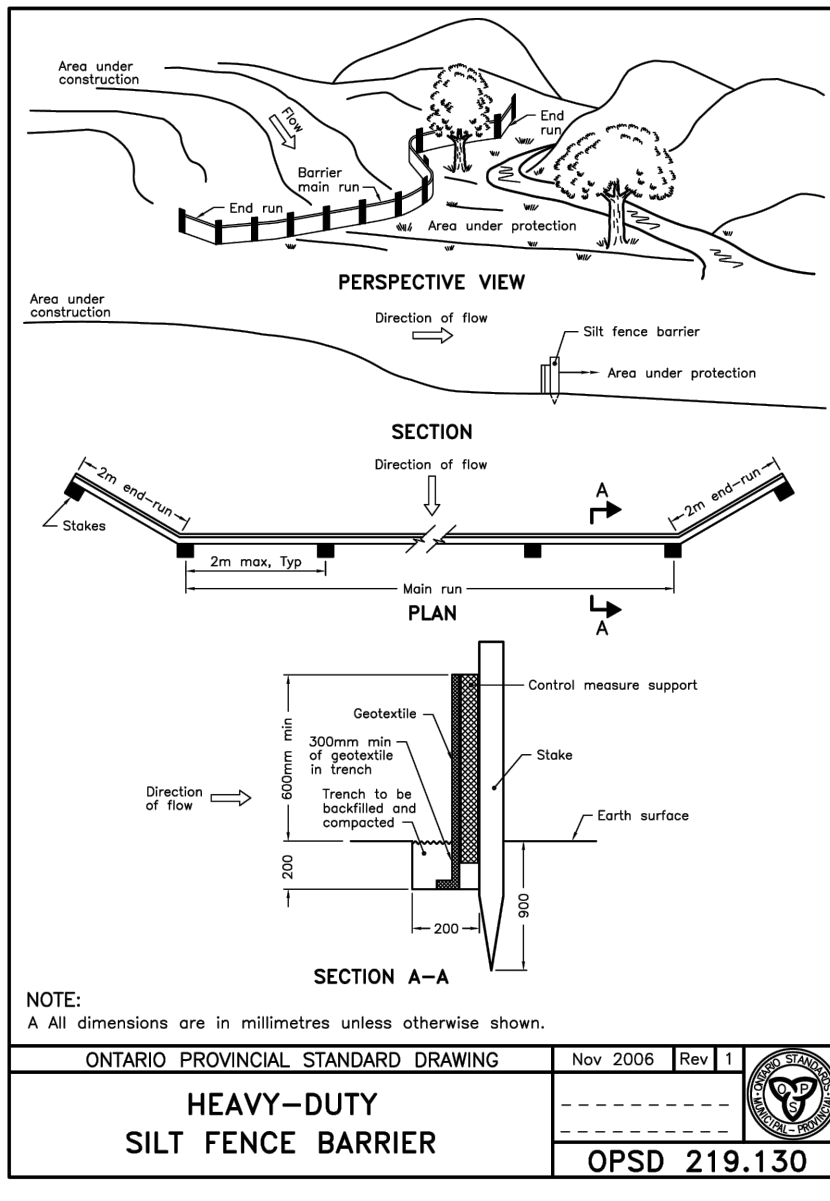

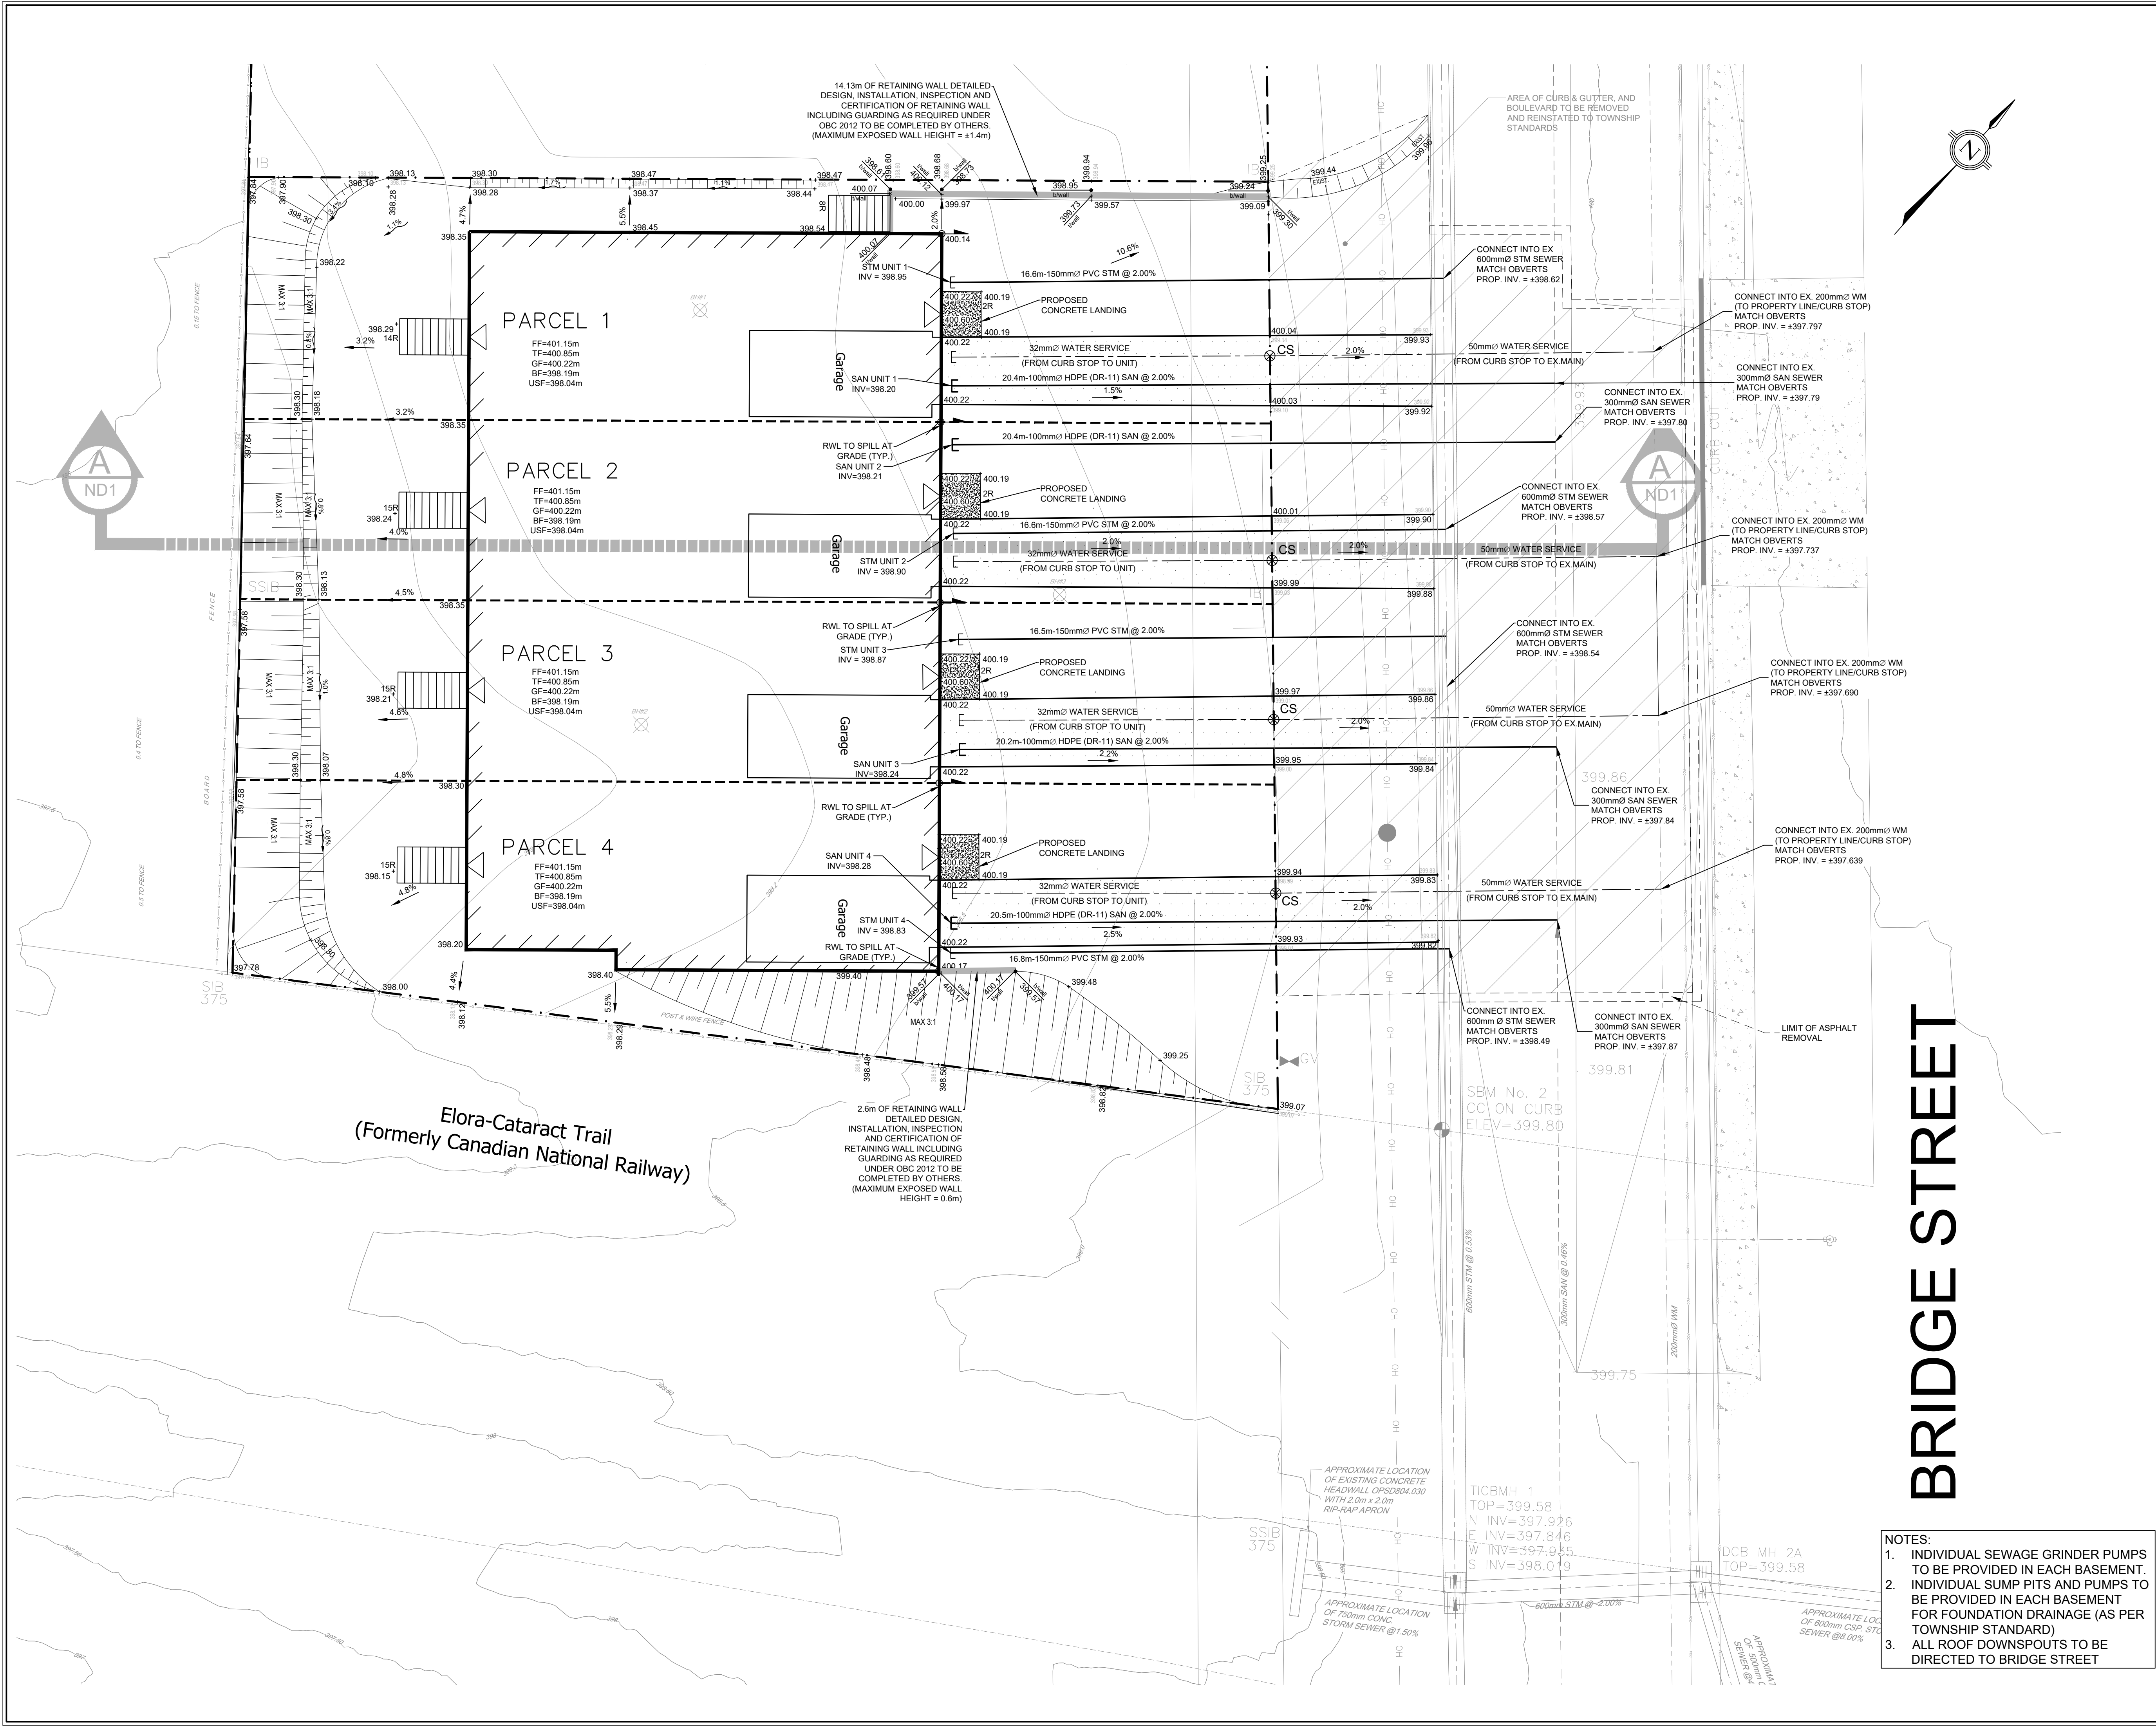

BRIDGE STREET

- NOTES:
- INDIVIDUAL SEWAGE GRINDER PUMPS TO BE PROVIDED IN EACH BASEMENT.
 - INDIVIDUAL SUMP PITS AND PUMPS TO BE PROVIDED IN EACH BASEMENT FOR FOUNDATION DRAINAGE (AS PER TOWNSHIP STANDARD)
 - ALL ROOF DOWNSPOUTS TO BE DIRECTED TO BRIDGE STREET

KEY PLAN
SCALE: N.T.S.

LEGEND:
PROPERTY BOUNDARY
PARCEL BOUNDARY
EXISTING DECIDUOUS TREE
EXISTING CONIFEROUS TREE
EXISTING BOREHOLE
EXISTING GAS METER
EXISTING MANHOLE
EXISTING CATCHBASIN
EXISTING HYDRO POLE
EXISTING LIGHT STANDARD
EXISTING OVERHEAD HYDRO
EXISTING GAS LINE
EXISTING WATER LINE
EXISTING SANITARY SEWER
EXISTING STORM SEWER
EXISTING CURB & GUTTER
EXISTING FENCELINE
REMOVALS

EXISTING SERVICES:
ALL EXISTING UNDERGROUND SANITARY, STORM AND WATERMAIN, INCLUDING INVERTS AND PIPE DIAMETER, ARE TAKEN FROM AS-BUILT PLAN AND PROFILE DRAWINGS OBTAINED FROM THE TOWNSHIP OF CENTRE WELLINGTON. CITY DRAWINGS, BRIDGE ST M4351, DATED 03/92
SITE PLAN
PREPARED BY: MHBC PLANNING URBAN DESIGN & LANDSCAPE ARCHITECTURE DATE: JULY 9, 2026
TOPOGRAPHIC & LEGAL
PREPARED BY: VAN HARTEN LAND SURVEYORS - ENGINEERS DATE: APRIL 30, 2026
BENCHMARK NOTES
BENCHMARK PROVIDED BY VAN HARTEN LAND SURVEYORS - ENGINEERS. ELEVATIONS ARE BASED ON GNSS OBSERVATIONS FROM PERMANENT REFERENCE STATIONS IN THE NAD83 (CSRS-2010) COORDINATE SYSTEM, WITH HEIGHTS CONVERTED TO ORTHOMETRIC ELEVATIONS ON THE CGVD28 DATUM (1978 ADJUSTMENT) WITH GEOID MODEL HTV2.0, AS SUPPLIED BY NATURAL RESOURCES CANADA. CUT CROSS ON CURB NEAR NE CORNER OF: SUBJECT PROPERTY HAVING AN ELEVATION OF 400.02 METRES. CUT CROSS ON CURB NEAR SE CORNER FOR SUBJECT PROPERTY HAVING AN ELEVATION OF 399.80 METRES.

Notes
1. This drawing is the exclusive property of R. J. Burnside & Associates Limited. The reproduction of any part without prior written consent of this office is strictly prohibited.
2. The contractor shall verify all dimensions, levels, and datums on site and report any discrepancies or omissions to this office prior to construction.
3. This drawing is to be read and understood in conjunction with all other plans and documents applicable to this project.

NOT FOR CONSTRUCTION

No.	Issue / Revision	Date	Auth.
1	ISSUED FOR REVIEW	07/21/26	AK

R. J. Burnside & Associates Limited
1405 Pickering Parkway
Pickering, Ontario, L1V 7G7
Telephone: (905) 420-5777
Fax: (905) 420-5247
web: www.rjburnside.com

Client
ELORA GREENS HOUSING DEVELOPERS
120 MATHESON BLVD E
MISSISSAUGA, ON
L4Z 1X1

Project Name
65-69 BRIDGE STREET
ELORA, ON
NOB 1SO

Drawing Title
GRADING AND SERVICING PLAN

Drawn	Checked	Designed	Checked	Date	Drawing No.
DS	MB	DS	MB	26/05/05	

Project No.	Contract No.	Revision No.
300061644		

Scale: 1:100
0 2.0 4.0 6.0m

GS1

Plotted by:DSmuk Paper size: ARCH Full Bleed D (24.00 X 36.00 Inches) Plot table: Rjb Full Scale-pickering 2013.ctb

LEGEND:

—□—	DENOTES SURVEY MONUMENT SET
—■—	DENOTES SURVEY MONUMENT FOUND
SIB	DENOTES .025 x .025 x 1.20 STANDARD IRON BAR
IB	DENOTES .015 x .015 x 0.60 IRON BAR
SSIB	DENOTES .025 x .025 x 0.60 SHORT STANDARD IRON BAR
CC	DENOTES CUT CROSS
OU	DENOTES ORIGIN UNKNOWN
375	DENOTES BLACK, SHOEMAKER et. al., O.L.S.'s
VH	DENOTES VAN HARTEN SURVEYING INC., O.L.S.'s
P1	DENOTES REGISTERED PLAN 870
P2	DENOTES DEPOSITED PLAN WGR-13
P3	DENOTES DEPOSITED PLAN 61R-22657
P4	DENOTES SURVEYOR'S REAL PROPERTY REPORT BY (VH).
P5	PROJ. NO. 97-12950, DATED SEPTEMBER 22, 1988
P6	DENOTES DEPOSITED 61R-8466
EXISTING ELEVATION	×
PROPOSED ELEVATION	×
TOP OF FOUNDATION	T/F=206.33
FINISHED FLOOR ELEVATION	F/F=206.33
UTILITY POLE	●
HYDRO POLE	●
HP WITH LIGHT	●
LIGHT STANDARD	●
HYDRO METER	●
GUY WIRE	—
FIRE HYDRANT	●
WATER VALVE	●
GATE	—
SIGN	●
DIRECTION OF FLOW	→
DITCH/SWALE	—
OVERHEAD HYDRO	—
GAS LINE	—
WATER LINE	—
SANITARY SEWER	—
STORM SEWER	—
CENTRELINE OF ROAD	—
FENCELINE	—
TOP OF BANK	—
DECIDUOUS TREE	●
CONIFEROUS TREE	●
BELL PEDESTAL	●
TV PEDESTAL	●
GAS METER	●
MANHOLE	●
CATCHBASIN	●
ASPHALT	—
BUILDING	—
GRAVEL	—
CONCRETE	—

GENERAL NOTES:

- LOT ARRANGEMENT IS CONCEPTUAL IN NATURE AND SUBJECT TO DETAILED DESIGN AT THE BUILDING PERMIT STAGE.
- CONSTRUCTION FOR THIS PROJECT TO COMPLY WITH MOST RECENT VERSION OF TOWNSHIP OF CENTRE WELLINGTON DEVELOPMENT MANUAL, THE ONTARIO BUILDING CODE, AND OPSS AND OPSD. ALL UNDERGROUND SERVICE MATERIALS AND METHODS TO BE IN ACCORDANCE WITH THE LATEST APPLICABLE CODES AND STANDARDS.
- ALL CONSTRUCTION TO BE CARRIED OUT IN ACCORDANCE WITH THE OCCUPATIONAL HEALTH AND SAFETY ACT AND REGULATIONS FOR CONSTRUCTION PROJECTS.
- THE OWNER IS RESPONSIBLE FOR THE COORDINATION OF ALL REQUIRED UTILITIES.
- TEMPORARY SEDIMENT CONTROLS TO BE INSTALLED PRIOR TO ANY CONSTRUCTION ON SITE AND MAINTAINED FOR THE DURATION OF THE CONSTRUCTION PERIOD TO THE SATISFACTION OF THE TOWNSHIP OF CENTRE WELLINGTON.
- DISTURBED AREAS TO BE MINIMIZED TO THE EXTENT POSSIBLE, AND TEMPORARILY OR PERMANENTLY STABILIZED OR RESTORED AS THE WORK PROGRESSES.
- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING AND PROTECTING ALL UNDERGROUND AND OVERHEAD UTILITIES AND STRUCTURES EXISTING AT THE TIME OF CONSTRUCTION IN THE AREA OF THEIR WORK WHETHER SHOWN ON THE PLANS OR NOT AND FOR ALL REPAIRS AND CONSEQUENCES RELATING TO DAMAGE OF SAME.
- THE CONTRACTOR(S) SHALL BE SOLELY RESPONSIBLE TO GIVE 72 HOURS WRITTEN NOTICE TO THE UTILITIES, FOR THE PURPOSES OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE FOR THE DURATION OF CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COSTS ARISING FROM SUCH INSPECTION.
- A GEOTECHNICAL CONSULTANT SHOULD BE RETAINED TO CARRY OUT NECESSARY INSPECTIONS AND TESTING DURING CONSTRUCTION TO ENSURE PROPER PLACEMENT OF MATERIALS AND ADEQUATE COMPACTION.
- UNLESS OTHERWISE SPECIFIED BY A GEOTECHNICAL CONSULTANT, DRIVEWAY TO BE CONSTRUCTED WITH 150mm GRANULAR 'A' BASE, 300mm GRANULAR 'B' SUB BASE. THE BOULEVARD PORTION OF DRIVEWAY UP TO THE MUNICIPAL RIGHT OF WAY LIMIT IS TO BE COVERED WITH A HARD SURFACE SUCH AS 50mm HL3 ASPHALT PAVING, OR ANY OTHER SUBSTITUTION THAT IS ACCEPTABLE TO THE MUNICIPALITY.
- ANY ERRORS, OMISSIONS AND/OR CHANGE OF CONDITIONS ON SITE TO BE BROUGHT TO THE ATTENTION OF THE ENGINEER PRIOR TO PERFORMING THE RELATED WORK.
- PLAN BASED ON TOPOGRAPHIC SURVEY COMPLETED BY VAN HARTEN SURVEYING INC. ON JULY 2, 2024.
- THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED FOR TRANSACTION OR MORTGAGE PURPOSES.

SERVICING NOTES

- ALL MATERIALS AND CONSTRUCTION METHODS MUST CORRESPOND TO THE CURRENT TOWNSHIP OF CENTRE WELLINGTON STANDARDS AND SPECIFICATIONS AND APPLICABLE OPSS / OPSD.
- THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR LOCATES, EXPOSING, SUPPORTING, AND PROTECTING ALL UNDERGROUND AND OVERHEAD UTILITIES AND STRUCTURES EXISTING AT THE TIME OF CONSTRUCTION IN THE AREA OF THEIR WORK WHETHER SHOWN ON THE PLANS OR NOT AND FOR ALL REPAIRS AND CONSEQUENCES RELATING TO DAMAGE OF SAME.
- THE CONTRACTOR(S) SHALL BE SOLELY RESPONSIBLE TO GIVE 72 HOURS WRITTEN NOTICE TO THE UTILITIES, FOR THE PURPOSES OF INSPECTION BY THE CONCERNED UTILITY. THIS INSPECTION WILL BE FOR THE DURATION OF CONSTRUCTION, WITH THE CONTRACTOR RESPONSIBLE FOR ALL COSTS ARISING FROM SUCH INSPECTION.
- SERVICING TO RETAINED PARCEL TO REMAIN UNTOUCHED. IF SERVICES TO RETAINED PARCEL ARE FOUND TO BE IN CONFLICT WITH PROPOSED WORKS, ENGINEER AND TOWNSHIP TO BE IMMEDIATELY NOTIFIED.

SANITARY

- SANITARY SERVICES TO BE 100mm PVC DR28 AND GREEN IN COLOUR.
- ALL CONCRETE AND PVC PIPE SHALL HAVE RUBBER GASKET JOINTS.
- ALL PVC SEWERS SHALL BE CONSTRUCTED WITH BEDDING IN ACCORDANCE WITH OPSD 802.010 CLASS 'B' UNLESS OTHERWISE NOTED.
- SANITARY LATERAL TO BE INSTALLED AT MINIMUM 2% SLOPE.
- BUILDER IS TO ENSURE THE PROPOSED UNDERSIDE OF FOOTING ALLOWS A GRAVITY SEWER CONNECTION. IF GRAVITY FLOW TO THE SANITARY SERVICE CANNOT BE ACHIEVED FROM THE PROPOSED UNDERSIDE OF FOOTING, A SEWAGE EJECTOR PUMP IS TO BE INSTALLED AS PER O.B.C. AND MUNICIPAL REQUIREMENTS.

STORM

- SUMP PUMP TO DISCHARGE TO ROCK-LINED PAD AT GRADE.
- DOWNSPOUTS TO DISCHARGE TO SPLASH PAD AT GRADE.


WATER

- ALL MUNICIPAL OWNED WATER VALVES TO BE OPERATED BY THE TOWNSHIP OF CENTRE WELLINGTON. THE CONTRACTOR IS TO COORDINATE ALL NECESSARY VALVE OPERATIONS WITH THE TOWNSHIP PUBLIC WORKS DEPARTMENT.
- WATER SERVICES SIZE 50mm AND SMALLER MUST BE TYPE 'K' SOFT COPPER PIPE PER ASTM B88-49 SPECIFICATION.

GRADING NOTES:

- UNDERSIDE OF FOOTING TO BE MINIMUM 1.22m BELOW EXTERIOR GRADES AROUND BUILDING. TOP OF FOUNDATION WALL TO BE MINIMUM 0.15m ABOVE EXTERIOR GRADES AROUND BUILDING. LOT TO BE GRADED SO THAT WATER DOES NOT POND AT/NEAR BUILDINGS OR SEWAGE DISPOSAL SYSTEM.
- DRIVEWAY AND PARKING AREAS TO BE BETWEEN 1% AND 5% UNLESS OTHERWISE NOTED.
- ALL LANDSCAPE AREAS ON SITE TO BE RESTORED WITH MINIMUM OF 150mm TOPSOIL AND EITHER SEED OR SOO.
- MATCH EXISTING GRADES AT ALL PROPERTY LIMITS. GRADING NOT TO EXTEND ONTO ADJACENT PROPERTIES WITHOUT PRIOR WRITTEN CONSENT OF ADJACENT PROPERTY OWNER.
- SLOPES TO BE MAXIMUM 4H:1V UNLESS OTHERWISE NOTED.
- ALL EARTHWORKS ACTIVITIES TO BE UNDERTAKEN IN COMPLIANCE WITH O.Reg 406/19 REGARDING ON-SITE AND EXCESS SOIL MANAGEMENT.

INFILTRATION TRENCH DETAIL (NTS):

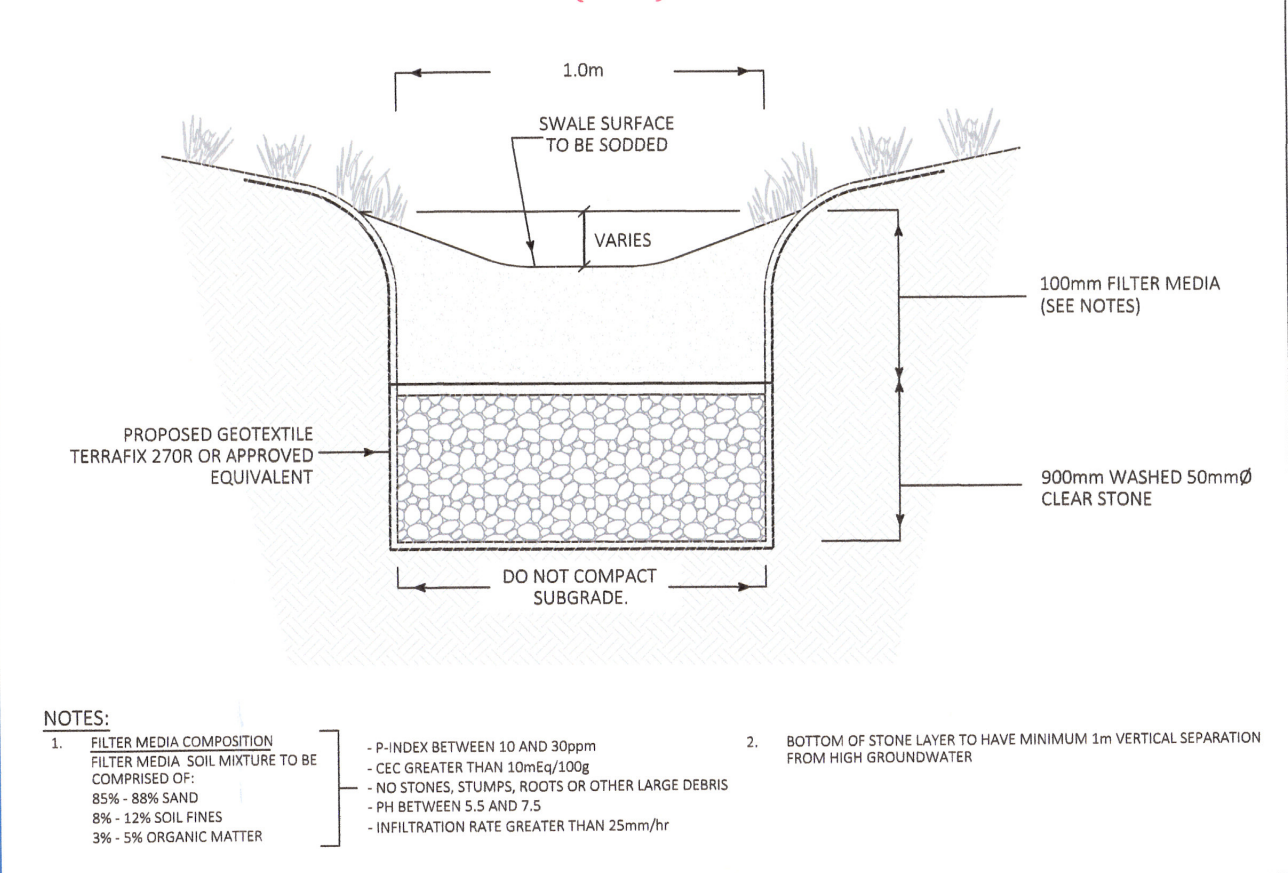

KNOWN AS CLARKE STREET

(ESTABLISHED BY REGISTERED PLAN 870)


PIN 71408 - 0224 (LT)

PART 24, WGR-13


PART 1, 61R-6030

PART 7, 61R-7352

PART 4, 61R-7350

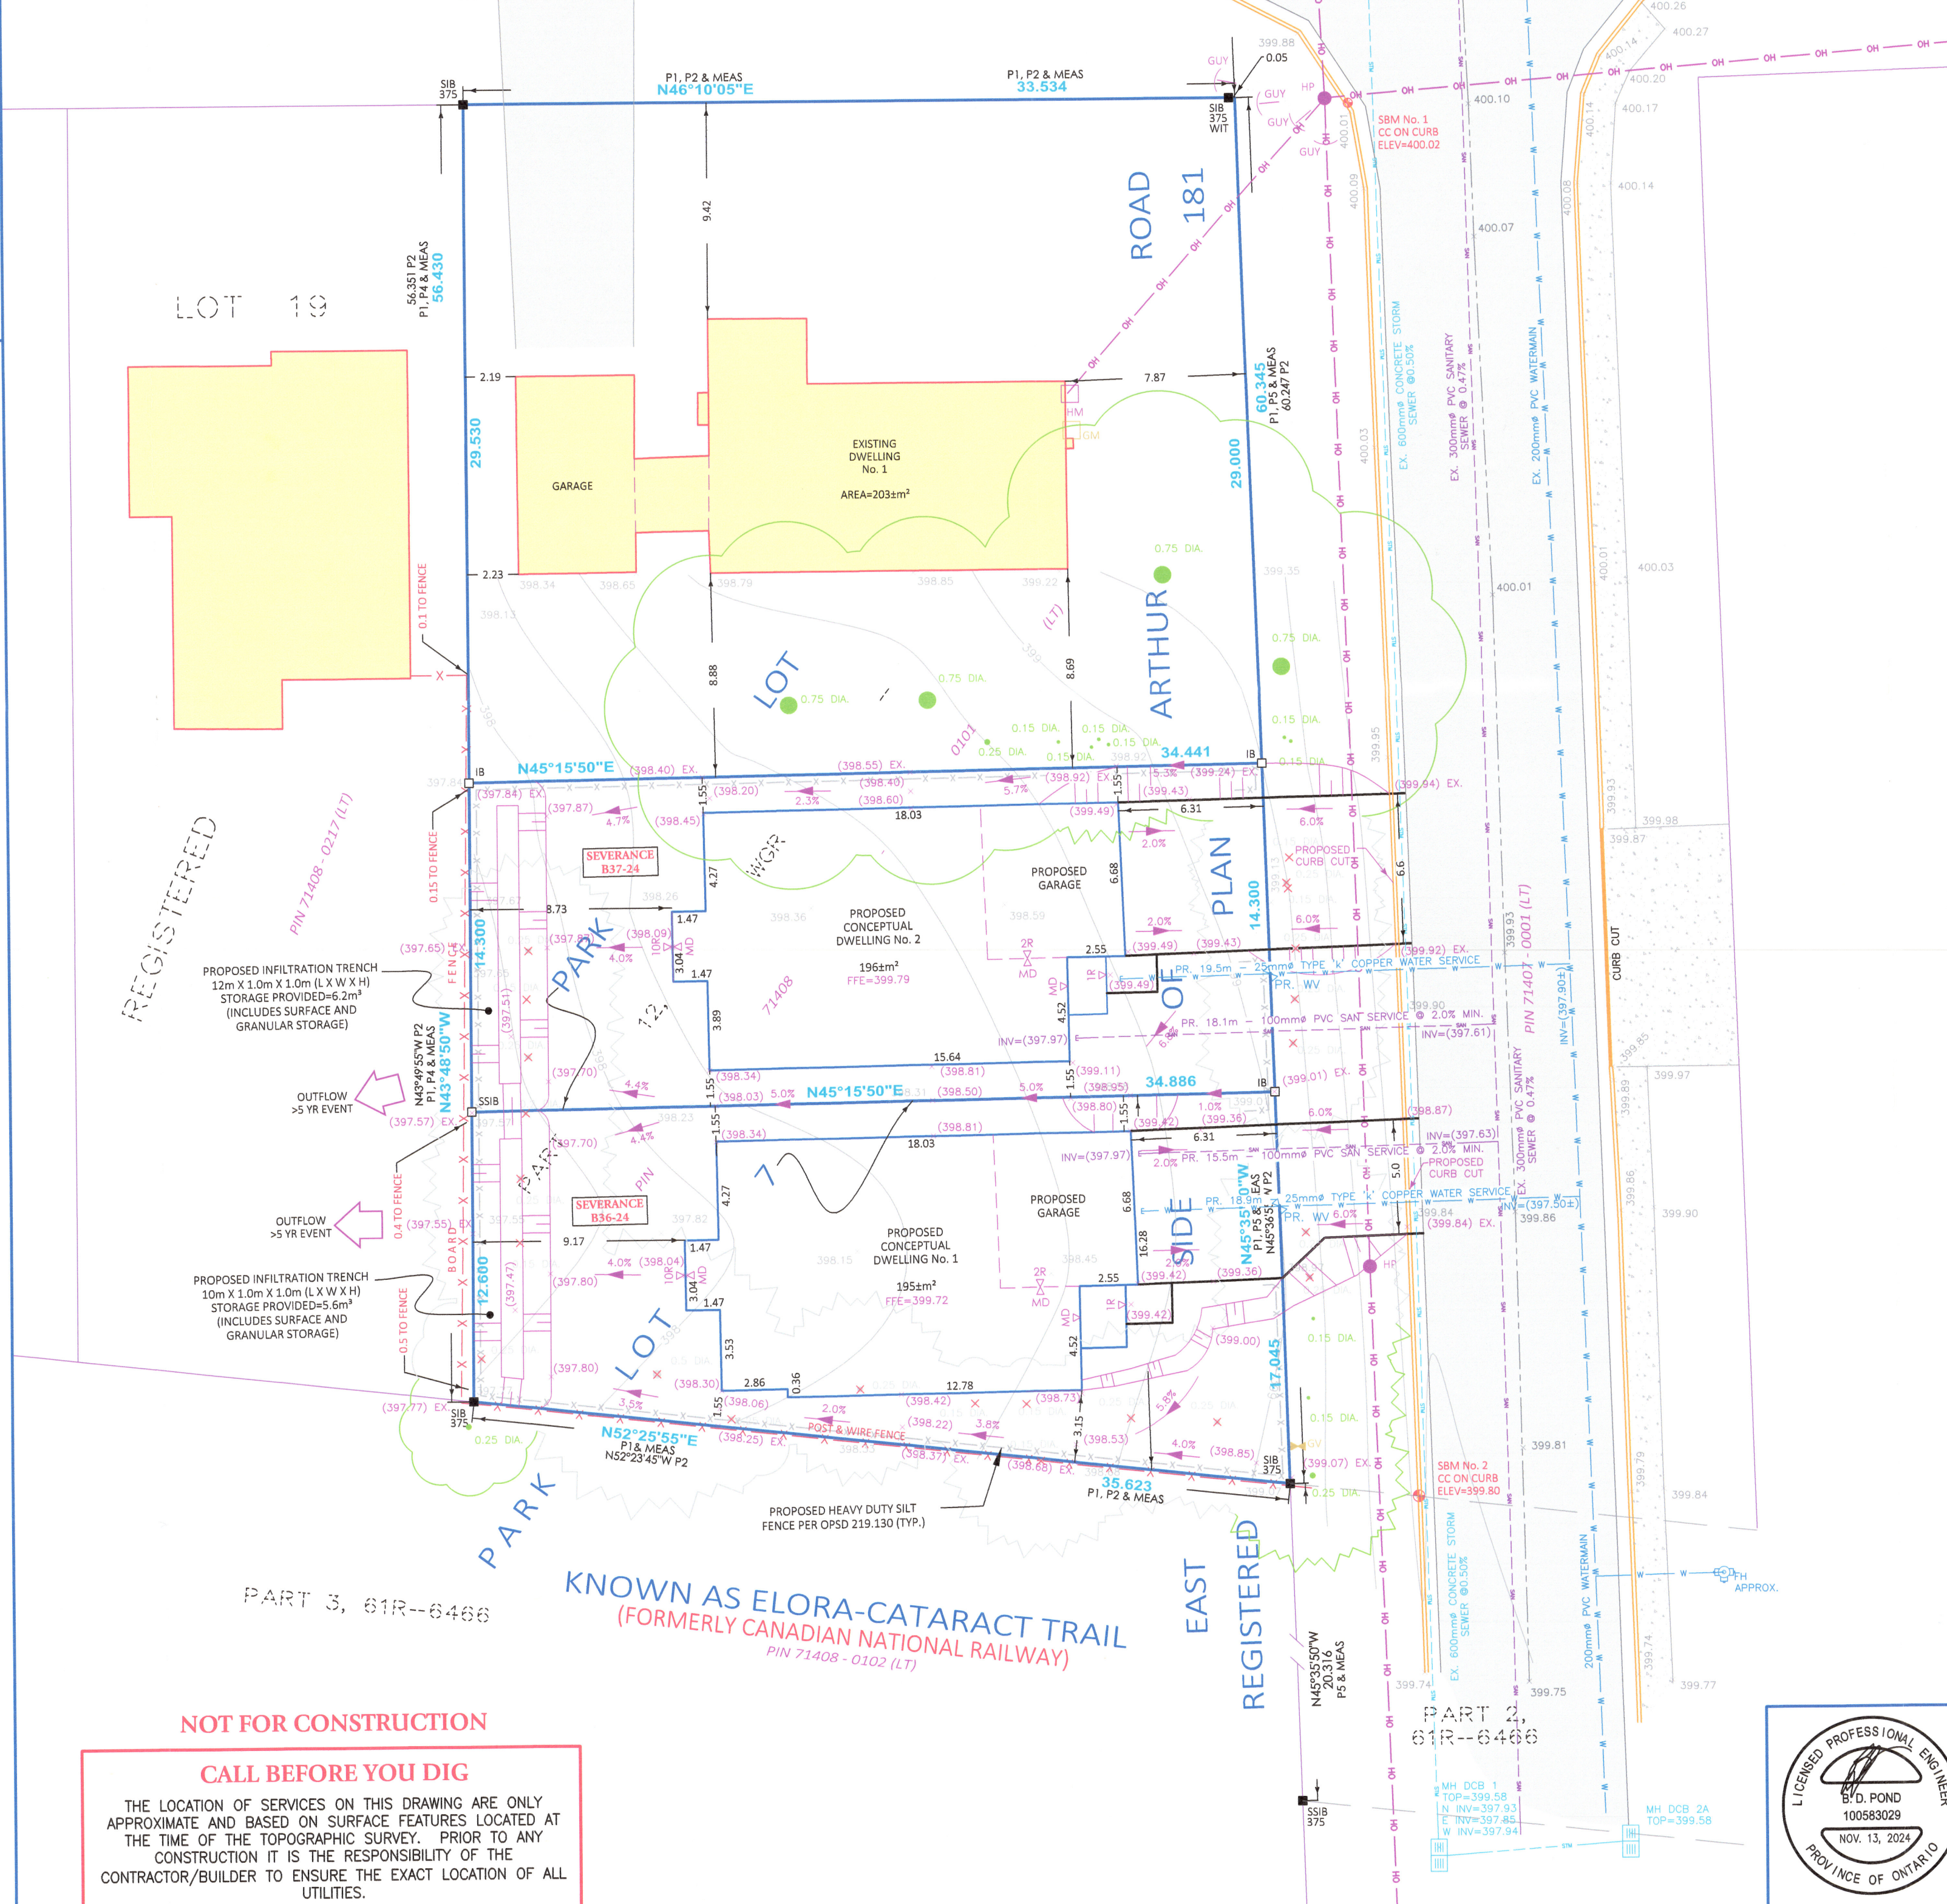

KEYMAP:

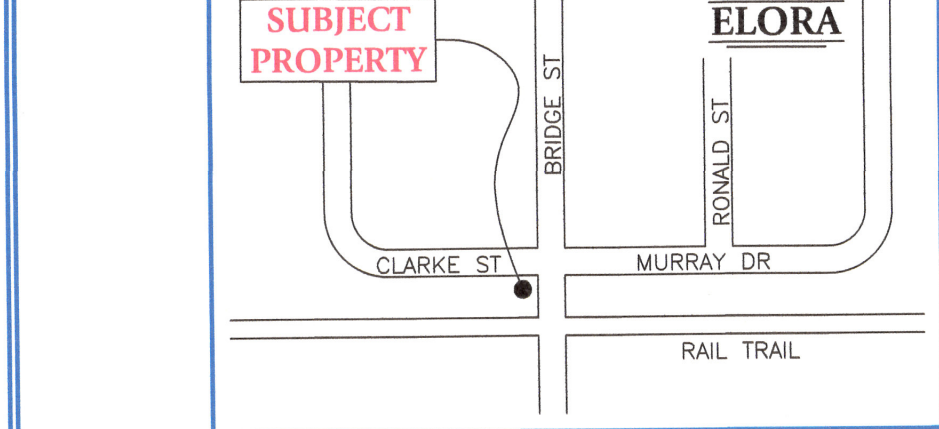

PROPERTY DESCRIPTION:

- PIN 71408-0101 (LT)
- ADDRESS: 1 CLARKE STREET
- PART OF PARK LOTS 5 & 7, EAST SIDE OF ARTHUR ROAD, REGISTERED PLAN 181
- TOWNSHIP OF CENTRE WELLINGTON

ZONING: RESIDENTIAL (R1A)

REQUIRED	PROPOSED (1)	PROPOSED (2)
MINIMUM LOT AREA 560m²	• (520.3m²)*	• (495.6m²)
MINIMUM LOT FRONTAGE = 18.0m	• (16.28m)*	• (14.3m)*
MINIMUM LOT DEPTH = 26.0m	• (34.8m)	• (34.4m)
MINIMUM FRONT YARD = 6.0m	• (6.3m)	• (6.3m)
MINIMUM INTERIOR SIDE YARD = 1.5m	• (1.5m)	• (1.5m)
MINIMUM REAR YARD = 7.5m	• (9.17m)	• (8.73m)
MAXIMUM LOT COVERAGE = 40%	• (37.4%)	• (39.3%)

* MINOR VARIANCE REQUESTED

CONCEPTUAL DWELLING: #1

TOP OF FOUNDATION	= (399.42)
UNDERSIDE OF FOOTING	= (398.86)
BASEMENT FLOOR	= (397.13)
FINISHED FLOOR	= (399.72)
GARAGE CUT	= (0)
GARAGE SLAB	= (399.42)

CONCEPTUAL DWELLING: #2

TOP OF FOUNDATION	= (399.49)
UNDERSIDE OF FOOTING	= (398.95)
BASEMENT FLOOR	= (397.20)
FINISHED FLOOR	= (399.79)
GARAGE CUT	= (0)
GARAGE SLAB	= (399.49)

ASSUMPTIONS

- 7"-11" FOUNDATION WALLS. 4" BASEMENT SLAB, 6" FOOTING

BEARING AND COORDINATE NOTE:

- BEARINGS ARE GRID BEARINGS AND ARE DERIVED FROM GPS OBSERVATIONS AND ARE REFERRED TO THE UTM PROJECTION, ZONE 17, NAD 83 (CSRS-2010) ADJUSTMENT.
- DISTANCES SHOWN ON THIS PLAN ARE ADJUSTED GROUND DISTANCES AND CAN BE CONVERTED TO GRID DISTANCES BY MULTIPLYING BY AN AVERAGED COMBINED SCALE FACTOR OF 0.999570.
- COORDINATES ON THIS PLAN ARE UTM, ZONE 17, NAD83 (CSRS-2010) ADJUSTMENT AND ARE BASED ON GPS OBSERVATIONS FROM A NETWORK OF PERMANENT GPS REFERENCE STATIONS.

BEARING COMPARISONS:

FOR THE PURPOSES OF BEARING COMPARISONS, PREVIOUS SURVEYS HAVE BEEN ROTATED TO UTM BEARINGS BY THE ANGLES SHOWN BELOW.

PLANS	ROTATION FOR NORTHEAST BEARINGS
P1, P4, P5	-0°08'35"
P2	-0°08'05"

SURVEY INFORMATION:

BENCHMARK REFERENCE:
ELEVATIONS ARE BASED ON GNSS OBSERVATIONS FROM PERMANENT REFERENCE STATIONS IN THE NAD83 (CSRS-2010) COORDINATE SYSTEM, WITH HEIGHTS CONVERTED TO ORTHOMETRIC ELEVATIONS ON THE CGVD28 DATUM (1978 ADJUSTMENT) WITH GEOID MODEL HTV2.0, AS SUPPLIED BY NATURAL RESOURCES CANADA.

SITE BENCHMARK

- CUT CROSS ON CURB NEAR NORTH EAST CORNER OF SUBJECT PROPERTY HAVING AN ELEVATION OF 400.02 METRES.
- CUT CROSS ON CURB NEAR SOUTH EAST CORNER FOR SUBJECT PROPERTY HAVING AN ELEVATION OF 399.80 METRES.

TOPOGRAPHIC SURVEY DATE:

THIS TOPOGRAPHIC SURVEY WAS COMPLETED ON THE 2nd DAY OF JULY, 2024.

CAUTION:

THIS IS NOT A PLAN OF SURVEY AND SHALL NOT BE USED FOR TRANSACTION OR MORTGAGE PURPOSES.

THIS SKETCH IS PROTECTED BY COPYRIGHT. ©

DISTANCES SHOWN ON THIS PLAN ARE IN METRES AND CAN BE CONVERTED TO FEET BY DIVIDING BY 0.3048.

CONCEPTUAL SITE PLAN FOR: PART OF PARK LOTS 5 & 7 EAST SIDE OF ARTHUR ROAD REGISTERED PLAN 181 GEOGRAPHIC VILLAGE OF ELORA TOWNSHIP OF CENTRE WELLINGTON COUNTY OF WELLINGTON

DRAWING REVISION SCHEDULE

NO.	REVISION	DATE
2	REISSUED FOR SEVERANCE APPLICATION	NOV. 13, 2024
1	ISSUED FOR SEVERANCE APPLICATION	SEPT. 27, 2024

PREPARED FOR: ANDY CHURCH

PROJECT No. 33156-24

DRAWING SCALE 1 : 200


0 2.5 5 7.5 10 metres

THE INTENDED PLOT SIZE OF THIS PLAN IS 762mm IN WIDTH BY 610mm IN HEIGHT. THE ORIGINAL VERSION OF THIS PLAN WAS CREATED IN COLOUR.

Van Harten
LAND SURVEYORS - ENGINEERS

Kitchener/Waterloo Ph: 519-742-8371	Geelph Ph: 519-821-2763	Orangeville Ph: 519-940-4110
www.vanharten.com		info@vanharten.com
DRAWN BY: S.A.P./T.J.H.	DESIGNED BY: B.P.	CHECKED BY: B.P.

Nov 13, 2024-8:40am
G:\ELORA\181\Areas\acad\SITE PT LOT 5 & 7 (CHURCH) UTM 2010.dwg

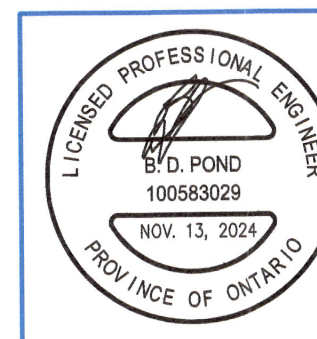

Appendix E:

Percolation Memo

To:

Elora Greens Inc.

120 Matheson Blvd. E., Unit 3

Mississauga, ON L4Z 1X1

Email: sam@osmows.com

CC:

Mr. Farhan Kamali Siddiqui

farhan@eloragreens.com

From: Kourosh Mohammadi, Ph.D. P.Eng.

Date: June 18, 2026

PLANET Project No.: 2601486AG

Subject:

Percolation Tests at 65-69 Bridge St, Township of Central Wellington, Ontario

1 INTRODUCTION

Planet Engineering Inc. (PLANET) was retained by Elora Greens Inc. (the Client) to perform a percolation test at the proposed location for the low impact development (LID) at 65-69 Bridge St, Township of Central Wellington, Ontario (the Site).

2 PERCOLATION TEST

2.1 Field Work

On June 2, 2026, PLANET personnel conducted an on-site percolation test after obtaining utility locates. A single 150-mm diameter borehole was drilled to approximately 1.30 meters below ground surface (mbgs), with all loose material cleared from the sides and bottom. Groundwater was encountered at approximate depth of 2.1 mbgs. The location of the test hole is depicted in **Figure 1A**.

In addition, three (3) geotechnical boreholes were drilled by PLANET to depths ranging from 6.4 to 6.7 mbgs and monitoring wells were installed in those boreholes. Detailed borehole logs are included in **Appendix B**.

For the percolation test, the bottom of the borehole was lined with approximately 10 cm of clean sand to minimize the effects of borehole wall disturbance and ensure more representative percolation measurements. The sand layer helped to create a stable base, preventing sloughing of the native soil and promoting uniform percolation into the surrounding material.

3 TEST RESULTS

The percolation test results are presented in detail in **Attachment 1**, including time versus water level data and all intermediate calculations. The test was conducted in accordance with standard procedures for assessing percolation capacity in support of Low Impact Development (LID) design.

Following test setup, the borehole was saturated and the water level was brought to approximately 7 cm below the ground surface. Measurements of water level decline were recorded at regular intervals to monitor the rate of percolation. The initial percolation rates were higher, which is typical due to soil saturation effects and the presence of macro pores. However, as the test progressed, the percolation rate began to stabilize, approaching a steady-state condition.

The final three recorded percolation rates were used to calculate the average steady-state percolation rate, as recommended in industry guidelines. These final values were as follows:

The **average of 2.1 mm/hour** was considered to be representative of the long-term percolation capacity of the soil at the tested depth. This value accounts for soil texture, compaction, and moisture conditions at the time of testing.

This result indicates very low infiltration capacity of the native soils and suggests that infiltration-based stormwater management practices may have limited effectiveness at this location. The measured percolation rate should be considered in the design and evaluation of the proposed stormwater management system, and alternative approaches such as controlled discharge or enhanced storage may be required. The findings presented herein are based on the test location and subsurface conditions encountered during the investigation and are intended to provide input for preliminary stormwater management planning and design.

4 LIMITATIONS

Planet Engineering Inc. has performed this site assessment in accordance with generally accepted professional practices and procedures at the time of the assessment. These services are not subject to any express or implied warranties and none should be inferred.

For and on behalf of Planet Engineering Inc.



Kourosh Mohammadi, Ph.D., P.Eng.

Principal Hydrogeological Engineer

ATTACHMENT 1

Percolation Test Field Measurements and Calculations

Test Pit:	PT-1
Tested By:	SA

Date:	2-Jun-26
Weather:	Sunny
Depth to Water (cm):	2.1
Diameter (cm)	15

Project No.:	2601486AG
Depth to Bedrock (m)	
Depth (cm):	130

Horizon	Soil Texture	Soil color	Pores, Roots, Rock	Comments
0.0 - 0.6 m	Top Soil	Blakish/Dark Brown		
0.6 - 1.3 m	Silty sandy clay	Brown		

Time (min)	Water Depth (cm)
0	7.0
5	10.0
10	11.5
15	12.5
20	13.5
25	15.0
30	15.5
35	16.5
40	16.5
45	18.0
50	18.5
55	19.5
60	19.5
70	21.5
80	22.5

Δt (min)	Depth Difference (cm) y
5	3
5	1.5
5	1
5	1
5	1.5
5	0.5
5	1
5	0
5	1.5
5	0.5
5	1
5	0
10	2
10	1

Water Drop (cm/min)	Midpoint Distance (m) d	Water Volume (m3) Vy	Well Area (m2) AT	Percol. Rate (mm/hr)
0.600	1.215	0.000529875	0.589815	10.78
0.300	1.193	0.000264938	0.5792175	5.49
0.200	1.180	0.000176625	0.57333	3.70
0.200	1.170	0.000176625	0.56862	3.73
0.300	1.158	0.000264938	0.5627325	5.65
0.100	1.148	8.83125E-05	0.5580225	1.90
0.200	1.140	0.000176625	0.55449	3.82
0.000	1.135	0	0.552135	0.00
0.300	1.128	0.000264938	0.5486025	5.80
0.100	1.118	8.83125E-05	0.5438925	1.95
0.200	1.110	0.000176625	0.54036	3.92
0.000	1.105	0	0.538005	0.00
0.200	1.095	0.00035325	0.533295	3.97
0.100	1.080	0.000176625	0.52623	2.01

Time (min)	Water Depth (cm)
90	23.5
100	24.5
113	25.8
120	26.5

Δt (min)	Depth Difference (cm) y		Water Drop (cm/min)	Midpoint Distance (m) d	Water Volume (m3) Vy	Well Area (m2) AT	Percol. Rate (mm/hr)
10	1		0.100	1.070	0.000176625	0.52152	2.03
10	1		0.100	1.060	0.000176625	0.51681	2.05
13	1.3		0.100	1.049	0.000229613	0.5113935	2.07
7	0.7		0.100	1.039	0.000123638	0.5066835	2.09

Diameter (D)

Depth Difference (y):

Midpoint Distance (d)

Water Volume (Vy)


Wall Area (A1)

Base Area (AB)

Total Area (AT)

Time difference (x)

Percolation rate = $\frac{V_y \text{ for "y" }}{AT \times x} = P \text{ L/m}^2\text{/Min}$

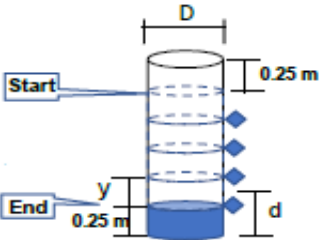

FIGURES



BOREHOLE LOCATION PLAN

Drawn By:
ZA

Project:


GEOTECHNICAL INVESTIGATION

Date:
June 12, 2026

Approved By:
IK

65-69 BRIDGE ST, TOWNSHIP OF CENTRAL WELLINGTON,
ONTARIO

Project No:
2601486AG

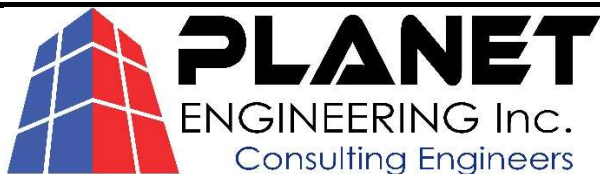

Client:

Elora Greens Inc.

Figure 1A

Appendix B

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings							DRILLING DATA							
CLIENT: Elora Greens Inc.							Method: Solid Stem Auger							
PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington							Diameter: 150mm				REF. NO.: 2601486AG			
DATUM: Geodetic							Date: Jun-02-2026				DRAWING NO.: 1			
BH LOCATION: N 4836564.441 E 547055.5554														
SOIL PROFILE			SAMPLES			GROUND WATER CONDITIONS	DYNAMIC CONE PENETRATION RESISTANCE PLOT		PLASTIC NATURAL LIQUID LIMIT			POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)
(m)	DESCRIPTION	STRATA PLOT	NUMBER	TYPE	"N" BLOWS 0.3 m		SHEAR STRENGTH (kPa)		WATER CONTENT (%)					
ELEV DEPTH							UNCONFINED	FIELD VANE & Sensitivity	Wp	W	Wl			
398.5	Topsoil:200mm													
0.0 398.3	Fill/Disturbed Native: silty sand, trace to some gravel & clay, trace rootlets, very moist, brown, loose		1	SS	7									
0.2														
1 397.4	Silty Sand Till to Sandy Silt Till: trace to some gravel & clay, boulders, very moist to moist, brown to grey, loose to compact		2	SS	4									12 36 43 9
1.1														
2			3	SS	18									
			4	SS	29									
3														
			5	SS	25									11 41 35 13
4														
393.9	Sandy Clayey Silt Till: trace gravel, boulders, moist to very moist, grey, hard		6	SS	40									
4.6														
5														
6														
392.2	End of Borehole: borehole terminated at 6.4m		7	SS	50 / 100mm									
6.4														
	Upon completion: 1) Cave-in: open 2) Water: 4.1mbgs 3) Monitoring well installed upon completion at 6.1mbgs Water Level Reading June 9, 2026 : 1.5mbgs													

GROUNDWATER ELEVATIONS

Measurement 1st 2nd 3rd 4th

GRAPH NOTES

+ 3, X 3: Numbers refer to Sensitivity

○ s=3% Strain at Failure

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings				DRILLING DATA							
CLIENT: Elora Greens Inc.				Method: Solid Stem Auger							
PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington				Diameter: 150mm		REF. NO.: 2601486AG					
DATUM: Geodetic				Date: Jun-02-2026		DRAWING NO.: 2					
BH LOCATION: N 4836553.135 E 547064.0464											
SOIL PROFILE			SAMPLES		GROUND WATER CONDITIONS	DYNAMIC CONE PENETRATION RESISTANCE PLOT		POCKET PEN. (Cu) (kPa)	NATURAL UNIT WT (kN/m³)	REMARKS AND GRAIN SIZE DISTRIBUTION (%)	
(m) ELEV DEPTH	DESCRIPTION	STRATA PLOT	NUMBER	TYPE		"N" BLOWS 0.3 m	ELEVATION				SHEAR STRENGTH (kPa)
							20 40 60 80 100				
398.1							20 40 60 80 100	PLASTIC LIMIT W _p	NATURAL MOISTURE CONTENT W	LIQUID LIMIT W _L	9 44 36 11
0.0 397.9	Topsoil: 180mm,						20 40 60 80 100				
0.2	Fill/Disturbed Native: silty sand, trace to some gravel & clay, trace rootlets, wet to very moist, blackish to brown, compact to loose		1	SS	16	398					
1			2	SS	4	397					
396.9						W. L. 397.0 m Jun 09, 2026					
1.2	Silty Sand Till to Sandy Silt Till: trace to some gravel & clay, boulders, very moist to moist, brown to grey, loose to dense		3	SS	7						
2			4	SS	24	396					
3			5	SS	32	395					
4						394					
393.5											
4.6	Sandy Clayey Silt Till: trace gravel, boulders, moist to very moist, grey, hard to very stiff		6	SS	58	393					
5											
6											
6.7	End of Borehole: borehole terminated at 6.7m										
	Upon completion: 1) Cave-in: open 2) Water: 1.4mbgs 3) Monitoring well installed upon completion at 6.1mbgs										
	Water Level Reading June 9, 2026 : 1.1mbgs										
391.4			7	SS	18	392					

PROJECT: Geotechnical Investigation for Proposed Residential Dwellings

CLIENT: Elora Greens Inc.

PROJECT LOCATION: 65-69 Bridge Street, Centre Wellington

DATUM: Geodetic

BH LOCATION: N 4836566.236 E 547070.9367

DRILLING DATA

Method: Solid Stem Auger

Diameter: 150mm

Date: Jun-02-2026

REF. NO.: 2601486AG

DRAWING NO.: 3

[illegible]

GROUNDWATER ELEVATIONS

	1st	2nd	3rd	4th
Measurement				

GRAPH
NOTES

$+^3, \times^3$: Numbers refer to Sensitivity

○ **$\epsilon=3\%$** Strain at Failure



BURNSIDE

[THE DIFFERENCE IS OUR PEOPLE]

Appendix D

Water Balance Calculations

WATER BALANCE CALCULATIONS
65-69 Bridge Street, Elora
Elora Greens Housing Developers

PROJECT No: 300061644.0000



TABLE WB-1

Pre- and Post-Development Monthly Water Balance Components													
Based on Thornthwaite's Soil Moisture Balance Approach with a Soil Moisture Retention of 125 mm (Urban Lawn in Sandy Silt)													
Climate data from WATERLOO WELLINGTON AIRPORT Climate Station (1981 - 2010)													

Potential Evapotranspiration Calculation	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Average Temperature (Degree C)	-6.50	-5.50	-1.00	6.20	12.50	17.60	20.00	18.90	14.50	8.20	2.50	-3.30	7.0
Heat index: $i = (t/5)^{1.514}$	0.00	0.00	0.00	1.38	4.00	6.72	8.16	7.49	5.01	2.11	0.35	0.00	35.2
Unadjusted Daily Potential Evapotranspiration U (mm)	0.00	0.00	0.00	29.03	60.80	87.22	99.80	94.02	71.10	38.99	11.14	0.00	492
Adjusting Factor for U (Latitude 43° 27' N)	0.81	0.82	1.02	1.12	1.26	1.28	1.29	1.2	1.04	0.95	0.81	0.77	
Adjusted Potential Evapotranspiration PET (mm)	0	0	0	33	77	112	129	113	74	37	9	0	582
COMPONENTS	JAN	FEB	MAR	APR	MAY	JUN	JUL	AUG	SEP	OCT	NOV	DEC	YEAR
Precipitation (P)	65	55	61	75	82	82	99	84	88	67	87	71	916.3
Potential Evapotranspiration (PET)	0	0	0	33	77	112	129	113	74	37	9	0	582
P - PET	65	55	61	42	6	-29	-30	-29	14	30	78	71	334
Change in Soil Moisture Storage	0	0	0	0	0	-29	-30	-29	14	30	44	0	0
Soil Moisture Storage max 125 mm	125	125	125	125	125	96	66	37	51	81	125	125	
Actual Evapotranspiration (AET)	0	0	0	33	77	112	129	113	74	37	9	0	582
Soil Moisture Deficit max 125 mm	0	0	0	0	0	29	59	88	74	44	0	0	
Water Surplus - available for infiltration or runoff	65	55	61	42	6	0	0	0	0	0	34	71	334
Potential Infiltration (based on MOE methodology*; independent of temperature)	33	27	31	21	3	0	0	0	0	0	17	36	167
Potential Direct Surface Water Runoff (independent of temperature)	33	27	31	21	3	0	0	0	0	0	17	36	167
IMPERVIOUS AREA WATER SURPLUS													
Precipitation (P)	916	mm/year											
Potential Evaporation (PE) from impervious areas (assume 15%)	137	mm/year											
P-PE (surplus available for runoff from impervious areas)	779	mm/year											

Assume January storage is 100% of Soil Moisture Storage

Soil Moisture Storage 125 mm

<-- See "Water Holding Capacity" values in Table 3.1, MOE SWMPDM, 2003

*MOE SWM infiltration calculations

topography - rolling land 0.2

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

soils - sandy silt 0.2

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

cover - grass 0.1

<-- Infiltration Factors from the bottom section of Table 3.1, MOE SWMPDM, 2003

Infiltration factor 0.5

Latitude of site (or climate station) 43 ° N.

WATER BALANCE CALCULATIONS

65-69 Bridge Street, Elora
Elora Greens Housing Developers

PROJECT No: 300061644.0000



TABLE WB-2

Water Balance - Existing Conditions and Post-Development (with no SWM/LID measures)												
Land Cover	Approx. Land Area (m ²)	Impervious Fraction for Land Cover	Estimated Impervious Area (m ²)	Runoff from Impervious Area* (m/a)	Runoff Volume from Impervious Area (m ³ /a)	Estimated Pervious Area (m ²)	Runoff from Pervious Area* (m/a)	Runoff Volume from Pervious Area (m ³ /a)	Infiltration from Pervious Area* (m/a)	Infiltration Volume from Pervious Area (m ³ /a)	Total Runoff Volume (m ³ /a)	Total Infiltration Volume (m ³ /a)
Existing Conditions												
Grass and Trees	1,020	0.05	51	0.779	40	969	0.167	162	0.167	162	202	162
TOTAL PRE-DEVELOPMENT	1,020		51		40	969		162		162	202	162
Post-Development Conditions (with no LID measures in place)												
Catchment 1000 - Front Catchment	720	0.75	540	0.779	421	180	0.167	30	0.167	30	451	30
Catchment 2000 - Back Catchment	300	0.05	15	0.779	12	285	0.167	48	0.167	48	59	48
TOTAL POST-DEVELOPMENT	1,020		555		432	465		78		78	510	78
% Change from Pre to Post											253	52
Effect of development (with no mitigation)											2.4 times increase in runoff	52 % reduction in infiltration

* figures from Table WB-1

To balance pre- to post-,
the infiltration target (m³/a)=

84 m³/a

